



REPORT

# STRUCTURAL STABILITY ASSESSMENT REPORT

## Monticello Steam Electric Station

**Submitted To:** Luminant  
1601 Bryan Street  
Dallas, TX 75201

**Submitted By:** Golder Associates Inc.  
500 Century Plaza Drive, Suite 190  
Houston, TX 77073 USA



Professional Engineering Firm  
Registration Number F-2578

October 2016

Project No. 164816403





## Table of Contents

1.0 INTRODUCTION..... 1

    1.1 Purpose..... 1

    1.2 Site Background..... 1

    1.3 Previous Slope Stability Evaluations..... 1

2.0 SUBSURFACE CONDITIONS..... 3

    2.1 Site Geology..... 3

        2.1.1 Subsurface Investigations and Laboratory Testing..... 3

        2.1.2 Subsurface Site Conditions..... 3

3.0 STRUCTURAL STABILITY ASSESSMENT - §257.73(d)(1)(i)-(vii)..... 5

    3.1 Foundations and Abutments - §257.73(d)(1)(i)..... 5

    3.2 Slope Protection - §257.73(d)(1)(ii)..... 5

    3.3 Dikes (Embankment) - §257.73(d)(1)(iii)..... 5

    3.4 Vegetated Slopes - §257.73(d)(1)(iv)..... 6

    3.5 Spillways - §257.73(d)(1)(v)..... 6

    3.6 Hydraulic Structures - §257.73(d)(1)(vi)..... 6

    3.7 Downstream Slopes Adjacent to Water Body - §257.73(d)(1)(vii)..... 6

    3.8 Structural Stability Deficiencies - §257.73(d)(2)..... 6

4.0 CONCLUSION ..... 7

5.0 CERTIFICATION..... 8

6.0 REFERENCES..... 9

## List of Figures

Figure 1      General Site Map

## List of Appendices

Appendix A      Boring Location Map & Boring Logs

Appendix B      Laboratory Test Results Summary

Appendix C      Laboratory Test Results



## 1.0 INTRODUCTION

### 1.1 Purpose

The “Disposal of Coal Combustion Residuals (CCR) from Electric Utilities rule” (40 Code of Federal Regulations (40 CFR) Part 257), effective October 19, 2015, requires that existing CCR surface impoundments meeting the requirements of §257.73(b) conduct initial and periodic structural stability assessments in accordance with §257.73(d). This letter provides the structural stability assessment for the Monticello Steam Electric Station’s (MOSES’s) CCR Impoundments, identified as the Bottom Ash Ponds (BAPs) – the Southwest Ash Settling Pond (SASP), West Ash Settling Pond (WASP), and the Northeast Ash Water Retention Pond (NAWRP).

### 1.2 Site Background

The MOSES generates bottom ash, fly ash, boiler slag, and scrubber gypsum during electricity generation. The following surface impoundments, collectively referred to as the Bottom Ash Ponds (BAPs), shown on Figure 1, are in operation at the MOSES:

- Southwest Ash Settling Pond (SASP);
- West Ash Settling Pond (WASP); and
- Northeast Ash Water Retention Pond (NAWRP).

Each of these ponds are active, clay-lined, excavated impoundments surrounded and separated by engineered earthen berms. The WASP and NAWRP receive a slurry of bottom ash/boiler slag and water from the dewatering bins through two sets of pipes entering above the crest of the northern embankment. The WASP and NAWRP are used to separate the solids from the water using gravity sedimentation. A set of pipes pass above the crest near the northwestern corner of the SASP; however, these pipes are blanked off and have reportedly never been put into service. The SASP, connected to the WASP with two weirs, is used for overflow from the other two ponds. Water decanted from the WASP and the SASP ponds is returned to the power plant via the Low Pressure Ash Water (LPAW) pump station.

Four other surface impoundments are present at MOSES: the Rubber-lined Pond, (previously referred to as the scrubber pond), the North Operating Pond, the Low Volume Waste Pond, and the Runoff Collection Pond (RCP) which is located in the southeastern quadrant of the BAP area. The RCP collects stormwater runoff from the facility and is not hydraulically connected to the BAPs. These ponds are not subject to the CCR Rule.

### 1.3 Previous Slope Stability Evaluations

Golder performed previous evaluations on the BAPs as part of the reports listed below:



- Ash and Scrubber Pond Stability Investigation Report, Luminant Monticello SES, Titus County, Texas, dated December 2012
- Addendum to Ash and Scrubber Pond Stability Investigation Report, Luminant Monticello Power Plant, Titus County, Texas, dated March 2014.

These studies found the pond slopes to be adequately stable.

LUMINANT



## 2.0 SUBSURFACE CONDITIONS

The MOSES site is located in the West Gulf Coastal Plain subprovince, in Titus County, Texas. The primary rock units in the region comprise sedimentary rocks of the Mesozoic and Cenozoic eras. The principal geologic unit in the region of the site is the Wilcox Group which is composed of interbedded sand, silt, silty shale, clay and lignite (Cook-Joyce Inc., 1985). The surficial soils of comprise of moderately well-drained to poorly drained loamy soils (USDA, 1990).

### 2.1 Site Geology

#### 2.1.1 *Subsurface Investigations and Laboratory Testing*

Information from previous subsurface investigations was used to characterize the subsurface site conditions. Golder conducted a subsurface investigation for the surface impoundments in December 2012. Golder completed eight borings within the pond footprints with boring depths of 50 feet below ground surface (bgs). The boring map and select, representative boring logs are included in Appendix A.

As part of the investigation, laboratory testing was performed on selected samples, in accordance with commonly accepted methods and practices. Undisturbed and disturbed soil samples were tested to determine water content, Atterberg limits, grain size distribution, and shear strength. Water content determination was performed in accordance with ASTM D2216; Atterberg limits were determined in accordance with ASTM D4318; and grain size distribution was performed in accordance with ASTM D422. Shear strength testing consisted of unconsolidated-undrained (UU) and consolidated-undrained (CU) triaxial compression tests in general accordance with ASTM D2850 and D4767, respectively. Laboratory test summary sheets results are presented in Appendix B. The test results can be found in Appendix C.

The findings from the above subsurface investigations were reviewed for their applicability to this study, and are summarized in the following sections.

#### 2.1.2 *Subsurface Site Conditions*

All eight borings of the subsurface investigation, were drilled along the crest of the BAPs embankments at approximate elevation 386.5 feet mean sea level (ft-msl). Hence, the borings consisted of fill and native soils. The soils encountered in the borings generally consisted of stiff to hard sandy clays and compact to dense sands. The subsurface stratigraphy generally consisted of interchanging layers of clayey sand and sandy clay. The clayey sand layers ranged in thickness from 2 to 20 feet where encountered. The sandy clay and clay layers varied in thickness from 2 to 33 feet where encountered. Four of the borings terminated in a sandy clay/clayey sand layer, while a layer of compact to dense, silty or poorly graded sand was encountered beneath the sandy clay/clayey sand layers in four borings.



Water was encountered in each of the eight borings. Water elevations encountered during drilling ranged from 352.1 to 375.05 ft-msl with an average of El. 358.5 ft-msl.

Groundwater levels measured in 2015, from wells surrounding the BAPs, indicate that the groundwater level varies from approximately EL 364 ft-msl in the southeast corner to EL 358 ft-msl in the northwest corner.

LUMINANT



### **3.0 STRUCTURAL STABILITY ASSESSMENT - §257.73(d)(1)(i)-(vii)**

The CCR rules require conducting periodic structural stability assessments by a qualified professional engineer to document whether the design, construction, operation and maintenance is consistent with recognized and generally accepted good engineering practices for the maximum volume of CCR and CCR wastewater that can be impounded therein.

#### **3.1 Foundations and Abutments - §257.73(d)(1)(i)**

As noted above, the foundation soils generally consist of stiff to hard sandy clays and compact to dense sand. As discussed below, the embankment fill appear to be well-compacted. The foundation soils and abutments are stable.

#### **3.2 Slope Protection - §257.73(d)(1)(ii)**

The downstream slopes of the BAP embankments are protected from erosion and deterioration by the establishment of a vegetative cover. The vegetative cover is inspected weekly for erosion, signs of seepage, animal burrows, sloughing, and plants that could negatively impact the embankment.

The interior slopes are protected from wave action by concrete revetment mats or riprap.

#### **3.3 Dikes (Embankment) - §257.73(d)(1)(iii)**

The BAPs at the MOSES were originally constructed in 1974 as a two-basin system. In 1990, the ponds were segregated and relined with a 3-foot thick clay liner. In addition, the interior slopes of the NAWRP, and the east side interior slopes of the WASP were lined with concrete revetment mats. Riprap was placed on all the remaining interior slopes of the ponds for erosion protection.

No construction documentation or testing details of the original embankment fill are available. Based on the borings, the embankments were likely constructed using a clayey fill from an on-site borrow source (Pastor, Behling and Wheeler, 2015). Golder's subsurface investigation of 2012, which comprised boreholes drilled into the embankment, found the embankment soils to generally consist of stiff to hard sandy clay, clayey sand, and clay, consistent with well-compacted fill.

No significant repairs have been performed to the BAP embankments since their initial construction, except the addition of an interior berms and a 3-foot thick clay liner in 1989. A shallow slope failure was observed at the northwestern corner of the WASP, on July 1, 2016. Based on our observations and previous inspections, it appears that the slope failure passes through fill placed against the original embankment slope and does not threaten the stability of the embankment.

Based on a review of past inspection reports and on recent observations, the BAP embankment is sufficient to withstand the range of loading conditions to which they are subjected.



### 3.4 Vegetated Slopes - §257.73(d)(1)(iv)

As of June 14, 2016 the US Court of Appeals for the District of Columbia Circuit issued an Order that remanded and vacated the CCR rule requirement that vegetation on the exterior portions of dikes on CCR surface impoundments be maintained not to exceed six inches in height. EPA will issue a new rulemaking in the future to address this issue.

Each of the surface impoundments at the MOSES are inspected weekly. Luminant maintains the vegetation in a manner that ensures adequate inspections can be conducted.

### 3.5 Spillways - §257.73(d)(1)(v)

There are no spillways on any of the surface impoundments.

### 3.6 Hydraulic Structures - §257.73(d)(1)(vi)

Two valve-controlled outlet structures with discharge pipes pass through the BAP embankment: a 3-foot diameter pipe through the western embankment near the southwestern corner of the WASP; and a pipe through the southern embankment of the SASP. These below-grade pipes are connected to concrete surge tanks, which are connected to a concrete chamber and pumps located west of the WASP.

Concrete weirs – two connecting the NAWRP to the WASP, and two connecting the WASP to the SASP – are present on the interior berms. Flow between the ponds is controlled with sluice gates.

All other piping to the BAPs passes above the crest of the embankments.

No significant deterioration, deformation, distortion, bedding deficiencies, sedimentation, or debris were observed that may negatively affect the operation of the surface impoundments.

### 3.7 Downstream Slopes Adjacent to Water Body - §257.73(d)(1)(vii)

The south side of the NAWRP and the east side of the SASP border the Storm Water Collection Pond. The water level in this pond is maintained below EL 365 ft-msl, and the base of the BAPs is at EL 361 ft-msl. Since the maximum water level in the Stormwater Collection Pond is only 4 feet above the base of the adjacent ponds, rapid removal of water will not significantly affect the stability of the BAP embankment.

### 3.8 Structural Stability Deficiencies - §257.73(d)(2)

No structural stability deficiencies were identified during this assessment.





#### 4.0 CONCLUSION

Based on our review of the information provided by Luminant, on information prepared by Golder Associates Inc., and on our on-site observations, no structural stability deficiencies were identified in the surface impoundments during this assessment.

Golder appreciates the opportunity to assist Luminant with this project. If you have any questions, or require further assistance from Golder, please contact the undersigned at (281) 821-6868.

#### GOLDER ASSOCIATES INC.

Varenya Kumar  
Staff Engineer

Author/Admin initials

Jeffrey B. Fassett, PE  
Associate Geotechnical Engineer

LUMINANT



## 5.0 CERTIFICATION

I hereby certify that this report has been prepared in general accordance with normally accepted civil engineering practices and in accordance with the requirements of 40 CFR §257.73(d).



Jeffrey B. Fassett, PE  
Golder Associates Inc.  
Registration Firm Number F-2578

LUMINANT



## 6.0 REFERENCES

Cook-Joyce Inc. 1985, Geologic Investigation of the Monticello Steam Electric Station “West” Bottom Ash Pond.

Golder Associates Inc. 2012, Ash and Scrubber Pond Stability Investigation Report, Luminant Monticello SES, Titus County, Texas.

Golder Associates Inc. 2014, Addendum to Ash and Scrubber Pond Stability Investigation Report, Luminant Monticello Power Plant, Titus County, Texas.


Pastor, Behling & Wheeler, LLC, 2015. Annual Surface Impoundment Inspection Report. Luminant – Monticello Steam Electric Station, Bottom Ash Ponds, Titus County, Texas.

United States Department of Agriculture, Soil Conservation Service, 1990. Soil Survey of Camp, Franklin, Morris and Titus Counties, Texas.

LUMINANT



REFERENCE(S)  
AERIAL PHOTO SOURCED FROM GOOGLE EARTH PRO DATED 2015

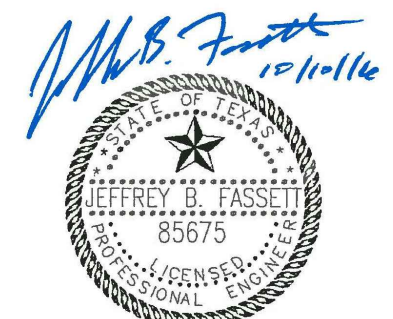

Professional Engineering Firm  
Registration Number F-2578



Path: \\bussan\cadd\drafting\_2016\164816403 - luminant monticello\PRODUCTION | File Name: 164816403A001.dwg

CLIENT  
LUMINANT POWER  
MONTICELLO

CONSULTANT



YYYY-MM-DD	2016-09-26
DESIGNED	VK
PREPARED	TNB
REVIEWED	MX
APPROVED	JBF

PROJECT  
2016 COAL COMBUSTION RESIDUALS  
ENGINEERING SERVICES

TITLE  
**GENERAL SITE MAP**

PROJECT NO.  
164816403

REV.

FIGURE  
**1**

1 in. IF THIS MEASUREMENT DOES NOT MATCH WHAT IS SHOWN, THE SHEET SIZE HAS BEEN MODIFIED FROM ANSI B

**APPENDIX A**  
**BORING LOCATION MAP & BORING LOGS**

NOTE: Figure Reference - Golder Associates Inc. 2012, Ash and Scrubber Pond Stability Investigation Report, Luminant Monticello SES, Titus County, Texas.




**LEGEND**

BH-101 BORING LOCATION

**REFERENCE**

1.) AERIAL SHOWN LICENSED FROM GOOGLE EARTH PROFESSIONAL.



REV	DATE	DES	REVISION DESCRIPTION	CADD	CHK	RWW

PROJECT LUMINANT - MONTICELLO  
 ASH SCRUBBER SLOPE STABILITY INVESTIGATION REPORT  
 TITUS COUNTY, TEXAS

**TITLE**  
**BORING LOCATIONS**

			PROJECT No. 123-94128 FILE No. 12394128A001
DESIGN	MGP	11/21/12	SCALE AS SHOWN REV. 0
CADD	RG	11/21/12	<b>FIGURE 1</b>
CHECK	MGP	11/21/12	
REVIEW	PCM	11/21/12	



Drawing file: 12394128A001.dwg Dec 04, 2012 - 1:42pm



500 Century Plaza Drive, Suite 190  
Houston, Texas 77073  
Telephone: (281) 821-6868  
Fax: (281) 821-6870

# BORING NUMBER BH-101

PAGE 1 OF 2

**CLIENT** Luminant  
**PROJECT NUMBER** 123-94128  
**DATE STARTED** 10/22/12 **COMPLETED** 10/22/12  
**DRILLING CONTRACTOR** WEST Drilling  
**DRILLING METHOD** Hollow Stem Auger  
**LOGGED BY** FW **CHECKED BY** MP  
**NOTES** \_\_\_\_\_

**PROJECT NAME** Pond Slope Stability  
**PROJECT LOCATION** Monticello  
**GROUND ELEVATION** 386.5 ft **HOLE SIZE** 8 inches  
**GROUND WATER LEVELS:**  
▽ **AT TIME OF DRILLING** 11.45 ft / Elev 375.05 ft  
**AT END OF DRILLING** ---  
**AFTER DRILLING** ---

GEOTECH BH PLOTS - GINT STD US LAB.GDT - 12/4/12 15:59 - P.1 - 2012 PROJECT FOLDERS\123-94128 LUMINANT POND SLOPE STABILITY\MONTICELLO\94128\MONTICELLO.GPJ

DEPTH (ft)	GRAPHIC LOG	MATERIAL DESCRIPTION	SAMPLE TYPE NUMBER	RECOVERY % (RQD)	BLOW COUNTS (N VALUE)	POCKET PEN. (tsf)	DRY UNIT WT. (pcf)	▲ SPT N VALUE ▲		
								20	40	60
								PL      MC      LL 20    40    60    80		
								<input type="checkbox"/> FINES CONTENT (%) <input type="checkbox"/> 20    40    60    80		
0		(CL) SANDY CLAY, low plasticity, some to little silt, tan and gray, dry, firm	SH 1	54		3.5		●		
		medium to low plasticity, dark gray sandy gravel seam at 4.0'	SH 2	54		3.25		●		
5			SH 3	56		4.0		●		
			SH 4	88		2.25		●	—	
10		(SC) CLAYEY SAND, fine, uniform graded, subrounded, some silt, red and brown, dry	SH 5	75		3.0		●		
			SH 6	54		3.5		●		
15		(CL) SANDY CLAY, some to little silt, red and gray, mottled, moist, firm								
		medium plasticity at 18.0'	SH 7	63		2.0		●		
20			SH 8	54		4.75		●		
25		dark gray clayey sand seam, stiff to hard at 23.0'								
		(CH) Fat CLAY, grading to a sandy clay, some silt, red and gray, mottled, hard to stiff, moist	SH 9	58		2.0		●		
30			SH 10	71		5.0		●	—	
35		(CL) SANDY CLAY, fine, tan and brown, moist								

(Continued Next Page)



500 Century Plaza Drive, Suite 190  
Houston, Texas 77073  
Telephone: (281) 821-6868  
Fax: (281) 821-6870

# BORING NUMBER BH-101

PAGE 2 OF 2


CLIENT Luminant PROJECT NAME Pond Slope Stability

PROJECT NUMBER 123-94128 PROJECT LOCATION Monticello

DEPTH (ft)	GRAPHIC LOG	MATERIAL DESCRIPTION	SAMPLE TYPE NUMBER	RECOVERY % (RQD)	BLOW COUNTS (N VALUE)	POCKET PEN. (tsf)	DRY UNIT WT. (pcf)	▲ SPT N VALUE ▲	
								PL	MC LL
								□ FINES CONTENT (%) □	
								20	40 60 80
35		(CL) SANDY CLAY, fine, tan and brown, moist <i>(continued)</i>							
40		(SC) CLAYEY SAND, low plasticity, some silt, brown and gray, moist	SH 11	63		2.5		●	□
45		high plasticity clay seams, wet at 43.0'	SH 12	67		4.75		●	
50		decreased clay content at 48.0'	SH 13	75		1.0		●	

Bottom of borehole at 50.0 feet.

GEOTECH BH PLOTS - GINT STD US LAB.GDT - 12/4/12 15:59 - P:\\_2012 PROJECT FOLDERS\123-94128 LUMINANT POND SLOPE STABILITY\MONTICELLO\94128\MONTICELLO.GPJ

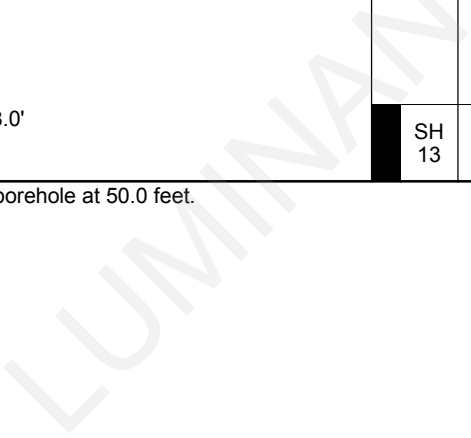





500 Century Plaza Drive, Suite 190  
Houston, Texas 77073  
Telephone: (281) 821-6868  
Fax: (281) 821-6870

# BORING NUMBER BH-102

PAGE 1 OF 2

**CLIENT** Luminant  
**PROJECT NUMBER** 123-94128  
**DATE STARTED** 10/22/12 **COMPLETED** 10/22/12  
**DRILLING CONTRACTOR** WEST Drilling  
**DRILLING METHOD** Hollow Stem Auger  
**LOGGED BY** FW **CHECKED BY** MP  
**NOTES** \_\_\_\_\_

**PROJECT NAME** Pond Slope Stability  
**PROJECT LOCATION** Monticello  
**GROUND ELEVATION** 386.5 ft **HOLE SIZE** 8 inches  
**GROUND WATER LEVELS:**  
▽ **AT TIME OF DRILLING** 31.20 ft / Elev 355.30 ft  
**AT END OF DRILLING** ---  
**AFTER DRILLING** ---

GEO TECH BH PLOTS - GINT STD US LAB.GDT - 12/4/12 15:59 - P.1 - 2012 PROJECT FOLDERS\123-94128 LUMINANT POND SLOPE STABILITY\MONTICELLO\94128\MONTICELLO.GPJ

DEPTH (ft)	GRAPHIC LOG	MATERIAL DESCRIPTION	SAMPLE TYPE NUMBER	RECOVERY % (RQD)	BLOW COUNTS (N VALUE)	POCKET PEN. (tsf)	DRY UNIT WT. (pcf)	▲ SPT N VALUE ▲			
								PL	MC	LL	
								□ FINES CONTENT (%) □			
								20	40	60	80
0		(SC) CLAYEY SAND, fine sand, low plasticity clay, little organics, dark brown, dry	SH 1	56		5.0		●			
		subangular grains, some silt, little gravel, dark brown and tan at 2.0'	SH 2	33		5.0		●			
5		low plasticity, red and brown at 4.0'	SH 3	42		5.0		●			
		high plasticity, 3" clay seam, soft at 6.0'	SH 4	50		5.0		●			
		grading to sandy clay, tan and gray, mottled, stiff to hard at 8.0'	SH 5	63		3.5		●			
15		(CL) SANDY CLAY, fine sand, low plasticity clay, tan and gray, very stiff	SH 6	50		3.5		●		□	
		(SC) CLAYEY SAND, fine sand, low plasticity clays									
		red and gray, mottled, moist at 18.0'	SH 7	58		5.0		●			
25			SH 8	58		3.25		●			
		decreased clay content, tan and brown at 28.0'	SH 9	58		3.5		●			
35		(CL) SANDY CLAY, fine, subangular, trace silt, gray and tan, moist, stiff to very stiff	SH 10	73		2.0		●		□	

(Continued Next Page)



500 Century Plaza Drive, Suite 190  
Houston, Texas 77073  
Telephone: (281) 821-6868  
Fax: (281) 821-6870

# BORING NUMBER BH-102

PAGE 2 OF 2


CLIENT Luminant PROJECT NAME Pond Slope Stability

PROJECT NUMBER 123-94128 PROJECT LOCATION Monticello

DEPTH (ft)	GRAPHIC LOG	MATERIAL DESCRIPTION	SAMPLE TYPE NUMBER	RECOVERY % (RQD)	BLOW COUNTS (N VALUE)	POCKET PEN. (tsf)	DRY UNIT WT. (pcf)	▲ SPT N VALUE ▲	
								PL	MC LL
								20 40 60 80	20 40 60 80
								□ FINES CONTENT (%) □	
								20 40 60 80	20 40 60 80
35		(CL) SANDY CLAY, fine, subangular, trace silt, gray and tan, moist, stiff to very stiff ( <i>continued</i> )							
40			SH 11	58		2.0			
45		wet at 43.0'	SH 12	75		0.5			
50		(SC) CLAYEY SAND, fine, subangular, some clay seams, dark gray, wet	SH 13	65		3.5			

Bottom of borehole at 50.0 feet.

GEOTECH BH PLOTS - GINT STD US LAB.GDT - 12/4/12 15:59 - P.1\_2012 PROJECT FOLDERS\123-94128 LUMINANT POND SLOPE STABILITY\MONTICELLO\94128\MONTICELLO.GPJ

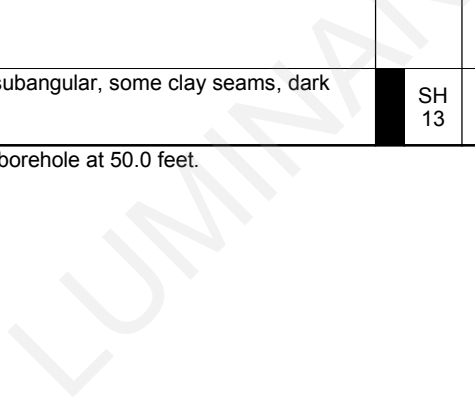



500 Century Plaza Drive, Suite 190  
Houston, Texas 77073  
Telephone: (281) 821-6868  
Fax: (281) 821-6870

# BORING NUMBER BH-103

PAGE 1 OF 2

**CLIENT** Luminant  
**PROJECT NUMBER** 123-94128  
**DATE STARTED** 10/22/12 **COMPLETED** 10/22/12  
**DRILLING CONTRACTOR** WEST Drilling  
**DRILLING METHOD** Hollow Stem Auger  
**LOGGED BY** FW **CHECKED BY** MP  
**NOTES** \_\_\_\_\_

**PROJECT NAME** Pond Slope Stability  
**PROJECT LOCATION** Monticello  
**GROUND ELEVATION** 386.5 ft **HOLE SIZE** 8 inches  
**GROUND WATER LEVELS:**  
▽ **AT TIME OF DRILLING** 26.30 ft / Elev 360.20 ft no reading, cave in at 26  
**AT END OF DRILLING** ---  
**AFTER DRILLING** ---

GEOTECH BH PLOTS - GINT STD US LAB.GDT - 12/4/12 15:59 - P.1 - 2012 PROJECT FOLDERS\123-94128 LUMINANT POND SLOPE STABILITY\MONTICELLO\094128\MONTICELLO.GPJ

DEPTH (ft)	GRAPHIC LOG	MATERIAL DESCRIPTION	SAMPLE TYPE NUMBER	RECOVERY % (RQD)	BLOW COUNTS (N VALUE)	POCKET PEN. (tsf)	DRY UNIT WT. (pcf)	▲ SPT N VALUE ▲			
								PL	MC	LL	
								□ FINES CONTENT (%) □			
								20	40	60	80
0		Roadway gravel removed									
		(CL) LEAN CLAY, low plasticity, some fine sand, tan and gray, dry, hard	SH 1	50		5.0					
			SH 2	65		5.0					
5		medium plasticity, sand and gravel seam, white at 4.0'	SH 3	65		5.0					
		(CL) SANDY CLAY, fine, subangular, low plasticity, brown and red, dry, hard	SH 4	63		4.0					
			SH 5	50		5.0					
15		(SC) CLAYEY SAND, fine, subangular, low plasticity, little silt, gray and red, moist	SH 6	71		4.0					
20		(CH) SANDY CLAY, medium to high plasticity, gray and red, moist, hard	SH 7	50		4.5					
25		(SM) SILTY SAND, fine, sub angular, some clay, orange and tan, moist	SH 8	42							
		▽	SS 9	71	6-6-7 (13)						
30		wet, compact at 30.0'	SH 10	0							
			SS 11	100	7-5-6 (11)						
35		medium to fine at 33.0'	SS 12	100	4-9-19 (28)						

(Continued Next Page)



500 Century Plaza Drive, Suite 190  
Houston, Texas 77073  
Telephone: (281) 821-6868  
Fax: (281) 821-6870


# BORING NUMBER BH-103

CLIENT Luminant PROJECT NAME Pond Slope Stability  
PROJECT NUMBER 123-94128 PROJECT LOCATION Monticello

DEPTH (ft)	GRAPHIC LOG	MATERIAL DESCRIPTION	SAMPLE TYPE NUMBER	RECOVERY % (RQD)	BLOW COUNTS (N VALUE)	POCKET PEN. (tsf)	DRY UNIT WT. (pcf)	▲ SPT N VALUE ▲	
								20 40 60 80	20 40 60 80
								PL	MC LL
								20 40 60 80	20 40 60 80
								□ FINES CONTENT (%) □	
								20 40 60 80	20 40 60 80
35		(SM) SILTY SAND, fine, sub angular, some clay, orange and tan, moist ( <i>continued</i> )							
40		(SM) SILTY SAND, fine, little clay, gray and red, wet, compact	SS 13	89	4-7-10 (17)			▲ ●	
45		some oxidation at 43.0'	SS 14	100	4-8-13 (21)			▲ ● □	
50			SS 15	94	6-9-12 (21)			▲ ●	

Bottom of borehole at 50.0 feet.

GEOTECH BH PLOTS - GINT STD US LAB.GDT - 12/4/12 15:59 - P1\_2012 PROJECT FOLDERS\123-94128 LUMINANT POND SLOPE STABILITY\MONTICELLO\094128\MONTICELLO.GPJ

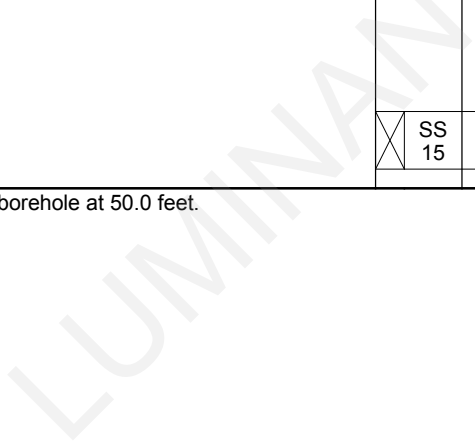



500 Century Plaza Drive, Suite 190  
Houston, Texas 77073  
Telephone: (281) 821-6868  
Fax: (281) 821-6870

# BORING NUMBER BH-104

PAGE 1 OF 2

**CLIENT** Luminant  
**PROJECT NUMBER** 123-94128  
**DATE STARTED** 10/23/12 **COMPLETED** 10/23/12  
**DRILLING CONTRACTOR** WEST Drilling  
**DRILLING METHOD** Hollow Stem Auger  
**LOGGED BY** FW **CHECKED BY** MP  
**NOTES** \_\_\_\_\_

**PROJECT NAME** Pond Slope Stability  
**PROJECT LOCATION** Monticello  
**GROUND ELEVATION** 386.5 ft **HOLE SIZE** 8 inches  
**GROUND WATER LEVELS:**  
▽ **AT TIME OF DRILLING** 25.20 ft / Elev 361.30 ft  
**AT END OF DRILLING** ---  
**AFTER DRILLING** ---

GEOTECH BH PLOTS - GINT STD US LAB.GDT - 12/4/12 15:59 - P.1 - 2012 PROJECT FOLDERS\123-94128 LUMINANT POND SLOPE STABILITY\MONTICELLO\94128\MONTICELLO.GPJ

DEPTH (ft)	GRAPHIC LOG	MATERIAL DESCRIPTION	SAMPLE TYPE NUMBER	RECOVERY % (RQD)	BLOW COUNTS (N VALUE)	POCKET PEN. (tsf)	DRY UNIT WT. (pcf)	▲ SPT N VALUE ▲			
								PL	MC	LL	
								□ FINES CONTENT (%) □			
								20	40	60	80
0		Remove gravel from road before drilling									
0 - 1.25		(CL) LEAN CLAY, low plasticity, little to trace sand, brown and gray, dry, hard	SH 1	33		5.0					
1.25 - 2.5			SH 2	40		5.0					
2.5 - 3.75		high plastic (CH), soft at 4.0'	SH 3	46		1.25					
3.75 - 5.0			SH 4			1.0					
5.0 - 6.25		(CL) SANDY CLAY, low plasticity, some to little silt, red and gray, hard, dry at 6.0'	SH 5	46		3.25					
6.25 - 7.5											
7.5 - 8.75		hard to stiff at 8.0'									
8.75 - 10.0											
10.0 - 11.25											
11.25 - 12.5											
12.5 - 13.75											
13.75 - 15.0		(SC) CLAYEY SAND, fine, subangular, brown, moist	SH 6	46							
15.0 - 16.25											
16.25 - 17.5											
17.5 - 18.75											
18.75 - 20.0		(CH) SANDY CLAY, fine, subangular, medium to high plasticity, red and gray, moist, hard	SH 7			4.5					
20.0 - 21.25											
21.25 - 22.5											
22.5 - 23.75		little silt, moist, soft at 23.0'	SH 8	67		1.5					
23.75 - 25.0											
25.0 - 26.25											
26.25 - 27.5											
27.5 - 28.75											
28.75 - 30.0		(SC) CLAYEY SAND, fine, subangular, low plasticity, red and gray, mottled, wet	SH 9	71		1.5					
30.0 - 31.25											
31.25 - 32.5											
32.5 - 33.75											
33.75 - 35.0		(SP) SAND, fine, poorly graded, trace silt and clay, gray and red, wet, compact	SS 10	94	6-8-11 (19)						

(Continued Next Page)



500 Century Plaza Drive, Suite 190  
Houston, Texas 77073  
Telephone: (281) 821-6868  
Fax: (281) 821-6870


# BORING NUMBER BH-104

CLIENT Luminant PROJECT NAME Pond Slope Stability  
PROJECT NUMBER 123-94128 PROJECT LOCATION Monticello

DEPTH (ft)	GRAPHIC LOG	MATERIAL DESCRIPTION	SAMPLE TYPE NUMBER	RECOVERY % (RQD)	BLOW COUNTS (N VALUE)	POCKET PEN. (tsf)	DRY UNIT WT. (pcf)	▲ SPT N VALUE ▲	
								PL	MC LL
								□ FINES CONTENT (%) □	
								20	40 60 80
35		(SP) SAND, fine, poorly graded, trace silt and clay, gray and red, wet, compact ( <i>continued</i> )							
40		(SP) SAND, medium to fine, subangular, poorly graded, some silt and fine gravel, red and brown, wet, compact	SS 11	100	6-12-12 (24)				▲
45		(SM) SILTY SAND, fine, subangular, some clay seams, tan and gray, wet, compact	SS 12		3-12-16 (28)				●
50		some oxidation, trace clay seams at 48.0'	SS 13	89	7-9-13 (22)				▲ ●

Bottom of borehole at 50.0 feet.

GEOTECH BH PLOTS - GINT STD US LAB.GDT - 12/4/12 15:59 - P.1\_2012 PROJECT FOLDERS\123-94128 LUMINANT POND SLOPE STABILITY\MONTICELLO\094128\MONTICELLO.GPJ

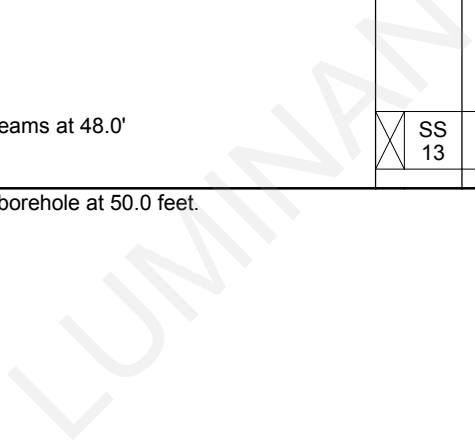



500 Century Plaza Drive, Suite 190  
Houston, Texas 77073  
Telephone: (281) 821-6868  
Fax: (281) 821-6870

# BORING NUMBER BH-105

PAGE 1 OF 2

**CLIENT** Luminant  
**PROJECT NUMBER** 123-94128  
**DATE STARTED** 10/23/12 **COMPLETED** 10/23/12  
**DRILLING CONTRACTOR** WEST Drilling  
**DRILLING METHOD** Hollow Stem Auger  
**LOGGED BY** FW **CHECKED BY** MP  
**NOTES** \_\_\_\_\_

**PROJECT NAME** Pond Slope Stability  
**PROJECT LOCATION** Monticello  
**GROUND ELEVATION** 386.5 ft **HOLE SIZE** 8 inches  
**GROUND WATER LEVELS:**  
▽ **AT TIME OF DRILLING** 34.40 ft / Elev 352.10 ft  
**AT END OF DRILLING** ---  
**AFTER DRILLING** ---

GEOTECH BH PLOTS - GINT STD US LAB.GDT - 12/4/12 15:59 - P.1 - 2012 PROJECT FOLDERS\123-94128 LUMINANT POND SLOPE STABILITY\MONTICELLO\094128\MONTICELLO.GPJ

DEPTH (ft)	GRAPHIC LOG	MATERIAL DESCRIPTION	SAMPLE TYPE NUMBER	RECOVERY % (RQD)	BLOW COUNTS (N VALUE)	POCKET PEN. (tsf)	DRY UNIT WT. (pcf)	▲ SPT N VALUE ▲		
								PL	MC	LL
								□ FINES CONTENT (%) □		
0		(CH) FAT CLAY, high plastic, tan and red, dry, soft (OH) SILT, low plastic, organic, trace roots, black (GP) SANDY GRAVEL, fine, subangular, white (CL) LEAN CLAY, low plasticity, some sand, tan and gray, dry, firm	SH 1	33		1.0		●		
		(CL) SANDY CLAY, low plasticity, red and gray, mottled, dry, hard	SH 2	50		4.5		●		
5		some sand seams at 6.0'	SH 3	67		5.0		●		
		(SC) CLAYEY SAND, fine, subangular, gray, dry	SH 4	92		3.0		●		
10		compact at 10.0'	SH 5	54		1.5		●		
		(CL) SANDY CLAY, low plasticity, some clayey sand seams, gray and red, mottled, dry, hard	SS 6	67	3-4-6 (10)			▲●		
15			SH 7	54		5.0		●	—	
20			SH 8	60		3.75		●		
25		increased sand content, moist at 23.0'	SH 8	67		5.0		●		□
30		(SC) CLAYEY SAND, fine, subangular, low plasticity, red and gray, moist, loose	SS 9	100	4-4-4 (8)			▲●		
35		some clay seams, trace fine gravel, tan and gray, wet, compact at 33.0'	SS 10	100	7-7-9 (16)			▲●		

(Continued Next Page)



500 Century Plaza Drive, Suite 190  
Houston, Texas 77073  
Telephone: (281) 821-6868  
Fax: (281) 821-6870

# BORING NUMBER BH-105


CLIENT Luminant PROJECT NAME Pond Slope Stability

PROJECT NUMBER 123-94128 PROJECT LOCATION Monticello

DEPTH (ft)	GRAPHIC LOG	MATERIAL DESCRIPTION	SAMPLE TYPE NUMBER	RECOVERY % (RQD)	BLOW COUNTS (N VALUE)	POCKET PEN. (tsf)	DRY UNIT WT. (pcf)	▲ SPT N VALUE ▲	
								PL	MC LL
								□ FINES CONTENT (%) □	
								20	40 60 80
35		(SC) CLAYEY SAND, fine, subangular, low plasticity, red and gray, moist, loose <i>(continued)</i>							
		no gravel at 38.0'	SS 11	100	5-7-10 (17)			▲ ●	
40									
			SS 12	100	5-6-9 (15)			▲ ●	
45									
			SS 14	100	5-7-9 (16)			▲ ●	
50		(SM) SILTY SAND, fine with trace medium, subangular, little clay, tan, wet, compact							

Bottom of borehole at 50.0 feet.

GEOTECH BH PLOTS - GINT STD US LAB.GDT - 12/4/12 15:59 - P.1\_2012 PROJECT FOLDERS\123-94128 LUMINANT POND SLOPE STABILITY\MONTICELLO\94128\MONTICELLO.GPJ

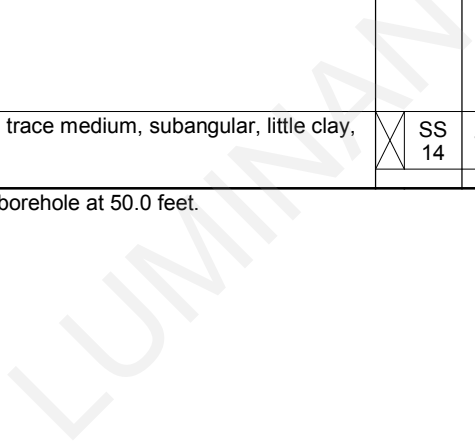





500 Century Plaza Drive, Suite 190  
Houston, Texas 77073  
Telephone: (281) 821-6868  
Fax: (281) 821-6870

# BORING NUMBER BH-106

PAGE 1 OF 2

**CLIENT** Luminant  
**PROJECT NUMBER** 123-94128  
**DATE STARTED** 10/23/12 **COMPLETED** 10/23/12  
**DRILLING CONTRACTOR** WEST Drilling  
**DRILLING METHOD** Hollow Stem Auger  
**LOGGED BY** FW **CHECKED BY** MP  
**NOTES** \_\_\_\_\_

**PROJECT NAME** Pond Slope Stability  
**PROJECT LOCATION** Monticello  
**GROUND ELEVATION** 386.5 ft **HOLE SIZE** 8 inches  
**GROUND WATER LEVELS:**  
▽ **AT TIME OF DRILLING** 31.00 ft / Elev 355.50 ft no reading, cave in at 31  
**AT END OF DRILLING** ---  
**AFTER DRILLING** ---

GEO TECH BH PLOTS - GINT STD US LAB.GDT - 12/4/12 16:00 - P.1 - 2012 PROJECT FOLDERS\123-94128 LUMINANT POND SLOPE STABILITY\MONTICELLO\94128\MONTICELLO.GPJ

DEPTH (ft)	GRAPHIC LOG	MATERIAL DESCRIPTION	SAMPLE TYPE NUMBER	RECOVERY % (RQD)	BLOW COUNTS (N VALUE)	POCKET PEN. (tsf)	DRY UNIT WT. (pcf)	▲ SPT N VALUE ▲		
								20	40	60
0		(CL) GRAVELLY CLAY, low plastic, some sand, brown, dry, hard	SH 1	33		5.0		●		
		(CH) FAT CLAY, medium to high plasticity, little silt and sand, brown, dry, hard	SH 2	46		5.0		●	—	—
5		(CL) SANDY CLAY, medium plasticity, trace silt, red and gray, dry	SS 3	33	3-4-5 (9)			▲ ●		
			SH 4	67		3.5		●		
			SH 5	67		3.0		●		
10		(SC) CLAYEY SAND, low plasticity for last 6", gray, dry								
		low to non plastic, dark gray at 13.0'	SH 6	46		5.0		●		
		fine, subangular, tan and gray at 18.0'	SH 7	50		2.0		●		
20		little silt, red, compact at 20.0'	SS 8	100	5-7-11 (18)			●		
		(CL) SANDY CLAY, low plasticity, tan and gray, moist, firm to stiff	SH 9	67		3.5		●		
25		(SM) SILTY SAND, fine, subangular, nonplastic, trace to little clay, tan, moist	SH 10	67				●		
30	▽									
		(SM) SILTY SAND, medium to fine, poorly graded, nonplastic, trace gravel, tan and red, wet, compact	SS 11	89	5-5-6 (11)			▲ ● □		
35										

(Continued Next Page)



500 Century Plaza Drive, Suite 190  
 Houston, Texas 77073  
 Telephone: (281) 821-6868  
 Fax: (281) 821-6870

# BORING NUMBER BH-106


CLIENT Luminant PROJECT NAME Pond Slope Stability

PROJECT NUMBER 123-94128 PROJECT LOCATION Monticello

DEPTH (ft)	GRAPHIC LOG	MATERIAL DESCRIPTION	SAMPLE TYPE NUMBER	RECOVERY % (RQD)	BLOW COUNTS (N VALUE)	POCKET PEN. (tsf)	DRY UNIT WT. (pcf)	▲ SPT N VALUE ▲	
								PL	MC LL
								□ FINES CONTENT (%) □	
								20 40 60 80	20 40 60 80
35		(SM) SILTY SAND, medium to fine, poorly graded, nonplastic, trace gravel, tan and red, wet, compact ( <i>continued</i> )							
40		(SC) CLAYEY SAND, fine, subangular, some clay seams, oxidation, tan and gray, mottled, wet, compact	SS 12	72	4-8-11 (19)			▲ ●	
45		no visible oxidation at 43.0'	SS 13	44	5-7-10 (17)			▲ ●	
50			SS 14	100	7-8-13 (21)			▲ ●	

Bottom of borehole at 50.0 feet.

GEOTECH BH PLOTS - GINT STD US LAB.GDT - 12/4/12 16:00 - P.1\_2012 PROJECT FOLDERS\123-94128 LUMINANT POND SLOPE STABILITY\MONTICELLO\94128\MONTICELLO.GPJ

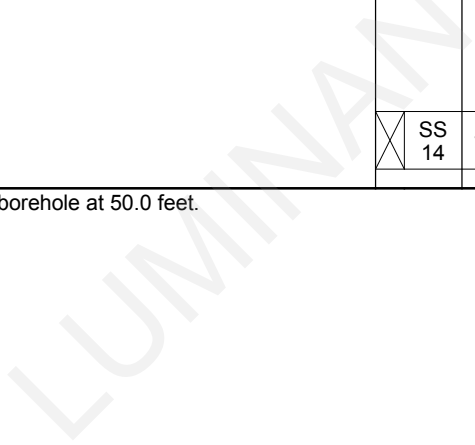



500 Century Plaza Drive, Suite 190  
Houston, Texas 77073  
Telephone: (281) 821-6868  
Fax: (281) 821-6870

# BORING NUMBER BH-107

**CLIENT** Luminant  
**PROJECT NUMBER** 123-94128  
**DATE STARTED** 10/23/12 **COMPLETED** 10/23/12  
**DRILLING CONTRACTOR** WEST Drilling  
**DRILLING METHOD** Hollow Stem Auger  
**LOGGED BY** FW **CHECKED BY** MP  
**NOTES** \_\_\_\_\_

**PROJECT NAME** Pond Slope Stability  
**PROJECT LOCATION** Monticello  
**GROUND ELEVATION** 386.5 ft **HOLE SIZE** 8 inches  
**GROUND WATER LEVELS:**  
 ▽ **AT TIME OF DRILLING** 31.75 ft / Elev 354.75 ft  
**AT END OF DRILLING** ---  
**AFTER DRILLING** ---

GEOTECH BH PLOTS - GINT STD US LAB.GDT - 12/4/12 16:00 - P.1 - 2012 PROJECT FOLDERS\123-94128 LUMINANT POND SLOPE STABILITY\MONTICELLO\94128\MONTICELLO.GPJ

DEPTH (ft)	GRAPHIC LOG	MATERIAL DESCRIPTION	SAMPLE TYPE NUMBER	RECOVERY % (RQD)	BLOW COUNTS (N VALUE)	POCKET PEN. (tsf)	DRY UNIT WT. (pcf)	▲ SPT N VALUE ▲			
								PL	MC	LL	
								□ FINES CONTENT (%) □			
								20	40	60	80
0		remove 1' of sandy gravel from roadway									
1		(CL) LEAN CLAY, low plasticity, some sand, gray, dry, hard	SH 1	42		5.0		●			
2			SH 2	56		5.0		●			
3		some sand seams at 4.0'	SH 3	46		5.0		●			
4			SH 4	71		4.25		●			
5		(SC) CLAYEY SAND, fine, subangular, low plasticity, gray, dry	SH 5	54		1.75					
6											
7			SH 6	67		3.5		●	—		
8											
9		(CL) SANDY CLAY, low plasticity, little silt, red and gray, dry, firm to stiff	SH 7	54		2.75		●	—		
10											
11		increased sand content, moist at 23.0'	SH 8	58		4.0		●			
12											
13		(SP) SAND, nonplastic, poorly graded, some silt, little clay, tan, moist	SH 9	58				●	□		
14											
15											
16											
17											
18											
19											
20											
21											
22											
23											
24											
25											
26											
27											
28											
29											
30											
31											
32											
33											
34											
35		(SM) SILTY SAND, fine with little medium, little clay, tan and gray, wet, compact	SS 10	89	5-5-6 (11)			▲ ●			

(Continued Next Page)



500 Century Plaza Drive, Suite 190  
 Houston, Texas 77073  
 Telephone: (281) 821-6868  
 Fax: (281) 821-6870

# BORING NUMBER BH-107


CLIENT Luminant PROJECT NAME Pond Slope Stability

PROJECT NUMBER 123-94128 PROJECT LOCATION Monticello

DEPTH (ft)	GRAPHIC LOG	MATERIAL DESCRIPTION	SAMPLE TYPE NUMBER	RECOVERY % (RQD)	BLOW COUNTS (N VALUE)	POCKET PEN. (tsf)	DRY UNIT WT. (pcf)	▲ SPT N VALUE ▲		
								20	40	60
								PL      MC      LL  ----- ----- -----  20    40    60    80		
								<input type="checkbox"/> FINES CONTENT (%) <input type="checkbox"/> 20    40    60    80		
35		(SM) SILTY SAND, fine with little medium, little clay, tan and gray, wet, compact ( <i>continued</i> )								
40		3" dark gray clay seam (CL), little gravel at 38.0'	SS 11	89	5-5-9 (14)					
45		subangular, trace clay, oxidation, tan at 43.0'	SS 12		5-9-11 (20)					
50		some clay seams, tan and gray at 48.0'	SS 13	89	4-8-9 (17)					

Bottom of borehole at 50.0 feet.

GEOTECH BH PLOTS - GINT STD US LAB.GDT - 12/4/12 16:00 - P.1\_2012 PROJECT FOLDERS\123-94128 LUMINANT POND SLOPE STABILITY\MONTICELLO\094128\MONTICELLO.GPJ

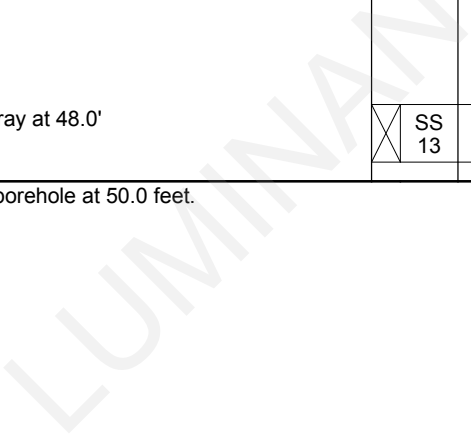



500 Century Plaza Drive, Suite 190  
Houston, Texas 77073  
Telephone: (281) 821-6868  
Fax: (281) 821-6870

# BORING NUMBER BH-108

**CLIENT** Luminant  
**PROJECT NUMBER** 123-94128  
**DATE STARTED** 10/24/12 **COMPLETED** 10/24/12  
**DRILLING CONTRACTOR** WEST Drilling  
**DRILLING METHOD** Hollow Stem Auger  
**LOGGED BY** FW **CHECKED BY** MP  
**NOTES** \_\_\_\_\_

**PROJECT NAME** Pond Slope Stability  
**PROJECT LOCATION** Monticello  
**GROUND ELEVATION** 386.5 ft **HOLE SIZE** 8 inches  
**GROUND WATER LEVELS:**  
▽ **AT TIME OF DRILLING** 32.65 ft / Elev 353.85 ft  
**AT END OF DRILLING** ---  
**AFTER DRILLING** ---

GEOTECH BH PLOTS - GINT STD US LAB.GDT - 12/4/12 16:00 - P.1 - 2012 PROJECT FOLDERS\123-94128 LUMINANT POND SLOPE STABILITY\MONTICELLO\094128\MONTICELLO.GPJ

DEPTH (ft)	GRAPHIC LOG	MATERIAL DESCRIPTION	SAMPLE TYPE NUMBER	RECOVERY % (RQD)	BLOW COUNTS (N VALUE)	POCKET PEN. (tsf)	DRY UNIT WT. (pcf)	▲ SPT N VALUE ▲			
								PL	MC	LL	
								□ FINES CONTENT (%) □			
								20	40	60	80
0		remove 4" of gravel from roadway									
		(CL) LEAN CLAY, low plasticity, some to little sand, trace silt, brown, dry, firm some sand, tan and gray, firm to stiff at 2.0'	SH 1	38		2.5					
			SH 2	75		2.75					
5		trace gravel, tan, red, and gray, stiff at 4.0'	SH 3	54		3.0					
		increased sand content, little silt, hard at 6.0'	SH 4	83		5.0					
10		(CL) SANDY CLAY, low plasticity, some silt, gray and red, dry, stiff	SH 5	44		3.75					
15		(CL) SANDY CLAY, low plasticity, fine, subangular, dark gray, dry	SH 6	75							□
20		some silt, tan and gray at 18.0'	SH 7	50							
25		(CL) SANDY CLAY, low plasticity, little silt, tan and gray, dry, hard	SH 8	83							
30		low plasticity, some silt, moist, firm at 28.0'	SS 9	89	6-3-4 (7)						
35		(SC) CLAYEY SAND, fine, subangular, low plasticity, little silt, some clay seams, tan and gray, moist	SH 10	46							

(Continued Next Page)



500 Century Plaza Drive, Suite 190  
Houston, Texas 77073  
Telephone: (281) 821-6868  
Fax: (281) 821-6870


# BORING NUMBER BH-108

CLIENT Luminant PROJECT NAME Pond Slope Stability  
PROJECT NUMBER 123-94128 PROJECT LOCATION Monticello

DEPTH (ft)	GRAPHIC LOG	MATERIAL DESCRIPTION	SAMPLE TYPE NUMBER	RECOVERY % (RQD)	BLOW COUNTS (N VALUE)	POCKET PEN. (tsf)	DRY UNIT WT. (pcf)	▲ SPT N VALUE ▲			
								20	40	60	80
								PL	MC	LL	
								20	40	60	80
								□ FINES CONTENT (%) □			
								20	40	60	80
35		(SC) CLAYEY SAND, fine, subangular, low plasticity, little silt, some clay seams, tan and gray, moist ( <i>continued</i> ) little medium at 35.0'	SS 11	100	4-6-9 (15)						
40		some silt, little oxidation, wet, compact at 43.0'	SS 12	100	3-7-9 (16)						
45			SS 13	100	4-8-11 (19)						
50			SS 14			6-9-15 (24)					

Bottom of borehole at 50.0 feet.

GEOTECH BH PLOTS - GINT STD US LAB.GDT - 12/4/12 16:00 - P1\_2012 PROJECT FOLDERS\123-94128 LUMINANT POND SLOPE STABILITY\MONTICELLO\94128\MONTICELLO.GPJ

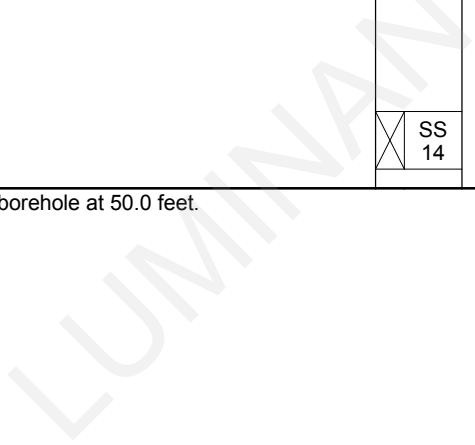

**APPENDIX B**  
**LABORATORY TEST RESULTS SUMMARY**

LUMINANT









**APPENDIX C**  
**LABORATORY TEST RESULTS**

LUMINANT

**ATTERBERG LIMIT RESULTS**

LUMINANT



## GRAIN SIZE ANALYSIS

LUMINANT



500 Century Plaza Drive, Suite 190  
Houston, Texas 77073  
Telephone: (281) 821-6868  
Fax: (281) 821-6870


# GRAIN SIZE DISTRIBUTION

CLIENT Luminant

PROJECT NAME Pond Slope Stability

PROJECT NUMBER 123-94128

PROJECT LOCATION Monticello

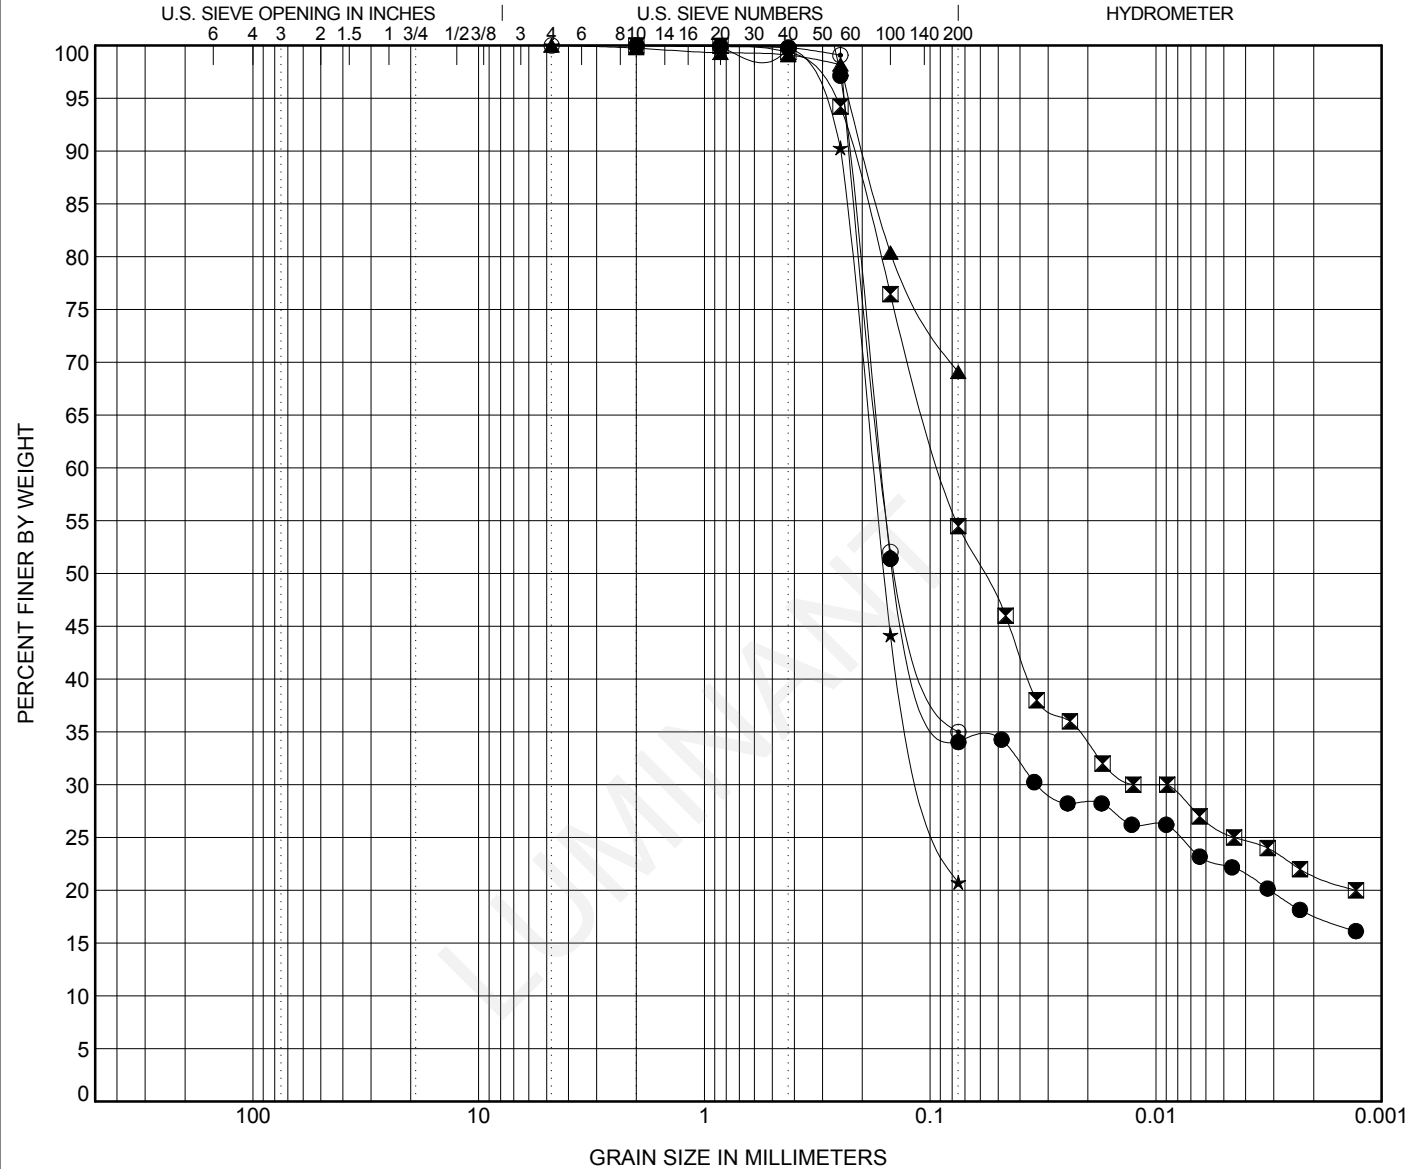

COBBLES	GRAVEL		SAND			SILT OR CLAY
	coarse	fine	coarse	medium	fine	

BOREHOLE	DEPTH	Classification					LL	PL	PI	Cc	Cu
● BH-101	38										
⊠ BH-102	13										
▲ BH-102	33										
★ BH-103	25										
○ BH-103	43										
BOREHOLE	DEPTH	D100	D60	D30	D10	%Gravel	%Sand	%Silt	%Clay		
● BH-101	38	2	0.165	0.033		0.0	66.0	11.6	22.4		
⊠ BH-102	13	2	0.089	0.009		0.0	45.5	28.9	25.6		
▲ BH-102	33	4.75				0.0	30.9	69.1			
★ BH-103	25	4.75	0.179	0.099		0.0	79.2	20.8			
○ BH-103	43	4.75	0.164			0.0	65.0	35.0			

GRAIN SIZE - COA - GINT STD US LAB.GDT - 11/20/12 14:49 - P:\\_2012 PROJECT FOLDERS\MONTICELLO FIELD INVESTIGATION\94128\MONTICELLO.GPJ



500 Century Plaza Drive, Suite 190  
Houston, Texas 77073  
Telephone: (281) 821-6868  
Fax: (281) 821-6870


# GRAIN SIZE DISTRIBUTION

CLIENT Luminant

PROJECT NAME Pond Slope Stability

PROJECT NUMBER 123-94128

PROJECT LOCATION Monticello

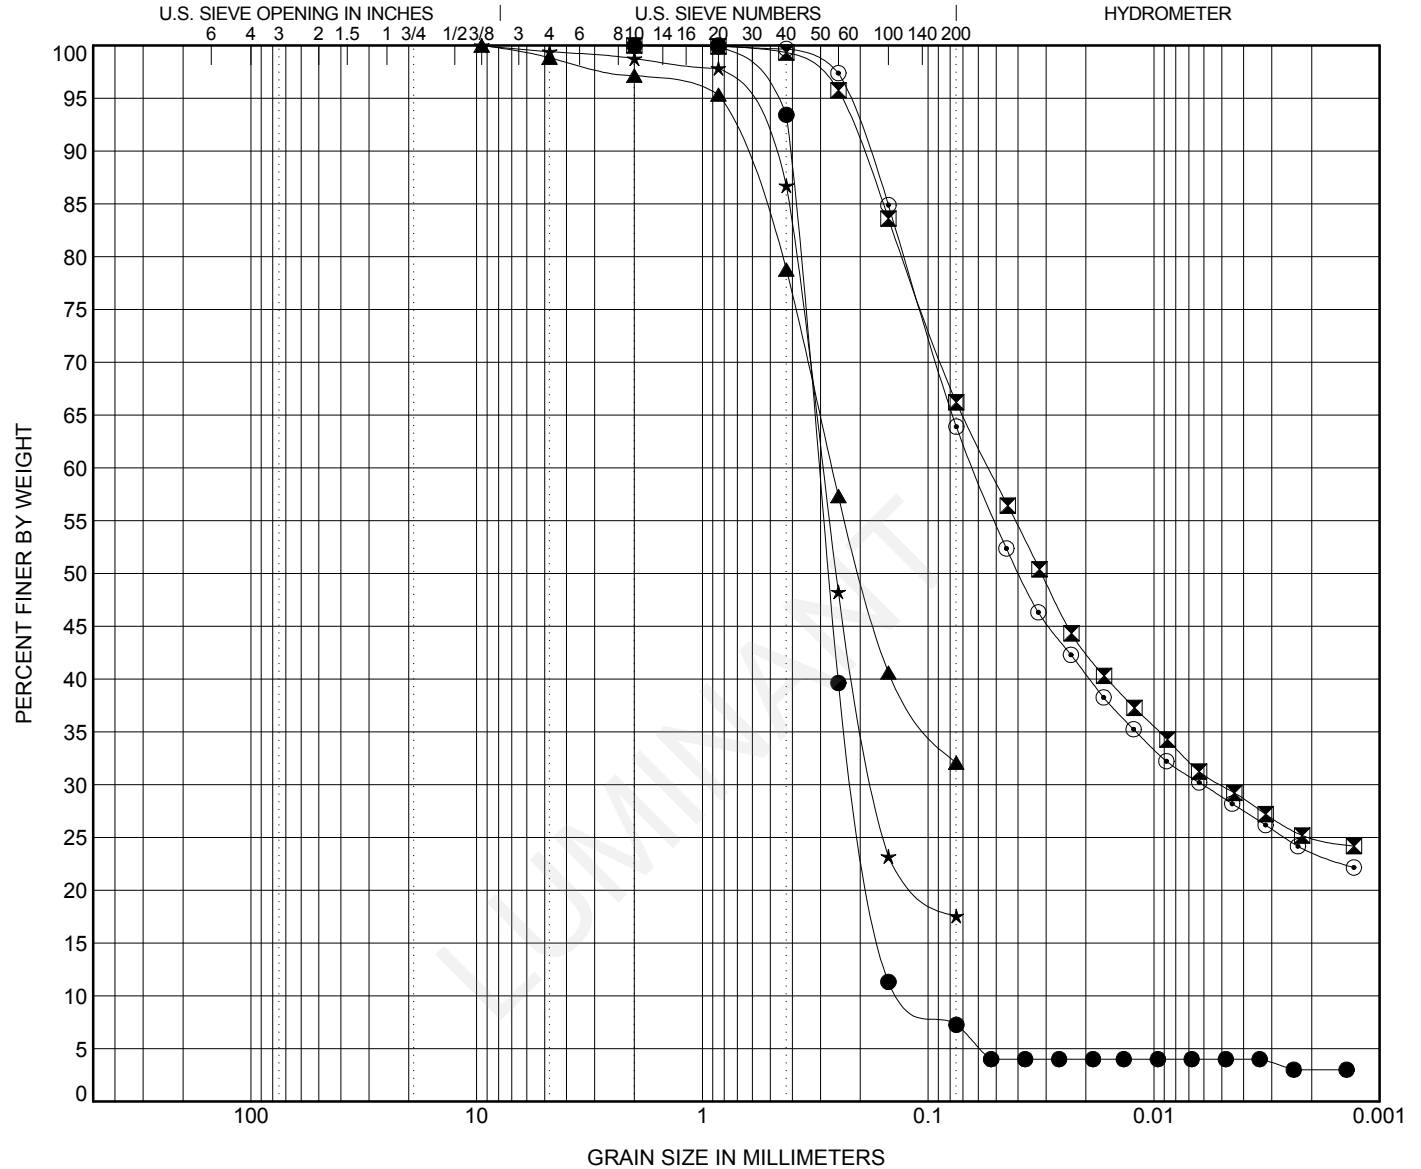

COBBLES	GRAVEL		SAND			SILT OR CLAY
	coarse	fine	coarse	medium	fine	

BOREHOLE	DEPTH	Classification					LL	PL	PI	Cc	Cu
● BH-104	33									1.21	2.55
☒ BH-105	23										
▲ BH-106	33										
★ BH-107	28										
○ BH-108	13										
BOREHOLE	DEPTH	D100	D60	D30	D10	%Gravel	%Sand	%Silt	%Clay		
● BH-104	33	2	0.306	0.21	0.12	0.0	92.7	3.3	4.0		
☒ BH-105	23	2	0.054	0.005		0.0	33.8	36.3	29.9		
▲ BH-106	33	9.5	0.267			1.2	66.7	32.1			
★ BH-107	28	9.5	0.294	0.172		0.6	81.9	17.6			
○ BH-108	13	0.85	0.063	0.006		0.0	36.1	35.1	28.8		

GRAIN SIZE - COA - GINT STD US LAB.GDT - 11/20/12 14:49 - P:\\_2012 PROJECT FOLDERS\123-94128 LUMINANT POND SLOPE STABILITY\MONTICELLO FIELD INVESTIGATION\94128\MONTICELLO.GPJ





500 Century Plaza Drive, Suite 190  
Houston, Texas 77073  
Telephone: (281) 821-6868  
Fax: (281) 821-6870


# GRAIN SIZE DISTRIBUTION

CLIENT Luminant

PROJECT NAME Pond Slope Stability

PROJECT NUMBER 123-94128

PROJECT LOCATION Monticello

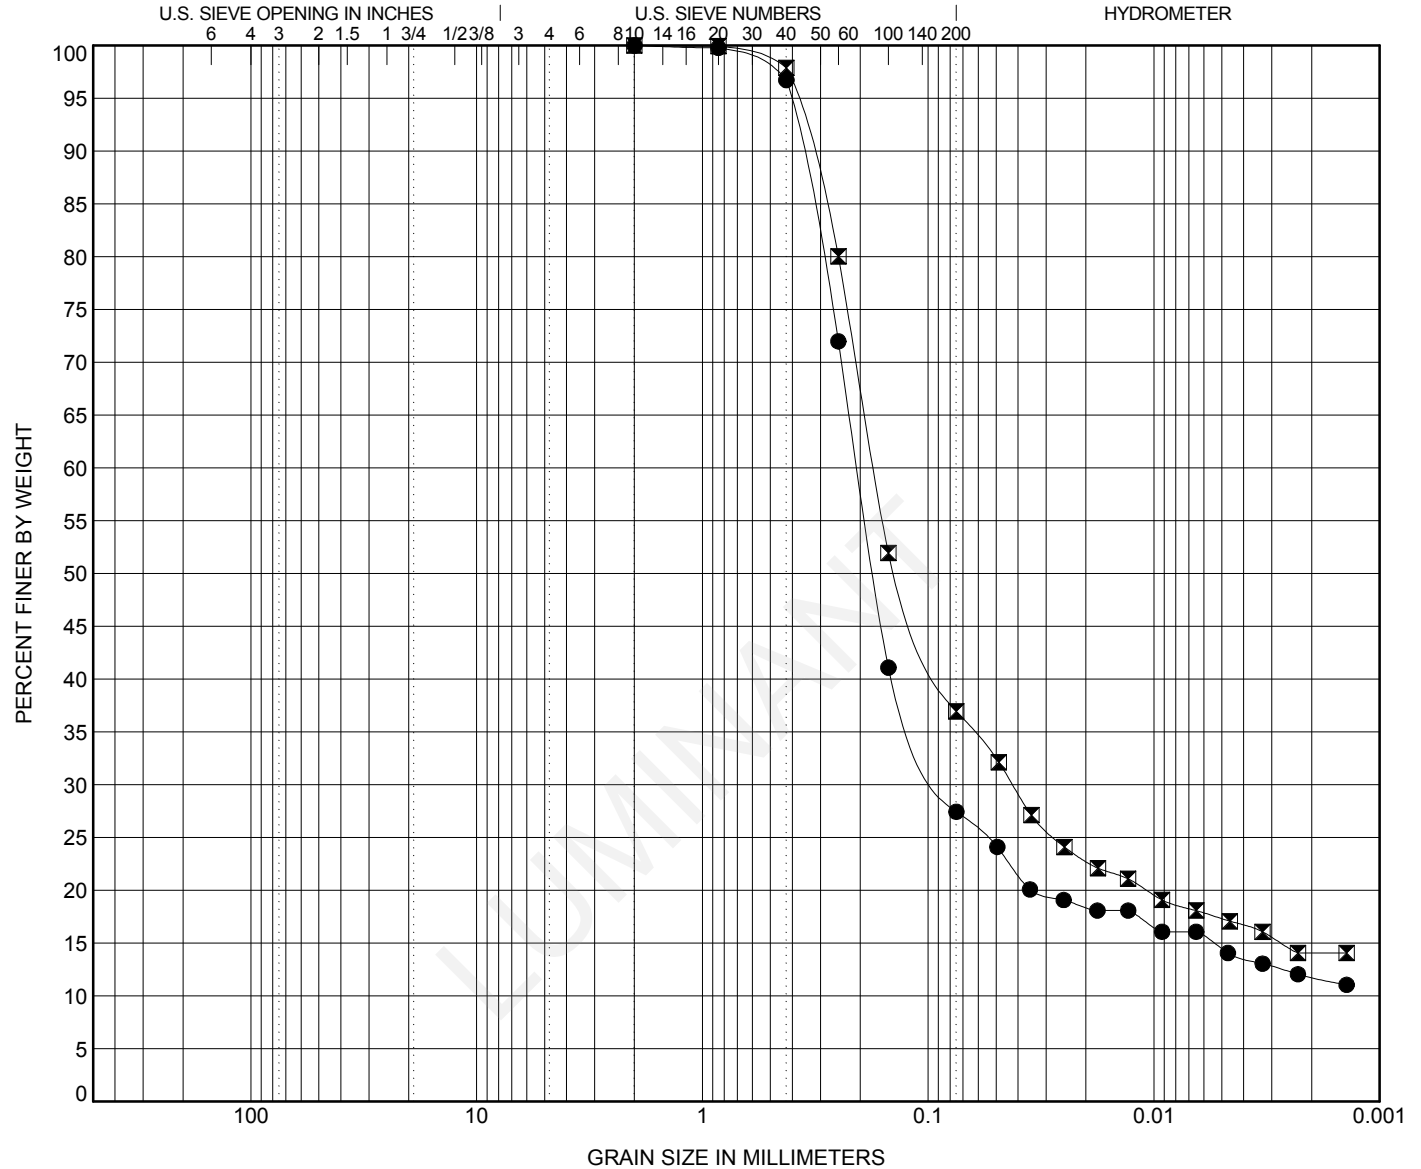

COBBLES	GRAVEL		SAND			SILT OR CLAY
	coarse	fine	coarse	medium	fine	


BOREHOLE	DEPTH	Classification								LL	PL	PI	Cc	Cu
● BH-109	6													
☒ BH-110	6													
BOREHOLE	DEPTH	D100	D60	D30	D10	%Gravel	%Sand	%Silt	%Clay					
● BH-109	6	2	0.205	0.085		0.0	72.6	13.0	14.4					
☒ BH-110	6	2	0.174	0.042		0.0	63.0	19.6	17.3					

GRAIN SIZE - COA - GINT STD US LAB.GDT - 11/20/12 14:50 - P:\2012 PROJECT FOLDERS\123-94128 LUMINANT POND SLOPE STABILITY\MONTICELLO FIELD INVESTIGATION\94128\MONTICELLO.GPJ

**UNCONSOLIDATED / UNDRAINED COMPRESSIVE STRENGTH (UU)**

LUMINANT


**UNCONSOLIDATED / UNDRAINED COMPRESSIVE STRENGTH  
ASTM D 2850**

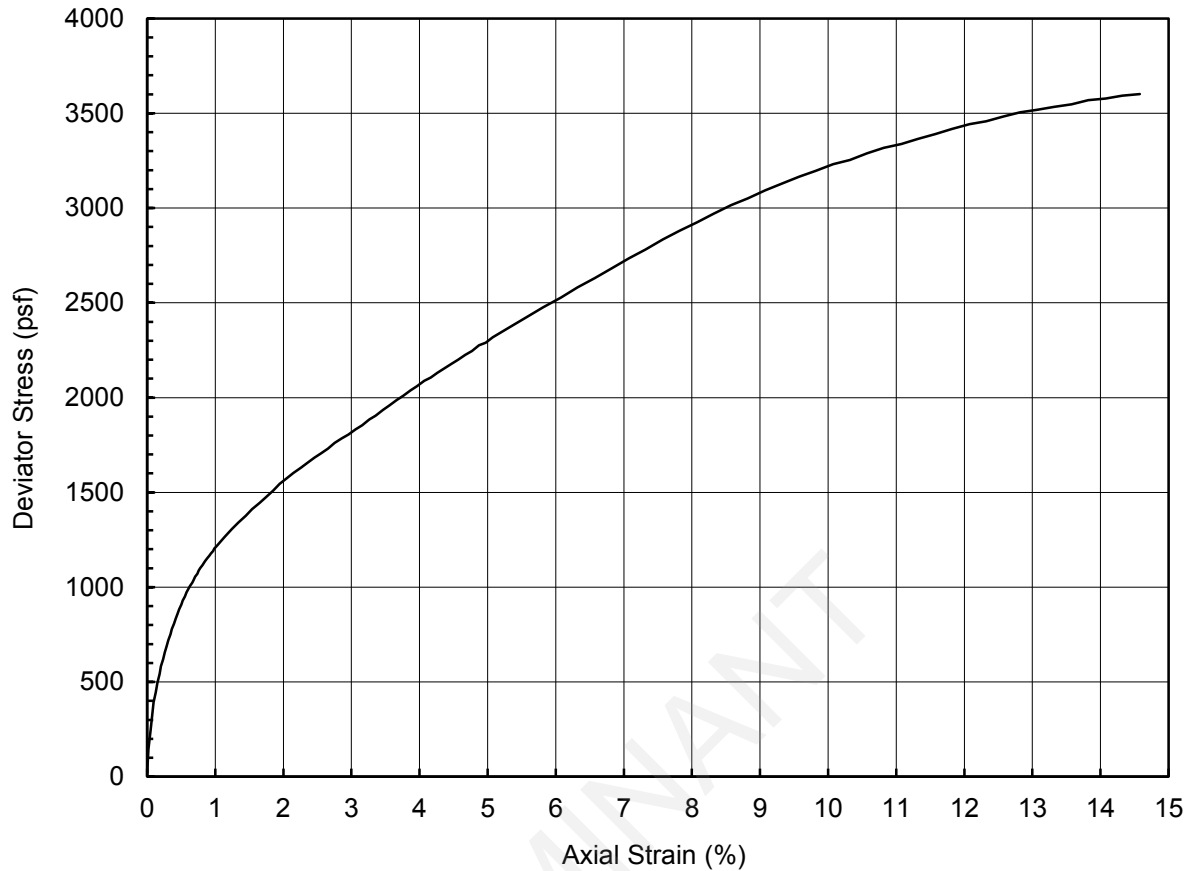

Specimen Description	Reddish Gray Sandy Clay			
LL		PI		USCS


Depth (ft)	6.0	Confining Pressure (psf)	878
Specimen Height (inch)	4.9	Strain Rate (%/min)	1.0
Specimen Diameter (inch)	2.8	Peak Deviator Stress (psf)	3620
Initial Specimen Weight (g)	1018.2	Axial Strain at Peak Stress (%)	14.8
Moist Unit Weight (pcf)	128.3		
Initial Water Content (%)	17		
Initial Dry Unit Weight (pcf)	109.6		

Project Title	Luminant - Monticello Slope Stability
Project Number	123-94128
Sample Type	Shelby Tube
Sample ID	BH-101 TO-4
Comments	Sample L/D ratio < 2

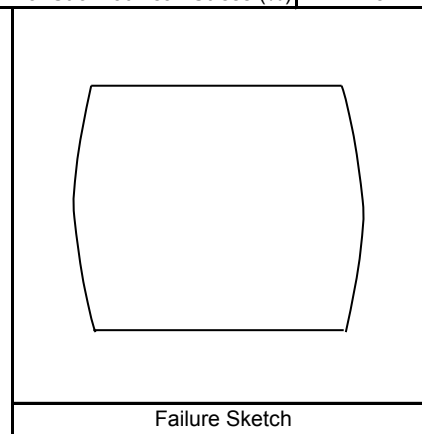

Performed by	PN
Date	9-Nov-12
Check	HR
Review	PCM


**UNCONSOLIDATED / UNDRAINED COMPRESSIVE STRENGTH  
ASTM D 2850**

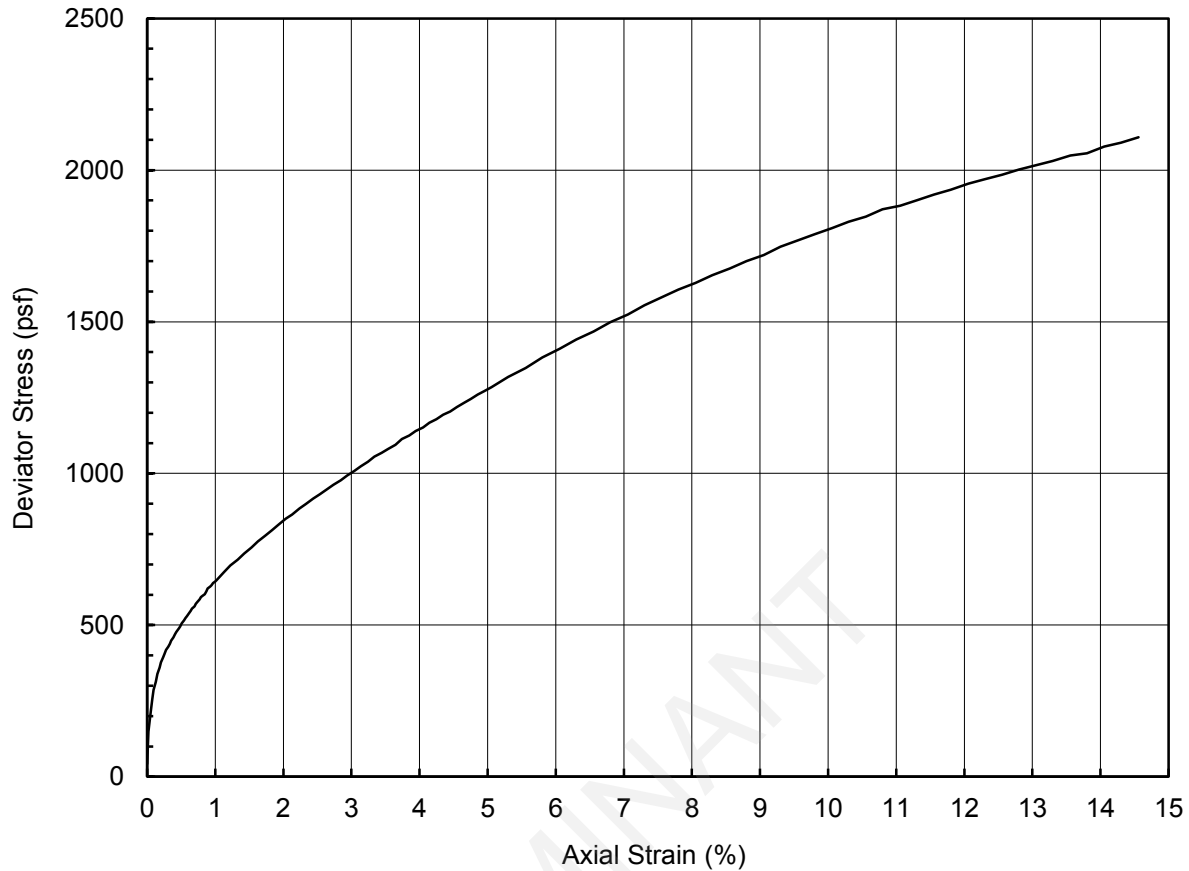

Specimen Description	Reddish Gray Sandy Clay			
LL		PI		USCS


Depth (ft)	33.0	Confining Pressure (psf)	4026
Specimen Height (inch)	5.9	Strain Rate (%/min)	1.0
Specimen Diameter (inch)	2.8	Peak Deviator Stress (psf)	2122
Initial Specimen Weight (g)	1252.9	Axial Strain at Peak Stress (%)	15.0
Moist Unit Weight (pcf)	129.3		
Initial Water Content (%)	23		
Initial Dry Unit Weight (pcf)	104.9		

Project Title	Luminant - Monticello Slope Stability	
Project Number	123-94128	
Sample Type	Shelby Tube	
Sample ID	BH-101	TO-10
Comments		

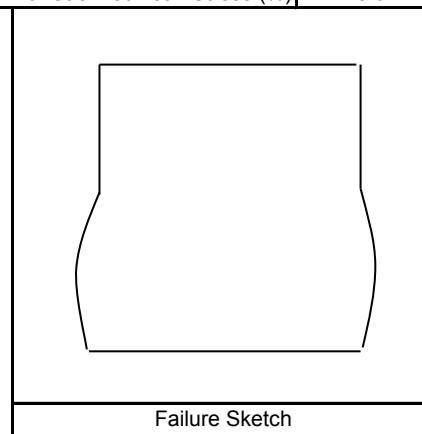

Performed by	PN
Date	10-Nov-12
Check	HR
Review	PCM


**UNCONSOLIDATED / UNDRAINED COMPRESSIVE STRENGTH  
ASTM D 2850**

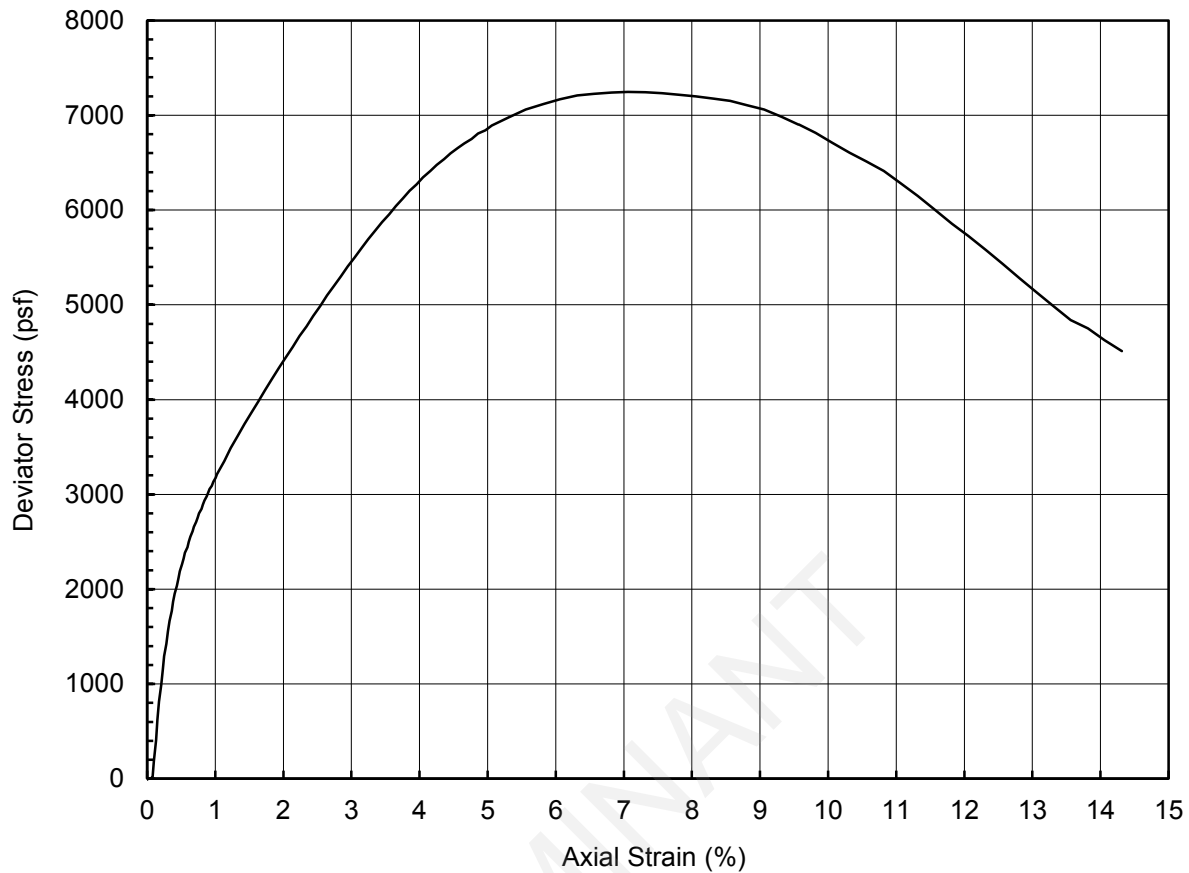

Specimen Description		Reddish Gray Clay		
LL		PI	LI	USCS

Depth (ft)	18.0	Confining Pressure (psf)	2251
Specimen Height (inch)	5.7	Strain Rate (%/min)	1.0
Specimen Diameter (inch)	2.8	Peak Deviator Stress (psf)	7245
Initial Specimen Weight (g)	1166.5	Axial Strain at Peak Stress (%)	7.1
Moist Unit Weight (pcf)	126.9		
Initial Water Content (%)	21		
Initial Dry Unit Weight (pcf)	104.5		

Project Title	Luminant - Monticello Slope Stability
Project Number	123-94128
Sample Type	Shelby Tube
Sample ID	BH-103 TO-7
Comments	

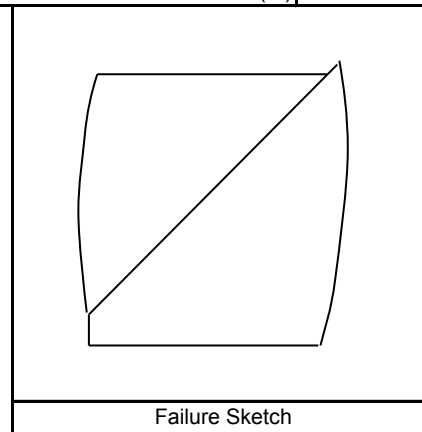

Performed by	PN
Date	10-Nov-12
Check	HR
Review	PCM


**UNCONSOLIDATED / UNDRAINED COMPRESSIVE STRENGTH  
ASTM D 2850**



Specimen Description	Reddish Gray Clay			
LL		PI		USCS


Depth (ft)	18.0	Confining Pressure (psf)	2873
Specimen Height (inch)	6.0	Strain Rate (%/min)	1.0
Specimen Diameter (inch)	2.8	Peak Deviator Stress (psf)	10292
Initial Specimen Weight (g)	1257.9	Axial Strain at Peak Stress (%)	11.1
Moist Unit Weight (pcf)	131.0		
Initial Water Content (%)	17		
Initial Dry Unit Weight (pcf)	112.3		

Project Title	Luminant - Monticello Slope Stability
Project Number	123-94128
Sample Type	Shelby Tube
Sample ID	BH-104 TO-7
Comments	Load cell reached maximum capacity

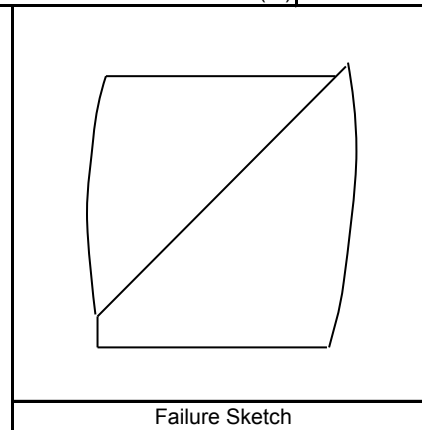

Performed by	PN
Date	10-Nov-12
Check	HR
Review	PCM


**UNCONSOLIDATED / UNDRAINED COMPRESSIVE STRENGTH  
ASTM D 2850**

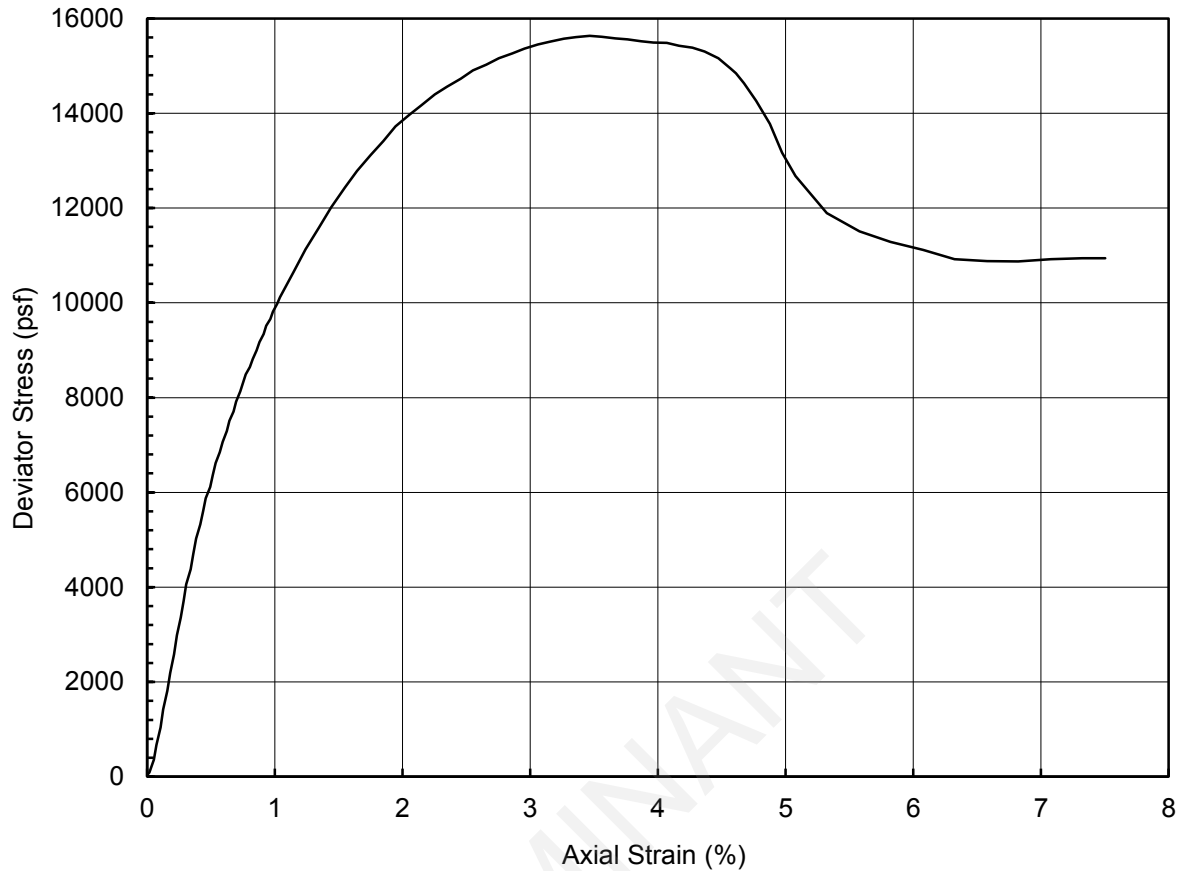

Specimen Description		Reddish Gray Clay			
LL		PI		LI	
				USCS	


Depth (ft)	2.0	Confining Pressure (psf)	364
Specimen Height (inch)	6.0	Strain Rate (%/min)	1.0
Specimen Diameter (inch)	2.8	Peak Deviator Stress (psf)	15637
Initial Specimen Weight (g)	1242.3	Axial Strain at Peak Stress (%)	3.5
Moist Unit Weight (pcf)	129.1		
Initial Water Content (%)	17		
Initial Dry Unit Weight (pcf)	110.8		

Project Title	Luminant - Monticello Slope Stability
Project Number	123-94128
Sample Type	Shelby Tube
Sample ID	BH-106 TO-2
Comments	

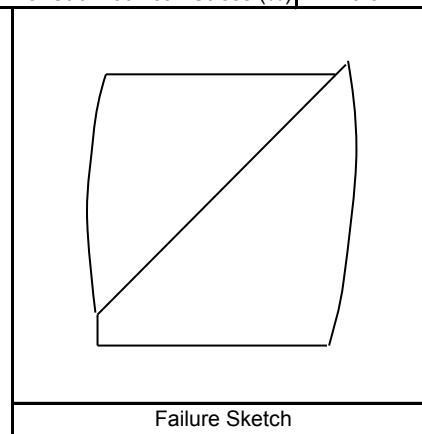

Performed by	PN
Date	10-Nov-12
Check	HR
Review	PCM


**UNCONSOLIDATED / UNDRAINED COMPRESSIVE STRENGTH  
ASTM D 2850**

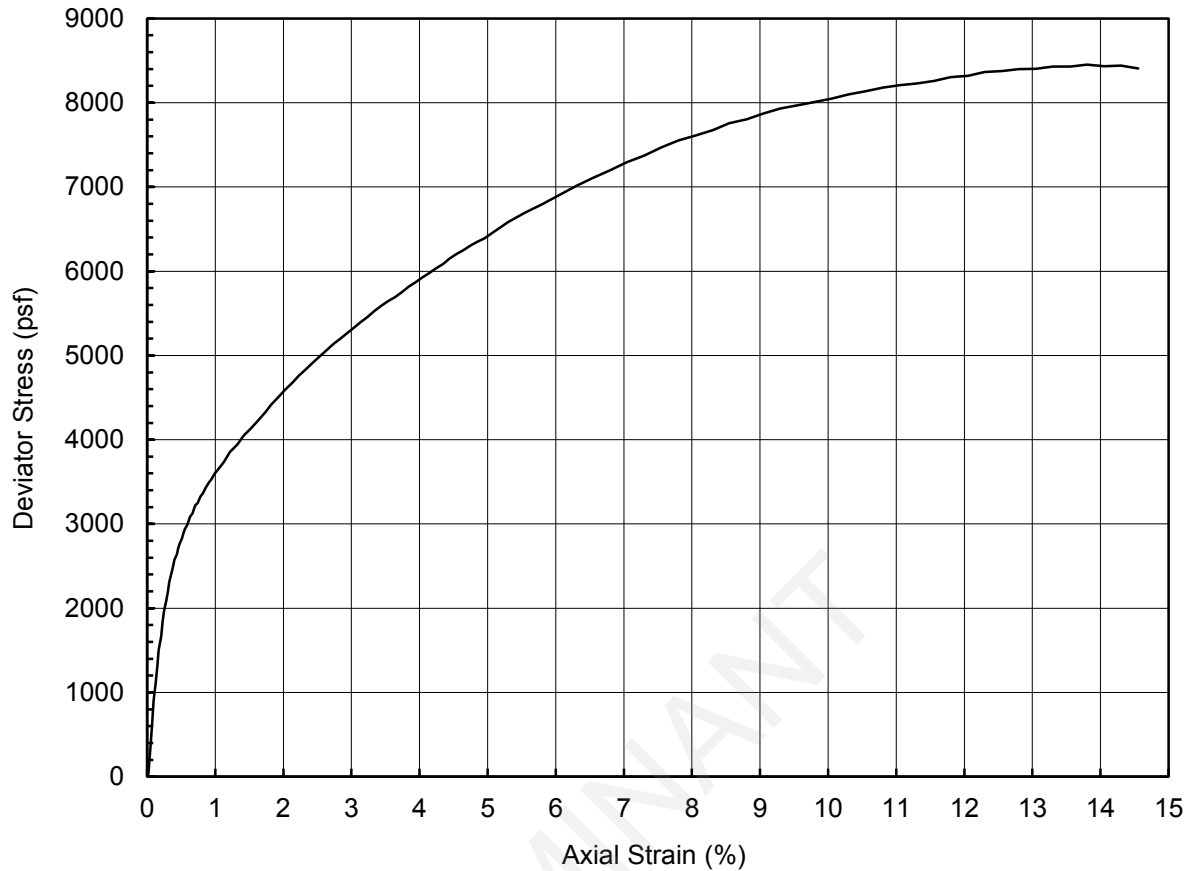

Specimen Description	Reddish Yellow Sandy Clay			
LL		PI		USCS

Depth (ft)	18.0	Confining Pressure (psf)	2376
Specimen Height (inch)	5.9	Strain Rate (%/min)	1.0
Specimen Diameter (inch)	2.8	Peak Deviator Stress (psf)	8451
Initial Specimen Weight (g)	1281.6	Axial Strain at Peak Stress (%)	13.8
Moist Unit Weight (pcf)	136.8		
Initial Water Content (%)	15		
Initial Dry Unit Weight (pcf)	119.3		

Project Title	Luminant - Monticello Slope Stability	
Project Number	123-94128	
Sample Type	Shelby Tube	
Sample ID	BH-107	TO-7
Comments		

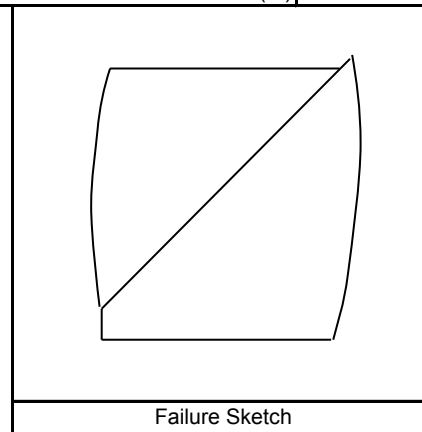

Performed by	PN
Date	10-Nov-12
Check	HR
Review	PCM




**UNCONSOLIDATED / UNDRAINED COMPRESSIVE STRENGTH  
ASTM D 2850**



Specimen Description	Light Grayish Brown Clay			
LL		PI		USCS


Depth (ft)	23.0	Confining Pressure (psf)	2876
Specimen Height (inch)	6.0	Strain Rate (%/min)	1.0
Specimen Diameter (inch)	2.8	Peak Deviator Stress (psf)	12167
Initial Specimen Weight (g)	1292.1	Axial Strain at Peak Stress (%)	14.3
Moist Unit Weight (pcf)	133.6		
Initial Water Content (%)	14		
Initial Dry Unit Weight (pcf)	116.9		

Project Title	Luminant - Monticello Slope Stability	
Project Number	123-94128	
Sample Type	Shelby Tube	
Sample ID	BH-108	TO-8
Comments		

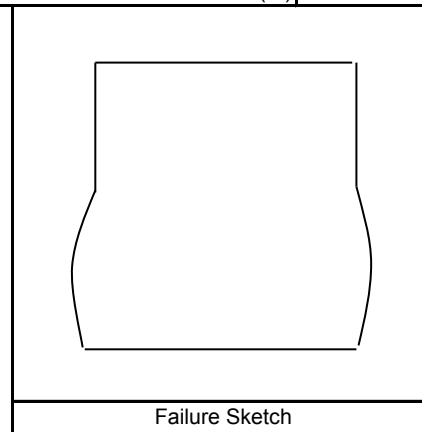

Performed by	PN
Date	10-Nov-12
Check	HR
Review	PCM


**UNCONSOLIDATED / UNDRAINED COMPRESSIVE STRENGTH  
ASTM D 2850**

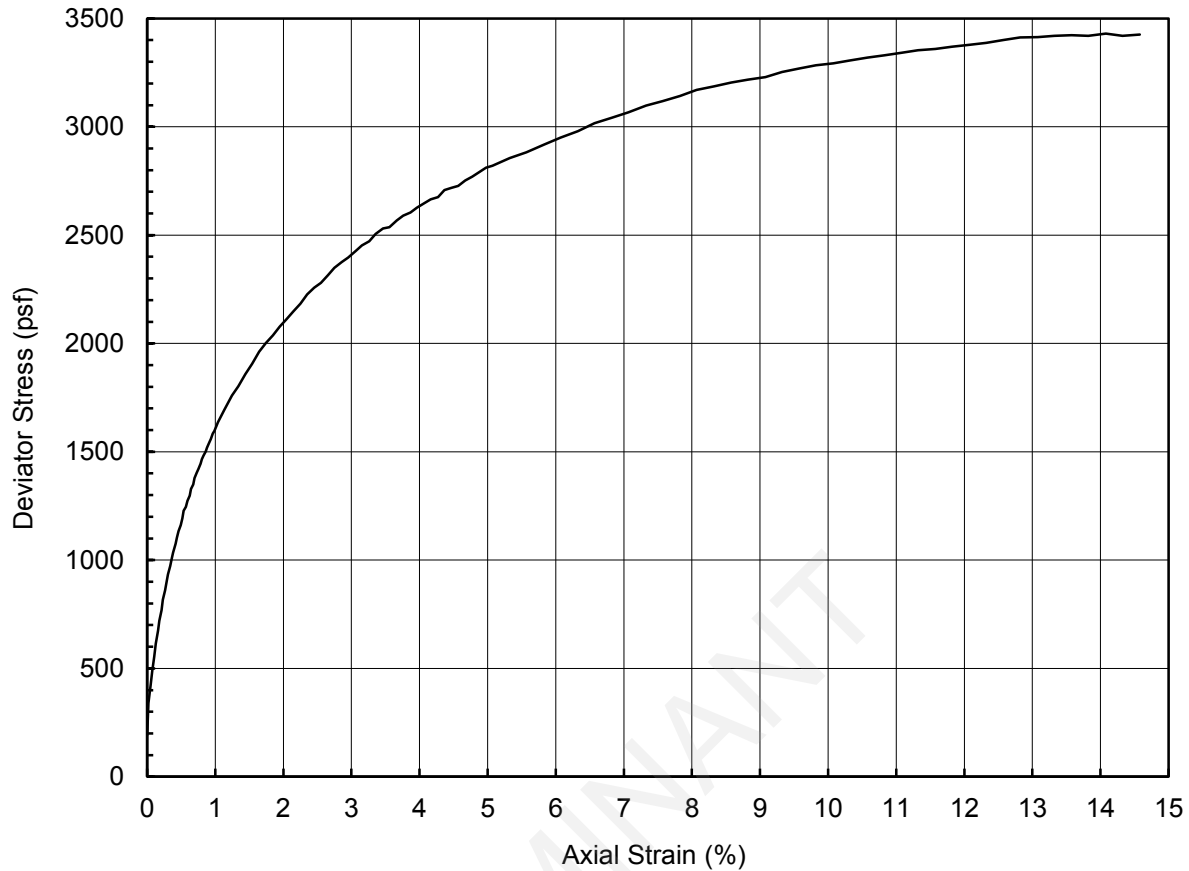

Specimen Description	Reddish Gray Clay			
LL		PI		USCS

Depth (ft)	10.0	Confining Pressure (psf)	1357
Specimen Height (inch)	5.9	Strain Rate (%/min)	1.0
Specimen Diameter (inch)	2.8	Peak Deviator Stress (psf)	3430
Initial Specimen Weight (g)	1191.6	Axial Strain at Peak Stress (%)	14.1
Moist Unit Weight (pcf)	124.9		
Initial Water Content (%)	19		
Initial Dry Unit Weight (pcf)	105.3		

Project Title	Luminant - Monticello Slope Stability	
Project Number	123-94128	
Sample Type	Shelby Tube	
Sample ID	BH-110	TO-6
Comments		

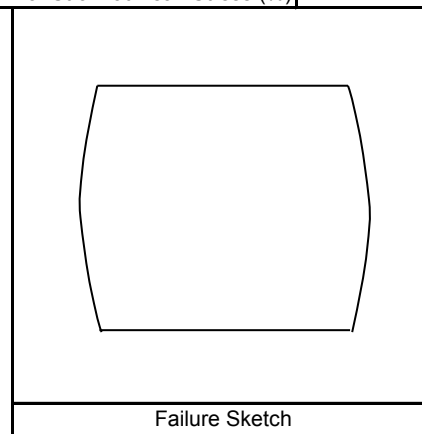

Performed by	PN
Date	10-Nov-12
Check	HR
Review	PCM

**ISOTROPICALLY CONSOLIDATED UNDRAINED TRIAXIAL TEST (ICU)**


LUMINANT

## Isotropically Consolidated Undrained Triaxial Test (ICU)

**Project Title:** Luminant  
**Boring Number:** BH-107

**Project Number:** 123-94128  
**Specimen Name:** TO-6

**Date:** 16-Nov-12  
**Depth (ft):** 13.0

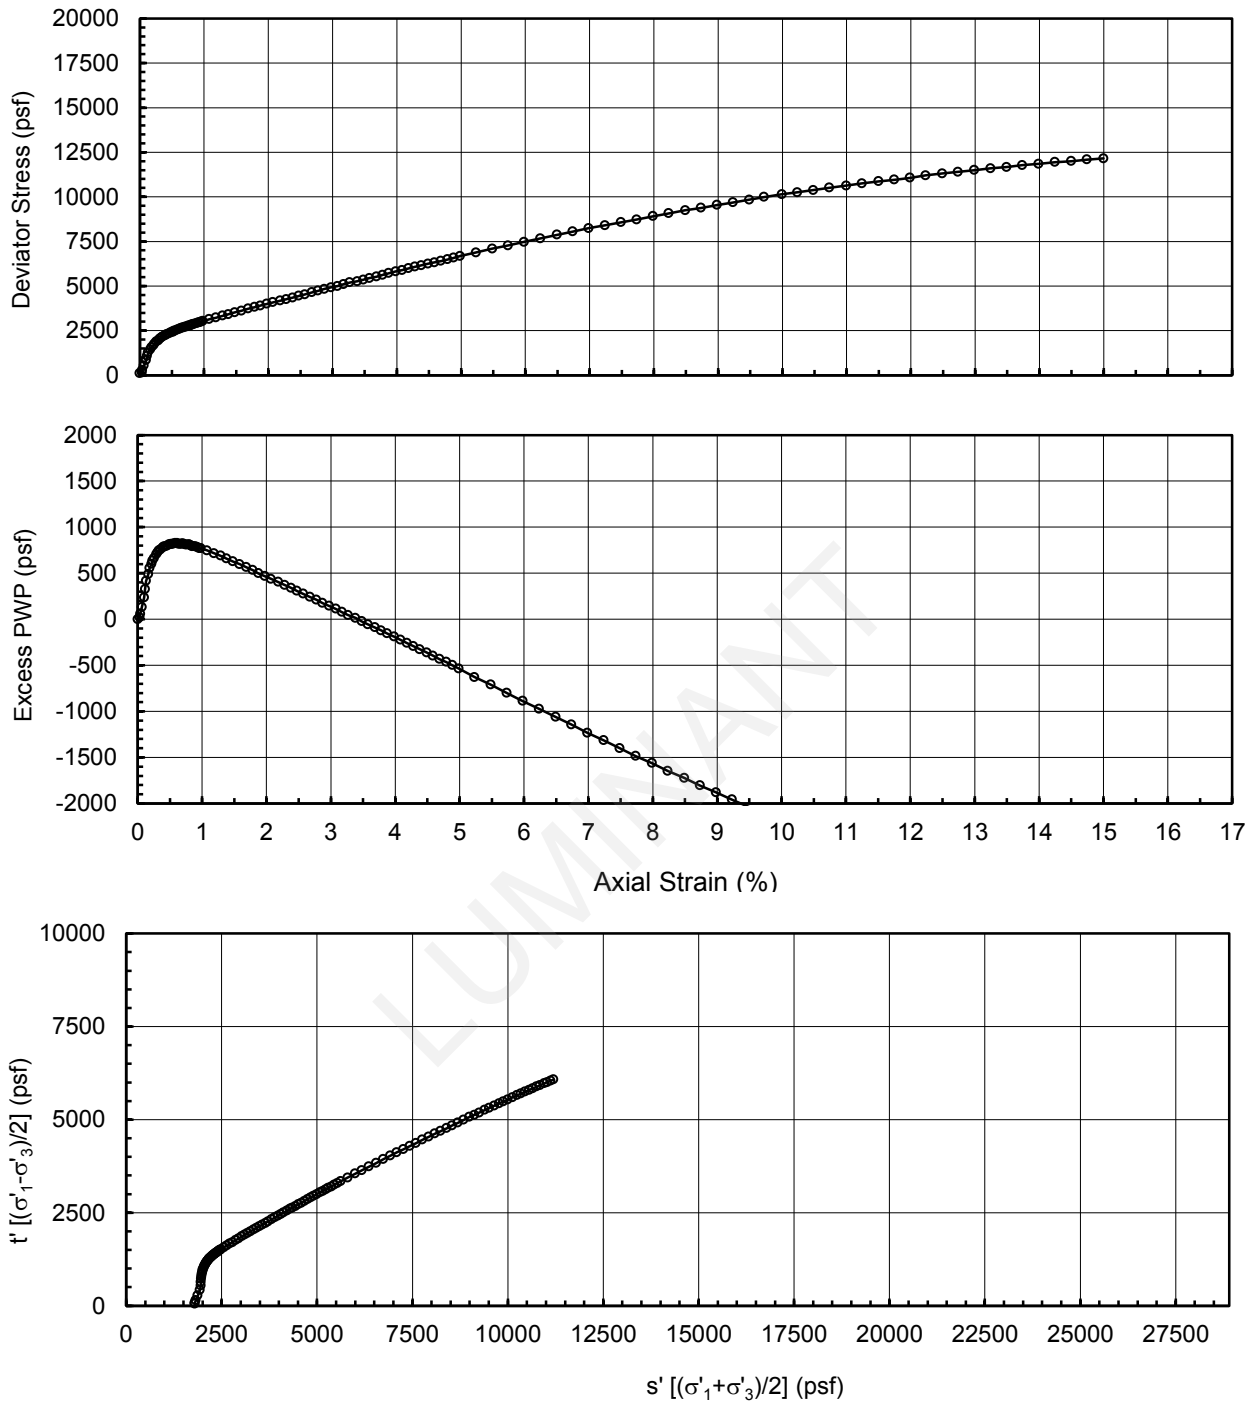

Specimen Description: Reddish Gray Sandy Clay (visual classification)



Initial Specimen Diameter (inch) =	2.81	Initial Specimen Height (inch) =	5.95
Initial Water Content (%) =	14.9	Water Content at End of Test (%) =	14.2
Initial Moist Unit Weight (pcf) =	134.9	B-value =	0.95
Back Pressure (BP, psf) =	5040.0	Consolidation Stress ( $\sigma'_3$ , psf) =	1743.9
Initial Lateral Stress ( $\sigma'_3$ , psf) =	1743.9	Consolidation $t_{50}$ (min) =	9
Initial Deviator Stress ( $\sigma_1 - \sigma_3$ , psf) =	102.3	Rebound Stress ( $\sigma'_3$ , psf) =	NA
Test Strain Rate (%/hour) =	1.0	Rebound $t_{50}$ (min) =	NA
LL =	36	PI =	20
USCS	CL	Performed by	PN
Comments:		Reviewed by	HR

# Isotropically Consolidated Undrained Triaxial Test (ICU)

**Project Title:** Luminant  
**Boring Number:** BH-107

**Project Number:** 123-94128  
**Specimen Name:** TO-6

**Date:** 16-Nov-12  
**Depth (ft):** 13.0

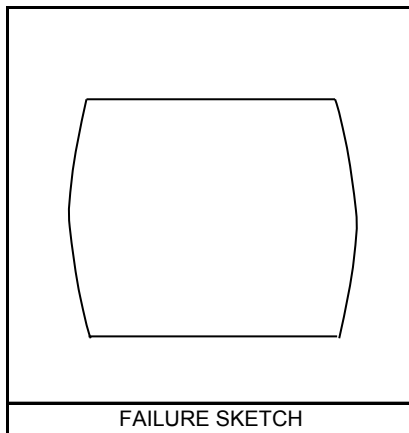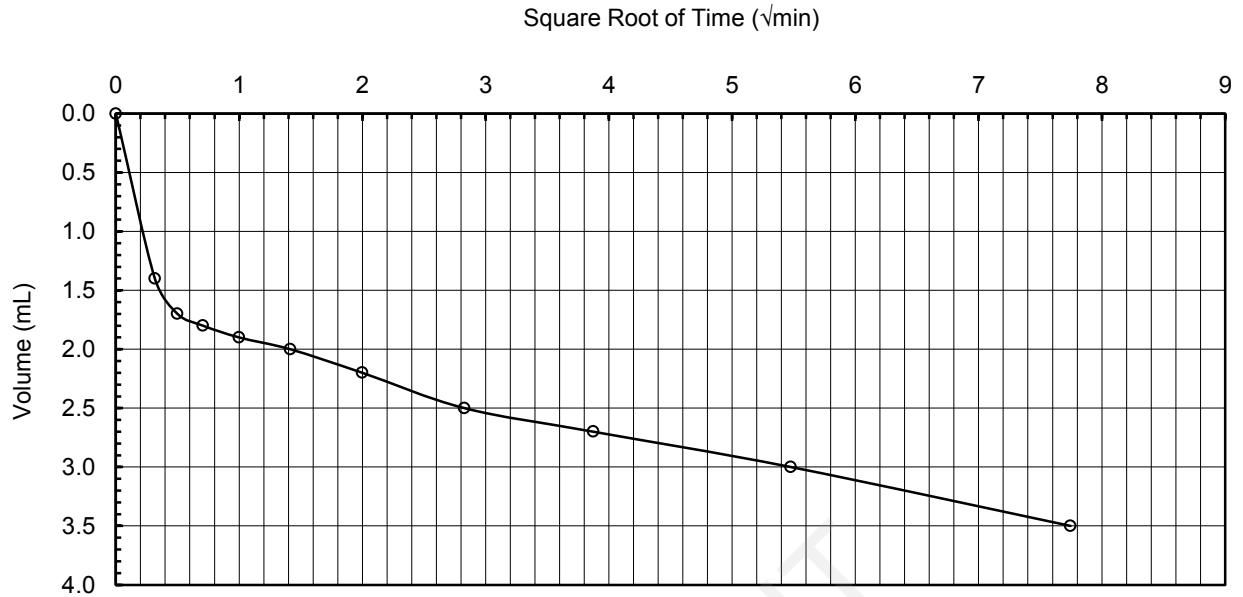

Consolidation Stress ( $\sigma'_3$ , psf) =		1743.9	
Consolidation $t_{50}$ (min) =		9	
Consolidation Volume Change (mL) =		3.5	
Unloading Stress (psf) =		NA	
Unloading $t_{50}$ (min) =		NA	
Unloading Volume Change (mL) =		NA	
LL =	36	PI =	20
USCS	CL		
Gs =	2.65	assumed	




**Performed by** PN  
**Reviewed by** HR

## Isotropically Consolidated Undrained Triaxial Test (ICU)

**Project Title:** Luminant  
**Boring Number:** BH-107

**Project Number:** 123-94128  
**Specimen Name:** TO-8

**Date:** 17-Nov-12  
**Depth (ft):** 23.0

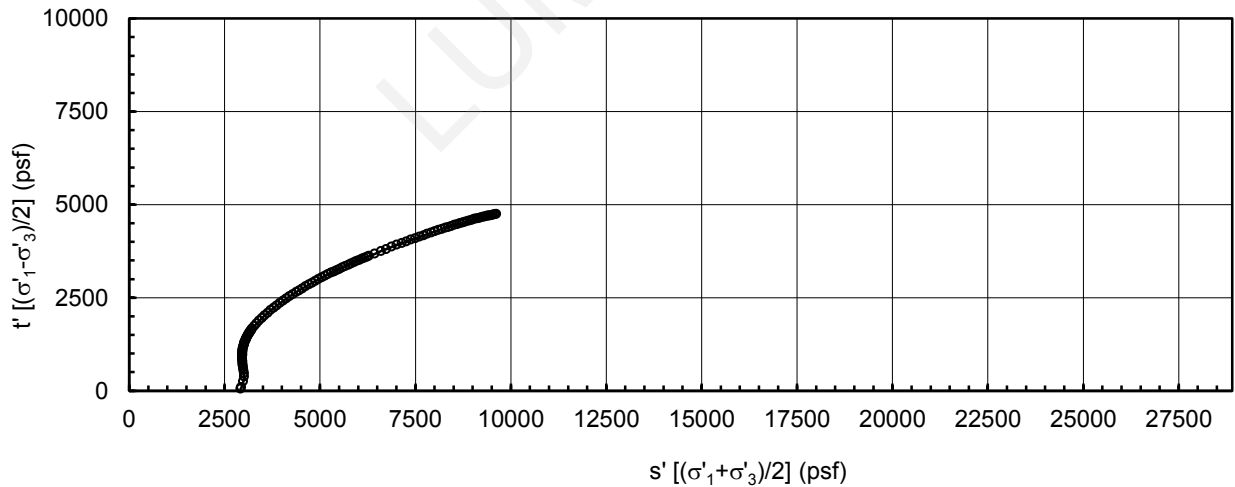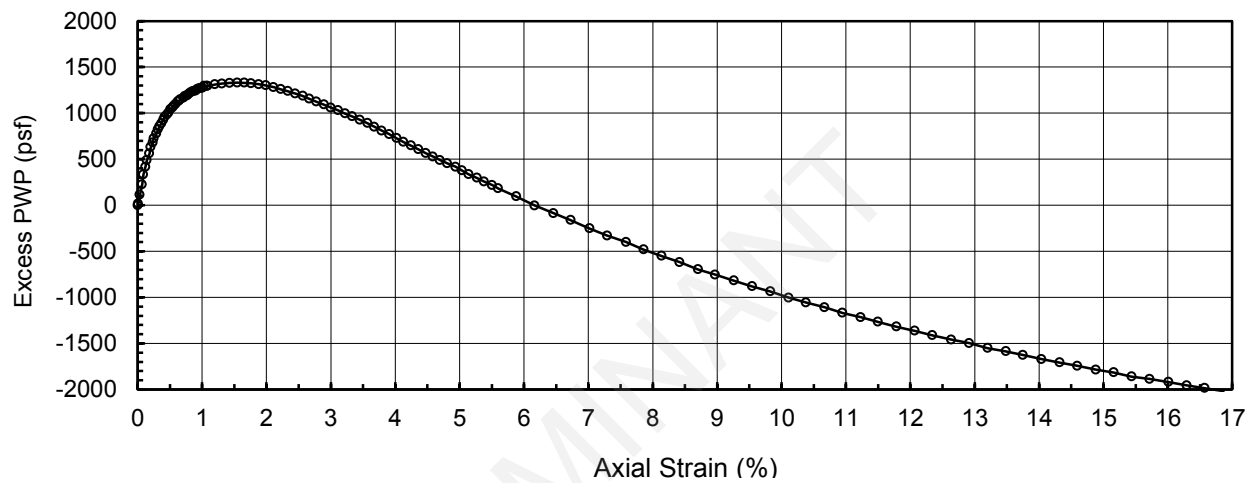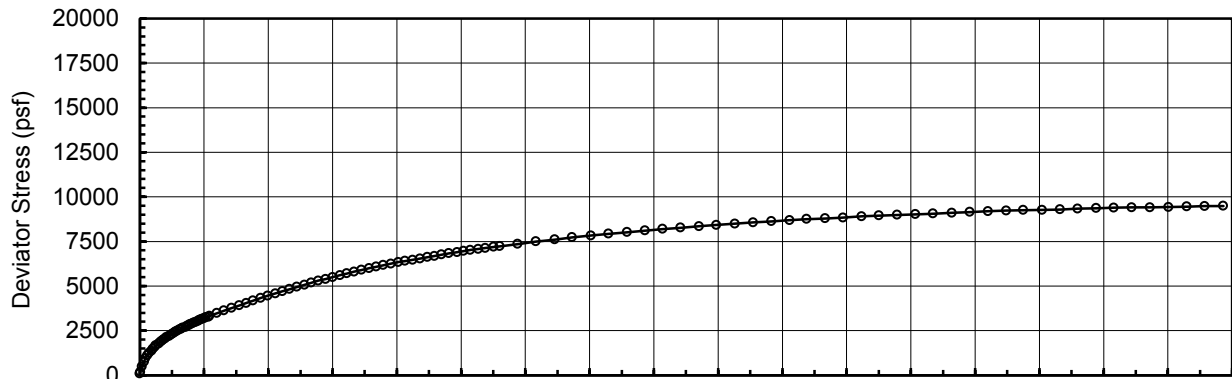

Specimen Description: Light Gray Clay



Initial Specimen Diameter (inch) =		2.84		Initial Specimen Height (inch) =		5.30	
Initial Water Content (%) =		16.8		Water Content at End of Test (%) =		19.5	
Initial Moist Unit Weight (pcf) =		141.6		B-value =		0.98	
Back Pressure (BP, psf) =		5760.0		Consolidation Stress ( $\sigma'_3$ , psf) =		2867.8	
Initial Lateral Stress ( $\sigma'_3$ , psf) =		2867.8		Consolidation $t_{50}$ (min) =		9	
Initial Deviator Stress ( $\sigma_1 - \sigma_3$ , psf) =		98.6		Rebound Stress ( $\sigma'_3$ , psf) =		NA	
Test Strain Rate (%/hour) =		1.0		Rebound $t_{50}$ (min) =		NA	
LL =	42	PI =	25	USCS	CL	Performed by	PN
Comments:						Reviewed by	HR

# Isotropically Consolidated Undrained Triaxial Test (ICU)

**Project Title:** Luminant  
**Boring Number:** BH-107

**Project Number:** 123-94128  
**Specimen Name:** TO-8

**Date:** 17-Nov-12  
**Depth (ft):** 23.0

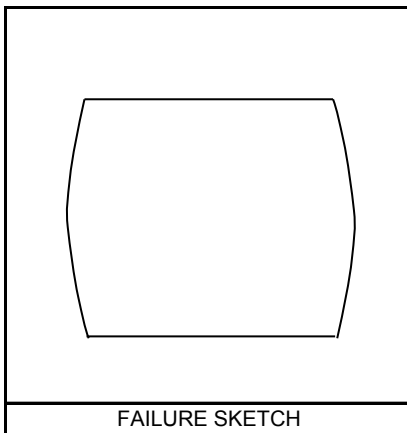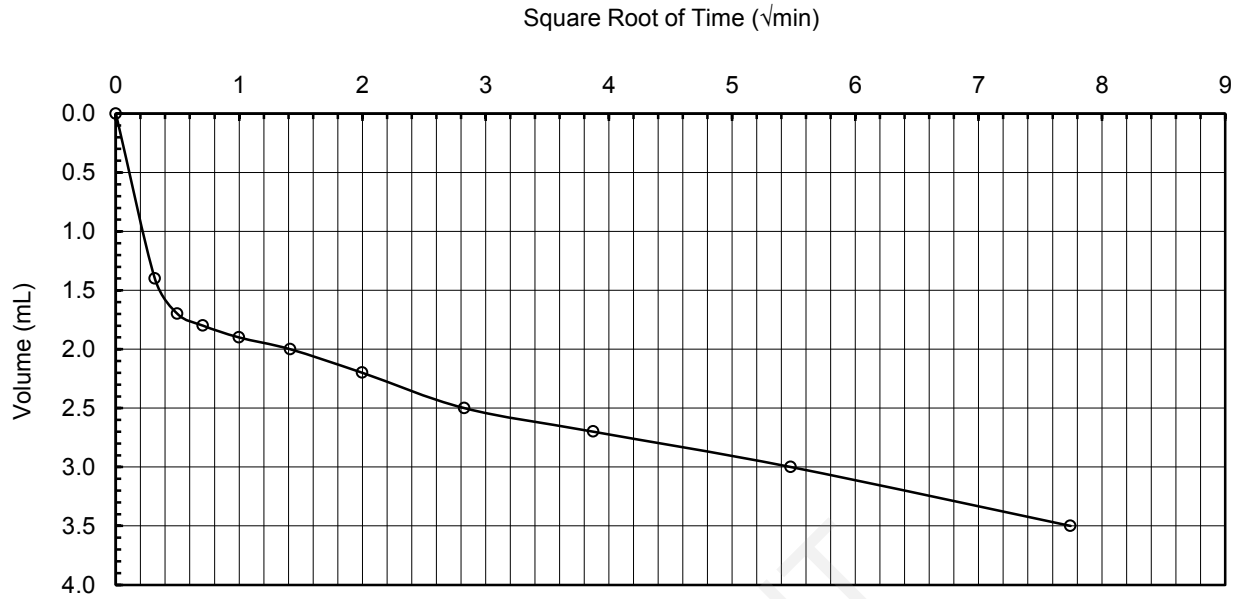

Consolidation Stress ( $\sigma'_3$ , psf) =		2867.8	
Consolidation $t_{50}$ (min) =		9	
Consolidation Volume Change (mL) =		9.7	
Unloading Stress (psf) =		NA	
Unloading $t_{50}$ (min) =		NA	
Unloading Volume Change (mL) =		NA	
LL =	42	PI =	25
USCS	CL		
Gs =	2.65	assumed	

**Performed by** PN  
**Reviewed by** HR

Established in 1960, Golder Associates is a global, employee-owned organization that helps clients find sustainable solutions to the challenges of finite resources, energy and water supply and management, waste management, urbanization, and climate change. We provide a wide range of independent consulting, design, and construction services in our specialist areas of earth, environment, and energy. By building strong relationships and meeting the needs of clients, our people have created one of the most trusted professional services organizations in the world.

Africa	+ 27 11 254 4800
Asia	+ 852 2562 3658
Australasia	+ 61 3 8862 3500
Europe	+ 356 21 42 30 20
North America	+ 1 800 275 3281
South America	+ 56 2 2616 2000

[solutions@golder.com](mailto:solutions@golder.com)  
[www.golder.com](http://www.golder.com)

**Golder Associates Inc.**  
**500 Century Plaza Drive, Suite 190**  
**Houston, TX 77073 USA**  
**Tel: (281) 821-6868**  
**Fax: (281) 821-6870**



**Engineering Earth's Development, Preserving Earth's Integrity**

Golder, Golder Associates and the GA globe design are trademarks of Golder Associates Corporation