

ANNUAL INSPECTION BY A QUALIFIED PROFESSIONAL ENGINEER
 40 CFR § 257.84(b) Rev. 0 - 1/14/2016

(b)(1) Existing and new CCR landfills and any lateral expansion of a CCR landfill must be inspected on a periodic basis by a qualified professional engineer to ensure that the design, construction, operation, and maintenance of the CCR unit is consistent with recognized and generally accepted good engineering standards. The inspection must, at a minimum, include: (i) A review of available information regarding the status and condition of the CCR unit, including, but not limited to, files available in the operating record (e.g., the results of inspections by a qualified person, and results of previous annual inspections); and (ii) A visual inspection of the CCR unit to identify signs of distress or malfunction of the CCR unit.


SITE INFORMATION	
Site Name / Address	Miami Fort Power Station 11021 Brower Road, North Bend, OH 45052
Operator Name / Address	Dynegy Miami Fort, LLC 11021 Brower Road, North Bend, OH 45052
CCR Unit	Lawrenceburg Road Ash Landfill

INSPECTION REPORT 40 CFR § 257.84(b)(2)
 Date of Inspection 12/01/2015

(b)(2)(i) Any changes in geometry of the structure since the previous annual inspection.	Initial Annual Inspection; Based on a review of the CCR unit's records and visual observation during the on-site inspection, no changes in geometry of the structure have taken place in the past year.
(b)(2)(ii) The approximate volume of CCR contained in the unit at the time of the inspection.	1,000,000 Cubic Yards
(b)(2)(iii) Any appearances of an actual or potential structural weakness of the CCR unit, in addition to any existing conditions that are disrupting or have the potential to disrupt the operation and safety of the CCR unit	No appearances of actual or potential structural weakness of the CCR unit were visually observed during the on-site inspection. A review of weekly inspections in the operating record, as well as other- monthly inspections on-file at the plant, also indicates no existing conditions that are disrupting or have the potential to disrupt the operation and safety of the CCR unit. Maintenance operations to correct minor erosion and existing drainage features have recently taken place without compromises to operation and safety of the CCR Unit.
(b)(2)(iv) Any other change(s) which may have affected the stability or operation of the CCR unit since the previous annual inspection.	Initial Annual Inspection; Based on a review of the CCR unit's records and visual observation during the on-site inspection, no other changes which may have affected the stability or operation of the CCR unit have taken place in the past year.

40 CFR § 257.84(b) - Annual inspection by a qualified professional engineer.

I, David B. Hoots, hereby certify that this report was prepared by me or under my direct supervision and that I am a duly Qualified Professional Engineer under the laws of the state of Ohio. The engineering services addressed herein have been performed, according to my knowledge, information and belief, in accordance with commonly accepted procedures consistent with applicable standards of practice, and is not a guaranty or warranty, either expressed or implied.

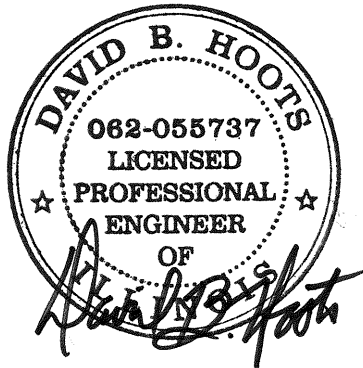

David B. Hoots, PE, Expires: 11/30/2017

Date: 1/14/2016

Under temporary authorization from the Ohio State Board of Registration for Professional Engineers and Surveyors while my application for professional registration in Ohio is Pending. This temporary authorization to practice is good for 60 days and expires on February 1, 2016.