



Cynthia Vodopivec
Illinois Power Resources Generating, LLC
Luminant
6555 Sierra Dr.
Irving, TX 75039

November 19, 2020

Sent via email

Mr. Andrew R. Wheeler, EPA Administrator
Environmental Protection Agency
1200 Pennsylvania Avenue, N.W.
Mail Code 5304-P
Washington, DC 20460

Re: Edwards Power Station Revised Alternative Closure Demonstration

Dear Administrator Wheeler:

Illinois Power Resources Generating, LLC (IPRG) submits this revised request to the U.S. Environmental Protection Agency (EPA) for approval of a site-specific alternative deadline to initiate closure pursuant to 40 C.F.R. § 257.103(f)(2) for the Ash Pond located at the Edwards Power Station near Peoria, Illinois. IPRG is requesting an extension pursuant to 40 C.F.R. § 257.103(f)(2) so that the Ash Pond may continue to receive CCR and non-CCR wastestreams after April 11, 2021, and complete closure no later than October 17, 2028.

The enclosed demonstration prepared by Burns & McDonnell replaces the demonstration that was previously submitted by IPRG to EPA on September 29, 2020. This demonstration addresses all of the criteria in 40 C.F.R. § 257.103(f)(2)(i)-(iv) and contains the documentation required by 40 C.F.R. § 257.103(f)(2)(v). As allowed by the agency, in lieu of hard copies of these documents, electronic files were submitted to Kirsten Hillyer, Frank Behan, and Richard Huggins via email. The demonstration is also available on IPRG's publicly available website: <https://www.luminant.com/ccr/>

Sincerely,

A handwritten signature in black ink that reads 'Cynthia E. Vodopivec'.

Cynthia Vodopivec
VP - Environmental Health & Safety

Enclosure

cc: Kirsten Hillyer
Frank Behan
Richard Huggins

CCR Surface Impoundment Demonstration for a Site-Specific Alternative to Initiation of Closure Deadline



Luminant

Illinois Power Resources Generating, LLC

**Edwards Power Station
Project No. 122702**

**Revision 1
11/19/2020**

CCR Surface Impoundment Demonstration for a Site-Specific Alternative to Initiation of Closure Deadline

prepared for

**Illinois Power Resources Generating, LLC
Edwards Power Station
Peoria, Illinois**

Project No. 122702

**Revision 1
11/19/2020**

prepared by

**Burns & McDonnell Engineering Company, Inc.
Kansas City, Missouri**

INDEX AND CERTIFICATION

Illinois Power Resources Generating, LLC CCR Surface Impoundment Demonstration for a Site-Specific Alternative to Initiation of Closure Deadline Project No. 122702

Report Index

<u>Chapter Number</u>	<u>Chapter Title</u>	<u>Number of Pages</u>
1.0	Executive Summary	1
2.0	Introduction	2
3.0	Documentation of No Alternative Disposal Capacity	8
6.0	Documentation of Closure Completion Timeframe	3
7.0	Conclusion	1
Appendix A	Site Plan	1



Certification

I hereby certify, as a Professional Engineer in the state of Illinois, that the information in this document as noted in the above Report Index was assembled under my direct personal charge. This report is not intended or represented to be suitable for reuse by the Illinois Power Resources Generating, LLC or others without specific verification or adaptation by the Engineer.



Edward T. Tohill, P.E. (Illinois License No. 062-056915)

Date: 11/19/20

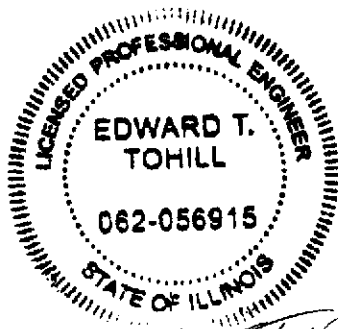

11/19/20
LIC EXPIRES
11/30/21

ATTACHMENT 7 – STRUCTURAL STABILITY ASSESSMENT
ATTACHMENT 8 – SAFETY FACTOR ASSESSMENT
ATTACHMENT 9 – CLOSURE PLAN

LIST OF TABLES

	<u>Page No.</u>
Table 3-1: Edwards CCR Wastestreams.....	3-2
Table 3-2: Edwards Non-CCR Wastestreams.....	3-5
Table 3-3: Non-CCR Wastestream Offsite Disposal.....	3-8
Table 6-1: Edwards Ash Pond Closure Schedule.....	6-2

LIST OF ABBREVIATIONS

<u>Abbreviation</u>	<u>Term/Phrase/Name</u>
CCR	Coal Combustion Residual
CFR	Code of Federal Regulations
Edwards	Edwards Power Station
ELG Rule	Effluent Limitations Guidelines and Standards for the Steam Electric Power Generating Point Source Category
EPA	Environmental Protection Agency
IPRG	Illinois Power Resources Generating, LLC
POTW	Publicly Owned Treatment Works
PSD	Prevention of Significant Deterioration
RCRA	Resource Conservation and Recovery Act
SWPPP	Stormwater Pollution Prevention Plan
TSS	total suspended solids

1.0 EXECUTIVE SUMMARY

Illinois Power Resources Generating, LLC (“IPRG”) submits this request to the U.S. Environmental Protection Agency (“EPA”) for approval of a site-specific alternative deadline to initiate closure pursuant to 40 C.F.R. § 257.103(f)(2) —“Permanent Cessation of a Coal-Fired Boiler(s) by a Date Certain”— for the Ash Pond located at the Edwards Power Station (“Edwards”) in Illinois. The Ash Pond is a 91-acre CCR surface impoundment used to manage CCR and non-CCR wastestreams at Edwards. As discussed herein, the two remaining boilers at the station will cease coal-fired operations no later than December 31, 2022 and the impoundment will complete closure no later than October 17, 2028. Therefore, IPRG is requesting an extension pursuant to 40 C.F.R. § 257.103(f)(2) so that the Ash Pond may continue to receive CCR and non-CCR waste streams after April 11, 2021, and complete closure no later than October 17, 2028.

2.0 INTRODUCTION

Edwards is a 585-megawatt coal-fueled electric generating station near Peoria, Illinois, that utilizes a 91-acre impoundment to manage sluiced bottom ash, economizer ash, dry fly ash (when not hauled offsite for beneficial use), and non-CCR wastewaters. All fly ash is typically handled dry. The impoundment was constructed in 1960 and has been in service for the life of the plant. Units 2 and 3 remain in operation, and Unit 1 has already ceased operation. Units 2 and 3 are scheduled to cease operation by December 31, 2022, pursuant to a consent decree entered by the U.S. District Court for the Central District of Illinois in *NRDC et al. v. Illinois Power Resources, LLC*, No. 13-01181 (C.D. Ill. Nov. 14, 2019). The various non-CCR wastewaters originate from the boiler and turbine room sumps, water treatment neutralization sump, Unit 1 demineralizer sump, air preheater wash, coal pile runoff, nonchemical metal cleaning wastewater, yard/substation/track drains, and other stormwater sources. The Ash Pond location is shown on Figure 1 in Appendix A, and the plant water balance diagram is included in Appendix B. The Ash Pond is referred to as both the North Ash Pond and the South Ash Pond on the water balance diagram; however, these are two portions of a single CCR unit and there is no separation dike between the two areas.

On April 17, 2015, the Environmental Protection Agency (“EPA”) issued the federal Coal Combustion Residual (“CCR”) Rule, 40 C.F.R. Part 257, Subpart D, to regulate the disposal of CCR materials generated at coal-fueled units. The rule is being administered under Subtitle D of the Resource Conservation and Recovery Act (RCRA, 42 U.S.C. § 6901 et seq.). On August 28, 2020, the EPA Administrator issued revisions to the CCR Rule that require all unlined surface impoundments to initiate closure by April 11, 2021, unless an alternative deadline is requested and approved. 40 C.F.R. § 257.101(a)(1) (85 Fed. Reg. 53,516 (Aug. 28, 2020)). Specifically, owners and operators of a CCR surface impoundment may continue to receive CCR and non-CCR wastestreams if the facility will cease operation of the coal-fired boiler(s) and complete closure of the impoundments within certain specified timeframes. 40 C.F.R. § 257.103(f)(2). To qualify for an alternative closure deadline under § 257.103(f)(2), a facility must meet the following four criteria:

1. **§ 257.103(f)(2)(i)** – No alternative disposal capacity is available on-site or off-site. An increase in costs or the inconvenience of existing capacity is not sufficient to support qualification.
2. **§ 257.103(f)(2)(ii)** - Potential risks to human health and the environment from the continued operation of the CCR surface impoundment have been adequately mitigated;
3. **§ 257.103(f)(2)(iii)** - The facility is in compliance with the CCR rule, including the requirement to conduct any necessary corrective action; and

4. **§ 257.103(f)(2)(iv)** - The coal-fired boilers must cease operation and closure of the impoundment must be completed within the following timeframes:
 - a. For a CCR surface impoundment that is 40 acres or smaller, the coal-fired boiler(s) must cease operation and the CCR surface impoundment must complete closure no later than October 17, 2023.
 - b. For a CCR surface impoundment that is larger than 40 acres, the coal-fired boiler(s) must cease operation, and the CCR surface impoundment must complete closure no later than October 17, 2028.

Section 257.103(f)(2)(v) sets out the documentation that must be provided to EPA to demonstrate that the four criteria set out above have been met. Therefore, this demonstration is organized based on the documentation requirements of §§ 257.103(f)(2)(v)(A) – (D).

3.0 DOCUMENTATION OF NO ALTERNATIVE DISPOSAL CAPACITY

To demonstrate that the criteria in § 257.103(f)(2)(i) has been met, the following provides documentation that no alternative disposal capacity is currently available on-site or off-site for each CCR and non-CCR wastestream that IPRG seeks to continue placing into the Ash Pond after April 11, 2021. Consistent with the regulations, neither an increase in costs nor the inconvenience of existing capacity was used to support qualification under this criterion. Instead, as EPA explained in the preamble to the proposed Part A revisions, “it would be illogical to require [] facilities [ceasing power generation] to construct new capacity to manage CCR and non-CCR wastestreams.” 84 Fed. Reg. 65,941, 65,956 (Dec. 2, 2019). EPA again reiterated in the preamble to the final revisions that “[i]n contrast to the provision under § 257.103(f)(1), the owner or operator does not need to develop alternative capacity because of the impending closure of the coal fired boiler. Since the coal-fired boiler will shortly cease power generation, it would be illogical to require these facilities to construct new capacity to manage CCR and non-CCR wastestreams.” 85 Fed. Reg. at 53,547. Thus, new construction or the development of new alternative disposal capacity was not considered a viable option for any wastestream discussed below.

3.1 Site-Layout and Wastewater Processes

As shown in Appendix A, Edwards is located between U.S. Highway 24 and the Illinois River. The Ash Pond receives both the CCR sluice flows and the non-CCR wastewater flows onsite (except for boiler blowdown, intake screen backwash, and non-contact cooling water). All remaining plant process flows are routed through the impoundment for treatment, as shown in Appendix B. The remaining impoundment onsite (stormwater runoff impoundment) is not authorized to receive the CCR sluice flows and is not large enough to independently treat the total volume of the plant process water flows.

3.2 CCR Wastestreams

IPRG evaluated each CCR wastestream placed in the Ash Pond at Edwards. For the reasons discussed below in Table 3-1, each of the following CCR wastestreams must continue to be placed in the Ash Pond at Edwards due to lack of alternative capacity both on and off-site.

Table 3-1: Edwards CCR Wastestreams

CCR Wastestreams	Estimated Average Flow (MGD)	Alternative Disposal Capacity Available? YES/NO	Details
Dry Fly Ash (includes air heater ash)	<p>NA (dry)</p> <p>72,100 tons/year produced based on 2019 rates; minimal projected in upcoming years due to a change in ash marketer and more aggressive marketing efforts</p>	NO	<p>The fly ash is collected dry and is currently conditioned. After conditioning, some of the fly ash is transported off-site for beneficial reuse. In 2020, 43% of ash produced was beneficially reused off-site. The need for fly ash disposal is projected to be minimal (~5%) for the remainder of 2020 and over the next two years.</p> <p>Any conditioned fly ash is placed in the Ash Pond, which will facilitate pond closure in the near future. This beneficial reuse of the fly ash will be reflected in the pond closure plan.</p> <p>IPRG does not have a CCR landfill or another CCR surface impoundment located onsite that would be available to accept this material. Consequently, there are no on-site alternatives for this wastestream.</p> <p>The idled Duck Creek landfill is located approximately 30 miles from Edwards but is not available to accept fly ash. During the operation of the Duck Creek Power Station and the active use of the landfill, fly ash materials from Edwards were periodically transported to and placed in the landfill. However, with Duck Creek's retirement in 2019, the landfill is now idled with only the minimal IEPA-required landfill operations and maintenance activities performed to maintain its idled state until ultimate closure in the near future. Also, no landfill operator remains at the site and the former access and site entrances have been closed/rerouted.</p>
Fly Ash Sluice	0	NA	Backup sluicing system has not been used for 4-5 years. IPRG will no longer use this system as required by the ELG rule.
Emergency Silo Ash Sluice	0	NA	IPRG will no longer use this system as required by the ELG rule.
Bottom Ash, Economizer Ash, and non-CCR Pyrites Sluice	1.73 (excluding flow from the retired Unit 1)	NO	<p>Currently, alternative capacity is not available on or off-site and would have to be developed. Alternative capacity would need to be designed, permitted, and installed. Off-site alternative capacity would include development of on-site temporary tanks and transporting of this sluice material offsite for disposal. Refer to the discussion below for a more detailed evaluation on the development of alternative capacity.</p>

IPRG evaluated the following on-site and off-site alternative capacity options for these CCR wastestreams:

- Dry fly ash (Approx. 72,100 tons/year handled dry in 2019):
 - On-site alternative capacity is currently not available and would need to be developed. Development of on-site alternative capacity would require the design, permitting, and installation of a new CCR impoundment or landfill. The environmental permitting would include a general NPDES stormwater construction permit (includes threatened and endangered species and historic preservation assessments), a construction & operating permit under the Illinois CCR rule (35 IAC 845), and SWPPP at a minimum. Based on our experience with environmental permitting, this effort could require three to four years.
 - Off-site alternative capacity is not currently available and would need to be developed; however, IPRG changed ash marketers in January 2020 and is currently marketing 43% of the fly ash for beneficial reuse off-site, with expected increases to 95% in 2021-2022. As a result, fly ash disposal is projected to be minimal over the remainder of the plant's operation on coal. Developed off-site alternative capacity for any potential fly ash disposal would potentially consist of off-site transportation to a contracted landfill. The disposed fly ash is conditioned (to ~10% moisture) in an on-site pug mill, and this low-sulfur Powder River Basin Class C fly ash develops cementitious characteristics when conditioned with water rather quickly. Because of this, and based on the experience of our ash marketers, off-site transportation must be limited to less than a one-hour haul time, or within 40 miles of the station, to prevent the fly ash from setting up and hardening and causing adverse disposal/unloading issues at the offsite landfill. Off-site alternative capacity would consist of off-site transportation utilizing approximately 13 trucks daily, or less depending on beneficial use opportunities. The daily truck traffic would result in increased potential for safety and noise impacts and further increases in fugitive dust, greenhouse gas emissions and carbon footprint which may require a Prevention of Significant Deterioration (PSD) permit and modification under the Clean Air Act Permit Program if the calculated increases in emissions are over the PSD limits. There are two landfills within approximately 40 miles of the station (see Figure 2 in Appendix A), so IPRG is continuing to have discussions with these offsite landfills to determine if they have the capacity and the infrastructure to handle this daily quantity of fly ash. This will also include efforts to characterize the waste. IPRG will update EPA in forthcoming progress reports if offsite disposal capacity becomes available.
- Bottom ash, economizer ash, and non-CCR mill rejects sluice (1.73 MGD average):

- On-site alternative capacity is currently not available and would need to be developed. The remaining impoundment onsite (stormwater runoff pond) is not authorized to receive the CCR material nor is it large enough to independently treat the total volume of this wastestream.
- Development of on-site alternative capacity would require the design, permitting, and installation of a new treatment system including CCR ponds, clarifiers, and/or storage tank(s), to provide the necessary retention time to meet the NPDES permit limits. The environmental permitting would include a modification to the current individual NPDES permit (to allow for the rerouting of this wastestream to another outfall), a general NPDES stormwater construction permit (includes threatened and endangered species and historic preservation assessments), a construction & operating permit under the Illinois CCR rule (35 IAC 845), and a SWPPP at a minimum would require reconfiguration, design, installation, and associated environmental permitting which would require a minimum of three years to implement.
- Off-site alternative capacity is currently not available and would need to be developed. Developed off-site alternative capacity would consist of both temporary on-site wet storage (frac tanks) and off-site transportation via tanker trucks. With an average daily flow of 1.73 MGD, approximately 83 frac tanks and 231 daily tanker trucks (~7,500 gallons per truck to maintain DOT weight restrictions) would be required, if a local POTW could be identified to receive it. The daily tanker truck traffic would result in increased potential for safety and noise impacts and further increases in fugitive dust, greenhouse gas emissions and carbon footprint which may require a PSD permit and modification under the Clean Air Act Permit Program if the calculated increases in emissions are over the PSD limits. Setting up contractual arrangements for a local POTW to accept the wastewater would prove to be difficult since this amount of wastewater would most likely upset their treatment systems causing them to exceed their NPDES discharge limits. The potential for leaks/spills from the tank system or transportation of the wastewater offsite does exist. Furthermore, the temporary wet storage needed to accommodate off-site disposal would require significant amounts of interconnecting piping, reconfiguration, design, installation, and associated environmental permitting. For all of these reasons, IPRG has determined that offsite disposal is not feasible for these flows at Edwards.

As stated previously, since IPRG has elected to pursue the option to permanently cease the coal-fired operation of the two remaining boilers by December 31, 2022, developing alternative disposal capacity is

“illogical,” to use EPA’s words, and also counterproductive to the work to retire the boilers and close the impoundments. As long as IPRG continues to wet handle the bottom ash and economizer ash material, there are no other onsite CCR impoundments to receive and treat these flows and it is not feasible to dispose of the wet-handled material offsite. The remaining impoundment onsite (stormwater runoff pond) is not authorized to receive the CCR sluice flows nor is it large enough to independently treat the total volume of this wastestream. As EPA explained in the preamble of the 2015 rule, it is not possible for sites that sluice CCR material to an impoundment to eliminate the impoundment and dispose of the material offsite. See 80 Fed. Reg. 21,301, 21,423 (Apr. 17, 2015) (“[W]hile it is possible to transport dry ash off-site to [an] alternate disposal facility that is simply not feasible for wet-generated CCR. Nor can facilities immediately convert to dry handling systems.”). As a result, the conditions at Edwards satisfy the demonstration requirement in § 257.103(f)(2)(i).

Consequently, in order to continue to operate and generate electricity, Edwards must continue to use the 91-acre CCR surface impoundment to manage the CCR wastestreams discussed above. IPRG is working with nearby offsite landfills to characterize waste and determine potential for offsite disposal of fly ash, which currently does not exist. Accordingly, the projected minimal amounts of fly ash that will be disposed must be placed in the only available onsite disposal location (i.e., the Ash Pond) unless alternative offsite capacity can be established.

3.3 Non-CCR Wastestreams

IPRG evaluated each non-CCR wastestream placed in the Ash Pond at Edwards. For the reasons discussed below in Table 3-2, each of the following non-CCR wastestreams must continue to be placed in the Ash Pond at Edwards due to lack of alternative capacity both on and off-site.

Table 3-2: Edwards Non-CCR Wastestreams

Non-CCR Wastestreams	Estimated Average Flow (MGD)	Alternative Disposal Capacity Currently Available? YES/NO	Details
Coal Pile Runoff (and coal handling wash water)	0.056 (1.72 for 10-year, 24-hour storm)	NO	Coal pile runoff would need to be rerouted to a new sump for discharge to an existing or new permitted outfall. This flow would require a new non-CCR impoundment for adequate TSS removal and surge capacity to meet the discharge limits. Refer to the discussion below for a more detailed evaluation on the development of alternative capacity options.

Non-CCR Wastestreams	Estimated Average Flow (MGD)	Alternative Disposal Capacity Currently Available? YES/NO	Details
Yard Drains (includes service water tower flush), Substation Drains, and Track Drains	0.046 (2.17 for 10-year, 24-hour storm)	NO	The yard drains could be rerouted to the stormwater basin which would need to be expanded and the site drainage system redesigned and modified. Permit modifications would be required, and additional sumps and piping may need to be installed for discharge to an existing or new permitted outfall. Refer to the discussion below for a more detailed evaluation on the development of alternative capacity options.
Fly Ash Truck Wash Water	0.012	NO	Currently the fly ash truck wash water discharges to the yard drain piping which could be rerouted to the stormwater basin. The stormwater basin would need to be expanded and the site drainage system would need to be redesigned and modified. Permit modifications would be required, and additional sumps and piping would need to be installed for discharge to an existing or new permitted outfall. Refer to the discussion below for a more detailed evaluation on the development of alternative capacity options.
Boiler and Turbine Room Sumps (including floor drains, ash hopper overflow, and miscellaneous uses and drains)	1.09	NO	Permit modifications would be required, and additional piping would need to be installed to reroute the flow to a new treatment system for discharge to an existing or new permitted outfall. This flow would require the wastewater treatment system for adequate TSS removal to meet the discharge limits. Refer to the discussion below for a more detailed evaluation on the development of alternative capacity options.
Neutralization Sump (including water treatment wastewaters such as clarifier blowdown, pressure filter backwash, RO Reject, and Unit 3 demineralizer regeneration flows)	0.074	NO	Permit modifications would be required, and additional sumps and piping would need to be installed to reroute to a new treatment system for discharge to an existing or new permitted outfall. Refer to the discussion below for a more detailed evaluation on the development of alternative capacity options.

Non-CCR Wastestreams	Estimated Average Flow (MGD)	Alternative Disposal Capacity Currently Available? YES/NO	Details
Unit 1 Demineralizer Sump	0	NA	IPRG will no longer use this sump due to the closure of Unit 1.
Air Preheater Wash Water	0	NA	An air preheater wash has not occurred since 2016 and is not anticipated to occur before the December 31, 2022 plant closure date.

As noted in Table 3-2, there is potential to discharge a portion of these non-CCR flows to other locations/outfalls; however, this would require permit modifications and installation of new piping and potentially a new treatment system including non-CCR ponds, clarifiers, and/or storage tank(s). IPRG evaluated development of on-site and off-site alternative capacity options for the non-CCR wastestreams. Development of on-site alternative capacity would require the design, permitting, and installation of a new treatment system including non-CCR ponds, clarifiers, and/or storage tank(s) to provide the necessary retention time for TSS removal to meet the NPDES permit limits. The environmental permitting would include a modification to the current individual NPDES permit (to allow for the rerouting of this wastestream to another outfall), general NPDES stormwater construction permit (includes threatened and endangered species and historic preservation assessments), a construction & operating permit, and a SWPPP at a minimum which would require a minimum of three years to implement.

Development of off-site alternative capacity would consist of both temporary on-site wet storage (frac tanks) and off-site transportation via tanker trucks assuming a local POTW could be identified to receive these streams. The required daily frac tanks and tanker trucks (~7,500 gallons per truck to maintain DOT weight restrictions) for each wastestream is provided in Table 3-3. The daily tanker truck traffic would result in increased potential for safety and noise impacts and further increases in fugitive dust, greenhouse gas emissions and carbon footprint which may require a PSD permit and modification under the Clean Air Act Permit Program if the calculated increases in emissions are over the PSD limits. Setting up arrangements for a local POTW to accept this wastewater could prove to be difficult if this amount of wastewater would upset their treatment systems, causing them to exceed their NPDES discharge limits. IPRG is continuing to have discussions with local POTW's to determine if they have the capacity and the infrastructure to handle these daily volumes of wastewater. This will also include efforts to characterize the waste. IPRG will update EPA in forthcoming progress reports if offsite disposal capacity becomes

available. The potential for leaks/spills from the tank system or transportation of the wastewater offsite does also exist. Furthermore, the temporary wet storage needed to accommodate off-site disposal would require reconfiguration, design, installation, and associated environmental permitting which would require a minimum of two years to implement. For all of these reasons, IPRG has determined that offsite disposal is not feasible for these flows at Edwards at this time.

Table 3-3: Non-CCR Wastestream Offsite Disposal

Non-CCR Wastestreams	Estimated Flow (MGD)	No. of Frac Tanks required (21,000 gallons each)	No. of Trucks required per day (7,500 gallons each)
Coal Pile Runoff	0.056 - 1.72	NA	8 - 230
Yard Drains, Substation Drains, and Track Drains	0.046 - 2.17	104	7 - 290
Fly Ash Truck Wash Water	0.012	1	2
Boiler and Turbine Room Sumps	1.09	52	146
Neutralization Sump	0.074	4	10
Total		161	173 - 678

As stated previously, because IPRG has elected to pursue the option to permanently cease the coal-fired operation of the two remaining boilers at the station by December 31, 2022, developing alternative disposal capacity is “illogical,” to use EPA’s words, and also counterproductive to the work to cease coal-fired operations of the boilers and close the impoundment. There is currently no available infrastructure at the plant to support reroute of these flows. For the reasons discussed above, each of the following non-CCR wastestreams must continue to be placed in the Ash Pond due to lack of alternative capacity both on and off-site. Consequently, in order to continue to operate and generate electricity, Edwards must continue to use the 91-acre Ash Pond to manage the non-CCR wastestreams discussed above.

4.0 RISK MITIGATION PLAN

To demonstrate that the criteria in § 257.103(f)(2)(ii) has been met, IPRG has prepared and attached a Risk Mitigation Plan for the Edwards Ash Pond (see Attachment 1).

5.0 DOCUMENTATION AND CERTIFICATION OF COMPLIANCE


In the Part A rule preamble, EPA reiterates that compliance with the CCR rule is a prerequisite to qualifying for an alternative closure extension, as it “provides some guarantee that the risks at the facility are properly managed and adequately mitigated.” 85 Fed. Reg. at 53,543. EPA further stated that it “must be able to affirmatively conclude that facility meets this criterion prior to any continued operation.” 85 Fed. Reg. at 53,543. Accordingly, EPA “will review a facility’s current compliance with the requirements governing groundwater monitoring systems.” 85 Fed. Reg. at 53,543. In addition, EPA will also “require and examine a facility’s corrective action documentation, structural stability documents and other pertinent compliance information.” 85 Fed. Reg. at 53,543. Therefore, EPA is requiring a certification of compliance and specific compliance documentation be submitted as part of the demonstration. 40 C.F.R. § 257.103(f)(2)(v)(C).

To demonstrate that the criteria in § 257.103(f)(2)(iii) has been met, IPRG is submitting the following information as required by § 257.103(f)(2)(v)(C):

5.1 Owner’s Certification of Compliance - § 257.103(f)(2)(v)(C)(1)

I hereby certify that, based on my inquiry of those persons who are immediately responsible for compliance with environmental regulations for the Ash Pond at Edwards, the facility is in compliance with all of the requirements contained in 40 C.F.R. Part 257, Subpart D – Standards for the Disposal of Coal Combustion Residuals in Landfills and Surface Impoundments. The Edwards CCR compliance website is up-to-date and contains all the necessary documentation and notification postings.

On behalf of IPRG:



Cynthia Vodopivec
VP - Environmental Health & Safety
November 19, 2020

5.2 Visual representation of hydrogeologic information - § 257.103(f)(2)(v)(C)(2)

Consistent with the requirements of § 257.103(f)(2)(v)(C)(2)(i) – (iii), IPRG has attached the following items to this demonstration:

- Map(s) of groundwater monitoring well locations in relation to the CCR unit (Attachment 2)
- Well construction diagrams and drilling logs for all groundwater monitoring wells (Attachment 3)
- Maps that characterize the direction of groundwater flow accounting for seasonal variations (Attachment 4)

5.3 Groundwater monitoring results - § 257.103(f)(2)(v)(C)(3)

Tables summarizing constituent concentrations at each groundwater monitoring well through the first 2020 semi-annual monitoring period are included as Attachment 5.

5.4 Description of site hydrogeology including stratigraphic cross-sections - § 257.103(f)(2)(v)(C)(4)

A description of site hydrogeology and stratigraphic cross-sections of the site are included as Attachment 6.

5.5 Corrective measures assessment - § 257.103(f)(2)(v)(C)(5)

Background sampling began at Edwards in late 2015 and continued for eight consecutive quarters. The first semiannual detection monitoring samples were collected in November 2017. The first assessment monitoring samples were collected in May 2018. The results, through the 2020 monitoring period, indicate that the Edwards Ash Pond is currently in assessment monitoring, with no exceedances of the Appendix IV parameters. Accordingly, an assessment of corrective measures is not currently required at the site. Edwards will continue to conduct groundwater monitoring in accordance with all state and federal requirements.

5.6 Remedy selection progress report - § 257.103(f)(2)(v)(C)(6)

As noted above, an assessment of corrective measures and the resulting selection of remedy are not currently required for the Ash Pond.

5.7 Structural stability assessment - § 257.103(f)(2)(v)(C)(7)

Pursuant to § 257.73(d), the initial structural stability assessment for the Ash Pond was prepared in October 2016 and is included as Attachment 7, as well as a memorandum which confirms the structural stability assessment.

5.8 Safety factor assessment - § 257.103(f)(2)(v)(C)(8)

Pursuant to § 257.73(e), the initial safety factor assessment for the Ash Pond was prepared in October 2016 and is included as Attachment 8.

6.0 DOCUMENTATION OF CLOSURE COMPLETION TIMEFRAME

To demonstrate that the criteria in § 257.103(f)(2)(iv) has been met, “the owner or operator must submit the closure plan required by § 257.102(b) and a narrative that specifies and justifies the date by which they intend to cease receipt of waste into the unit in order to meet the closure deadlines.” The closure plan for the Ash Pond, along with an addendum, is included as Attachment 9.

In order for a CCR surface impoundment over 40 acres to continue to receive CCR and non-CCR wastestreams after the initial April 11, 2021 deadline, the coal-fired boiler(s) at the facility must cease operation and the CCR surface impoundment must complete closure no later than October 17, 2028. As discussed below, Edwards will begin construction of the Ash Pond closure by April 17, 2026 in order for closure to be completed by this deadline.

Table 6-1 is included below to summarize the major tasks and estimated durations associated with closing the Ash Pond in place. These durations are consistent with the durations experienced in the closure of over 500 acres of other CCR impoundments already completed by IPRG and its affiliates to date as noted below:

- Baldwin Fly Ash Pond System – 230 acres closed in-place with an approximate 30-month construction schedule
- Hennepin West Ash Ponds System – 35 acres closed in-place with an approximate 24-month construction schedule (includes closure by removal of an adjacent 6-acre settling pond and installing a sheet pile wall)
- Hennepin East Ash Ponds 2 and 4 – 25 acres closed in-place with an approximate 6-month construction schedule
- Coffeen Ash Pond 2 – 60 acres closed in-place with an approximate 24-month construction schedule
- Duck Creek Ash Ponds 1 and 2 – 130 acres closed in-place with an approximate 24-month construction schedule

Each CCR impoundment closure indicated above utilized a closely coordinated passive or gravity dewatering method, which consisted of the use of trenches excavated to lower the phreatic surface in portions of the impoundment to obtain a stable ash surface to permit the safe construction of the final cover system. The phreatic water in the trenches flows by gravity to sumps constructed within the impoundment. The major benefit associated with this passive or gravity dewatering method is that the sumps are designed to provide holding time to allow the TSS to settle within the impoundment prior to discharge (an active

dewatering method with wells would result in potential discharges of unsettled TSS). After solids settling, the water is discharged through the NPDES outfall in compliance with permitted limits.

Construction progressed sequentially as the dewatering of an area stabilized the ash surface. The CCR was graded to subgrade level, then overlain with the compacted clay layers and/or geomembrane liners. Vegetative soil cover was then placed on top of the infiltration layer. As each section of the impoundment was closed, this sequencing progressed to the completion of the pond closure. A similar process will be utilized to close the Edwards Ash Pond. This sequencing will provide sufficient time for closure to be completed by October 17, 2028.

Table 6-1 provides estimates for the durations required to close the pond footprint. In order to dewater the closure area, IPRG will likely release pond water through the existing Outfall 001.

Table 6-1: Edwards Ash Pond Closure Schedule

Action	Estimated Timeline (Months)
Spec, bid, and Award Engineering Services for CCR Impoundment Closure	3
Finalize CCR unit closure plan and seek IEPA approval for CCR unit closure	12
Cease Coal-Fired Operations of Remaining Two Boilers Onsite (No Later Than, unless the Midcontinent Independent System Operator requires continued operation for a short term beyond this date)	December 31, 2022
Obtain environmental permits (based on IEPA approval of closure plan): <ul style="list-style-type: none"> • State Waste Pollution Control Construction/Operating Permit • NPDES Industrial Wastewater Permit Modification (<i>modification would be required to allow the associated ponded and subsurface free liquids generated before the pond closure to be discharged to Waters of the US and to allow reconfiguration of the various wastestreams to either other NPDES-permitted outfalls or newly-constructed NPDES-permitted outfalls</i>) • General NPDES Permit for Storm Water Discharges from Construction Site Activities and SWPPP • Proposed 35 Ill. Admin Code 845 operating permit application is due NLT September 2021. 	21

Action	Estimated Timeline (Months)
Construction permit application is anticipated to be due NLT July 2022.	
Spec, bid, and Award Construction Services for CCR Impoundment Closure	3
Begin Construction of Closure/Final Receipt of non-CCR Wastestreams (IPRG will start as soon as feasible but must start no later than this date, allowing for pond closure design/permitting/procurement activities and for plant cleanup and dredging of non-CCR ponds following coal pile and plant closure efforts to occur prior to this date.)	April 17, 2026
Dewater Impoundment	6
Regrade CCR Material	18
Install Cover System*	12
Establish Vegetation, Perform Site Restoration Activities, Complete Closure, and Initiate Post-Closure Care	2
Total Estimated Time to Complete Closure (including design, permitting, and procurement)	69
Date by Which Closure Must be Complete	October 17, 2028



* Activity expected to overlap with grading operations, finishing 4 months after grading is completed.

7.0 CONCLUSION


Based upon the information included in and attached to this demonstration, IPRG has demonstrated that the requirements of 40 C.F.R. § 257.103(f)(2) are satisfied for the 91-acre Ash Pond at Edwards. This CCR surface impoundment is needed to continue to manage the CCR and non-CCR wastestreams identified in Section 3.2 and 3.3 above, is larger than 40 acres, and the two remaining boilers at the station will cease coal-fired operation by December 31, 2022, and the Ash Pond will be closed by the October 17, 2028 deadline. Therefore, this CCR unit qualifies for the site-specific alternative deadline for the initiation of closure authorized by 40 C.F.R. § 257.103(f)(2).

Therefore, it is requested that EPA approve IPRG's demonstration and authorize the Ash Pond at Edwards to continue to receive CCR and non-CCR wastestreams notwithstanding the deadline in § 257.101(a)(1) and to grant the alternative deadline of October 17, 2028, by which to complete closure of the impoundment.

APPENDIX A – SITE PLAN AND NEARBY LANDFILLS

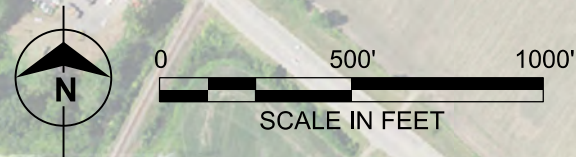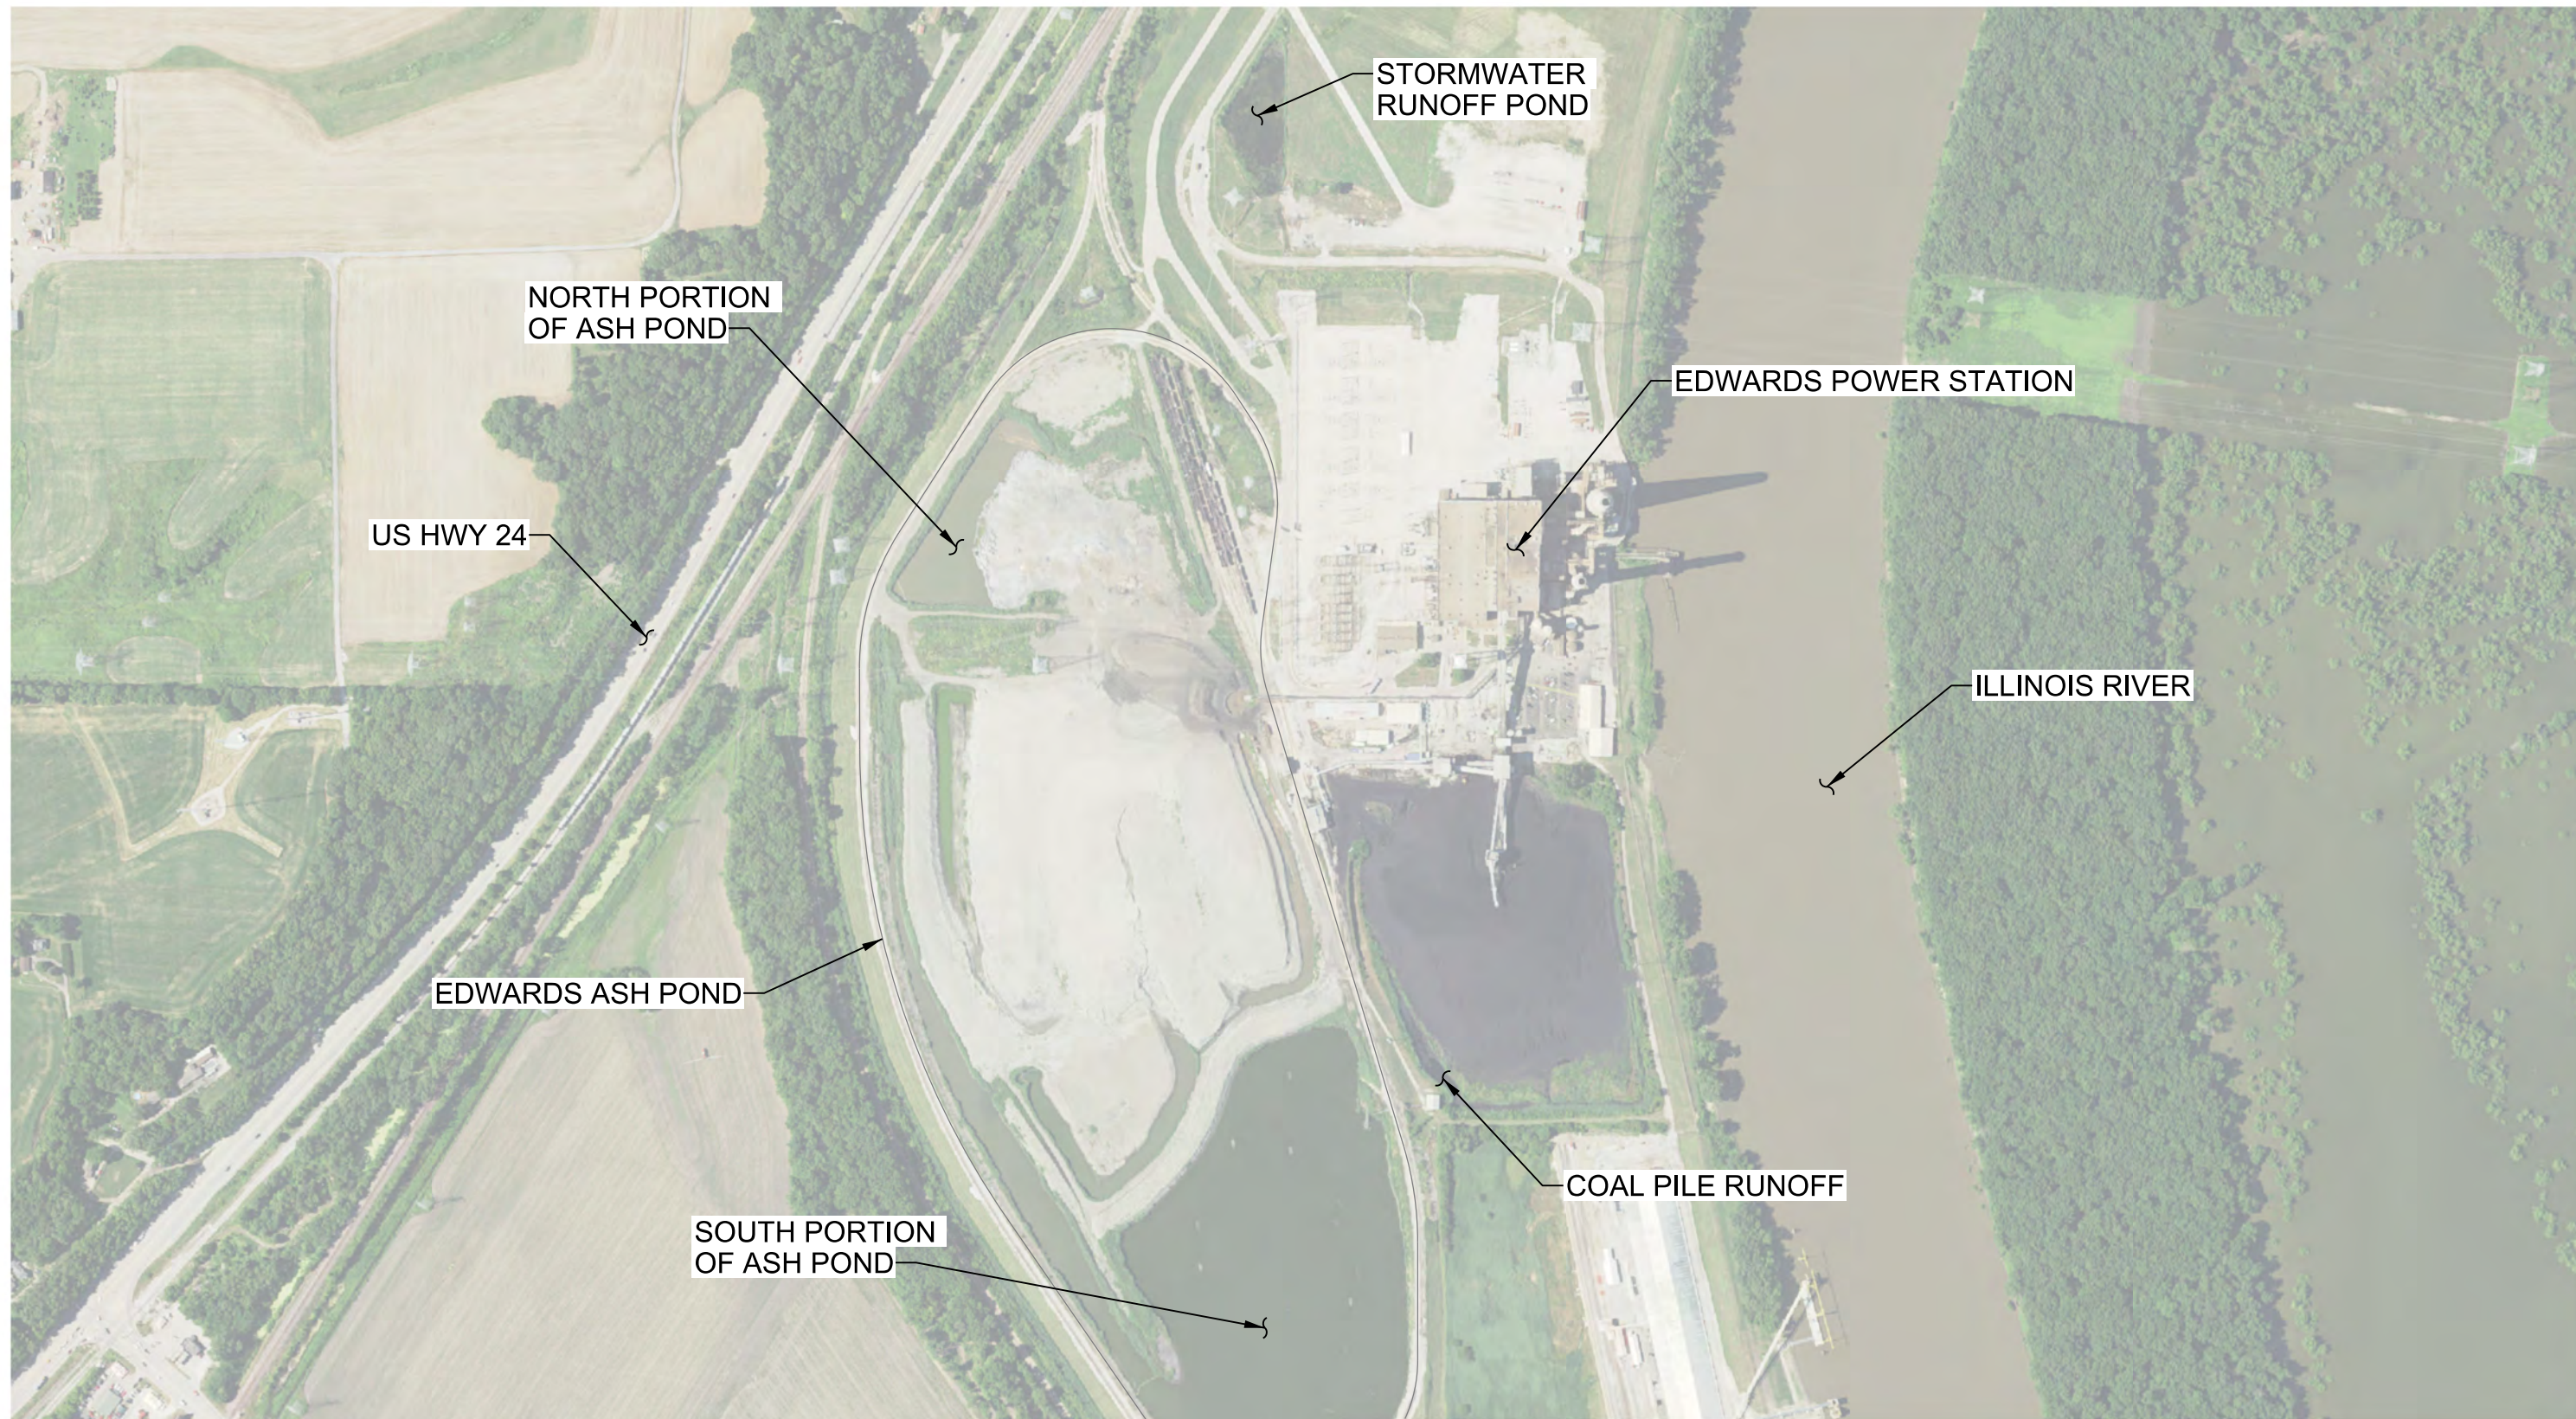

 date 03/05/2020 designed A. MYERS	LUMINANT EDWARDS POWER STATION SITE PLAN	project 122702
		contract -
		dwg FIGURE 1

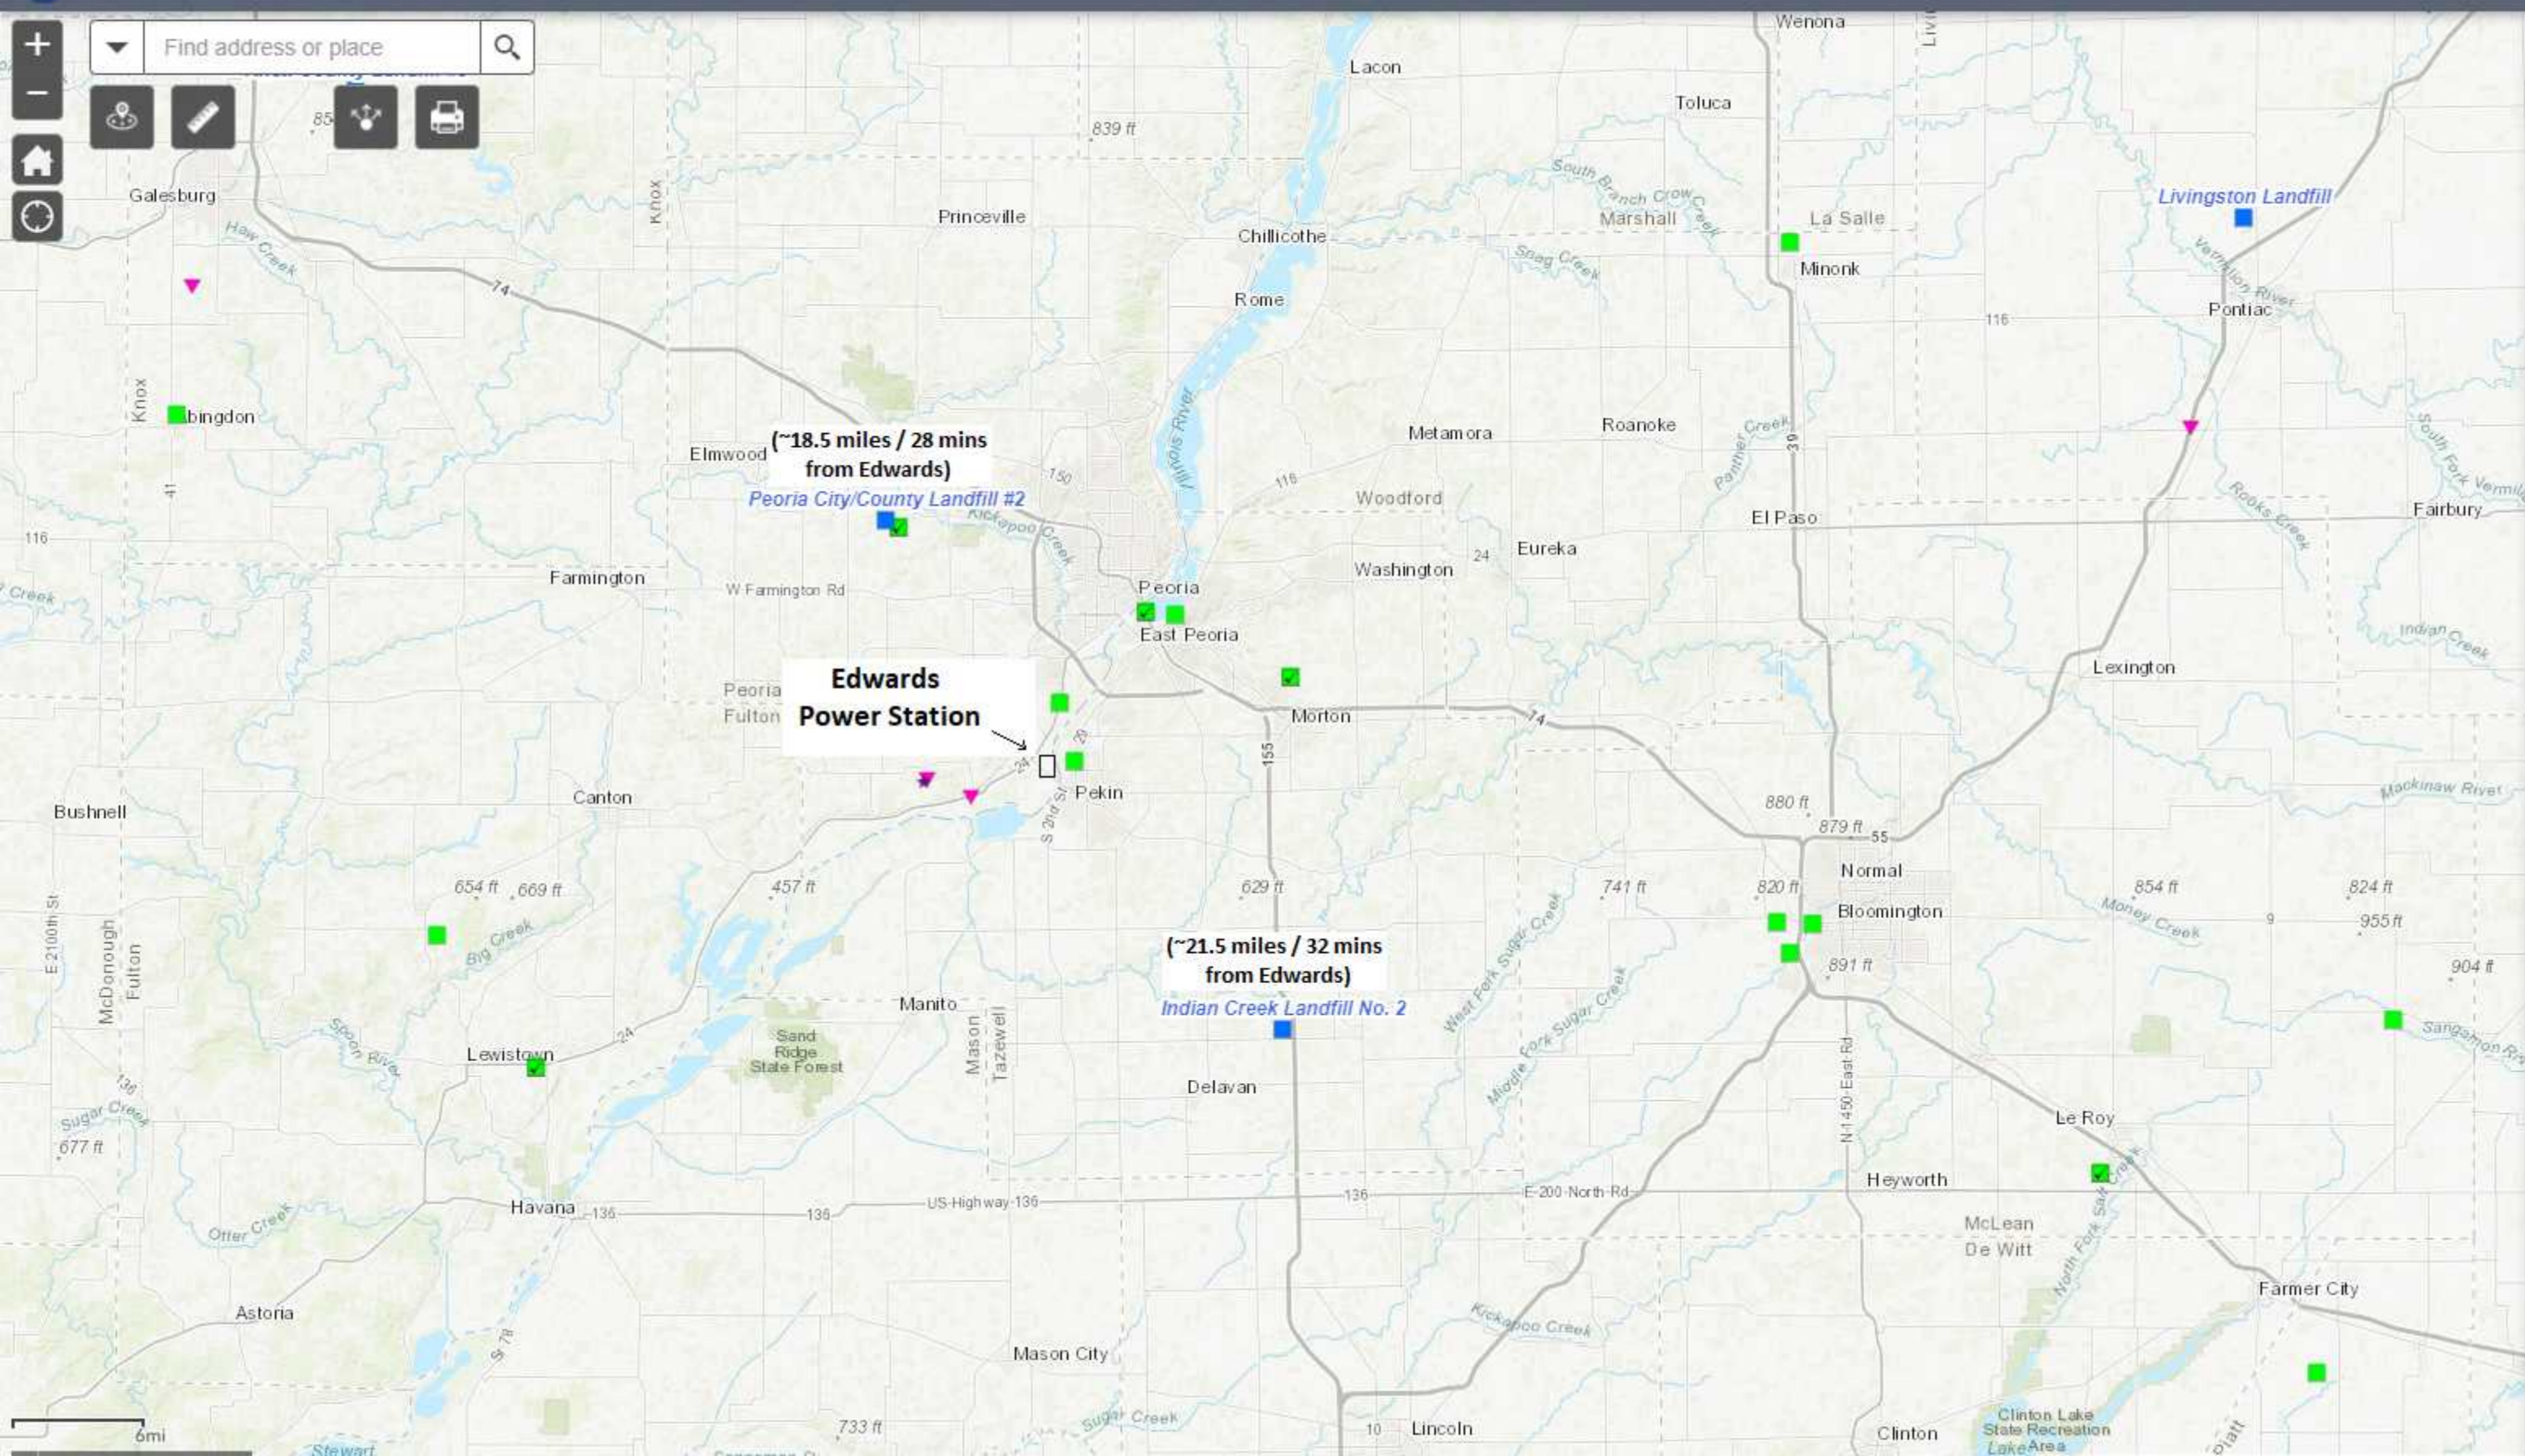


Legend

- Active Municipal Solid Waste Landfill
- Landfill In Post Closure
- Landfill Certified Post Closure
- Landfill In Voluntary Sites Program
- Landfill In State Sites Program

Figure 2

APPENDIX B – WATER BALANCE DIAGRAM

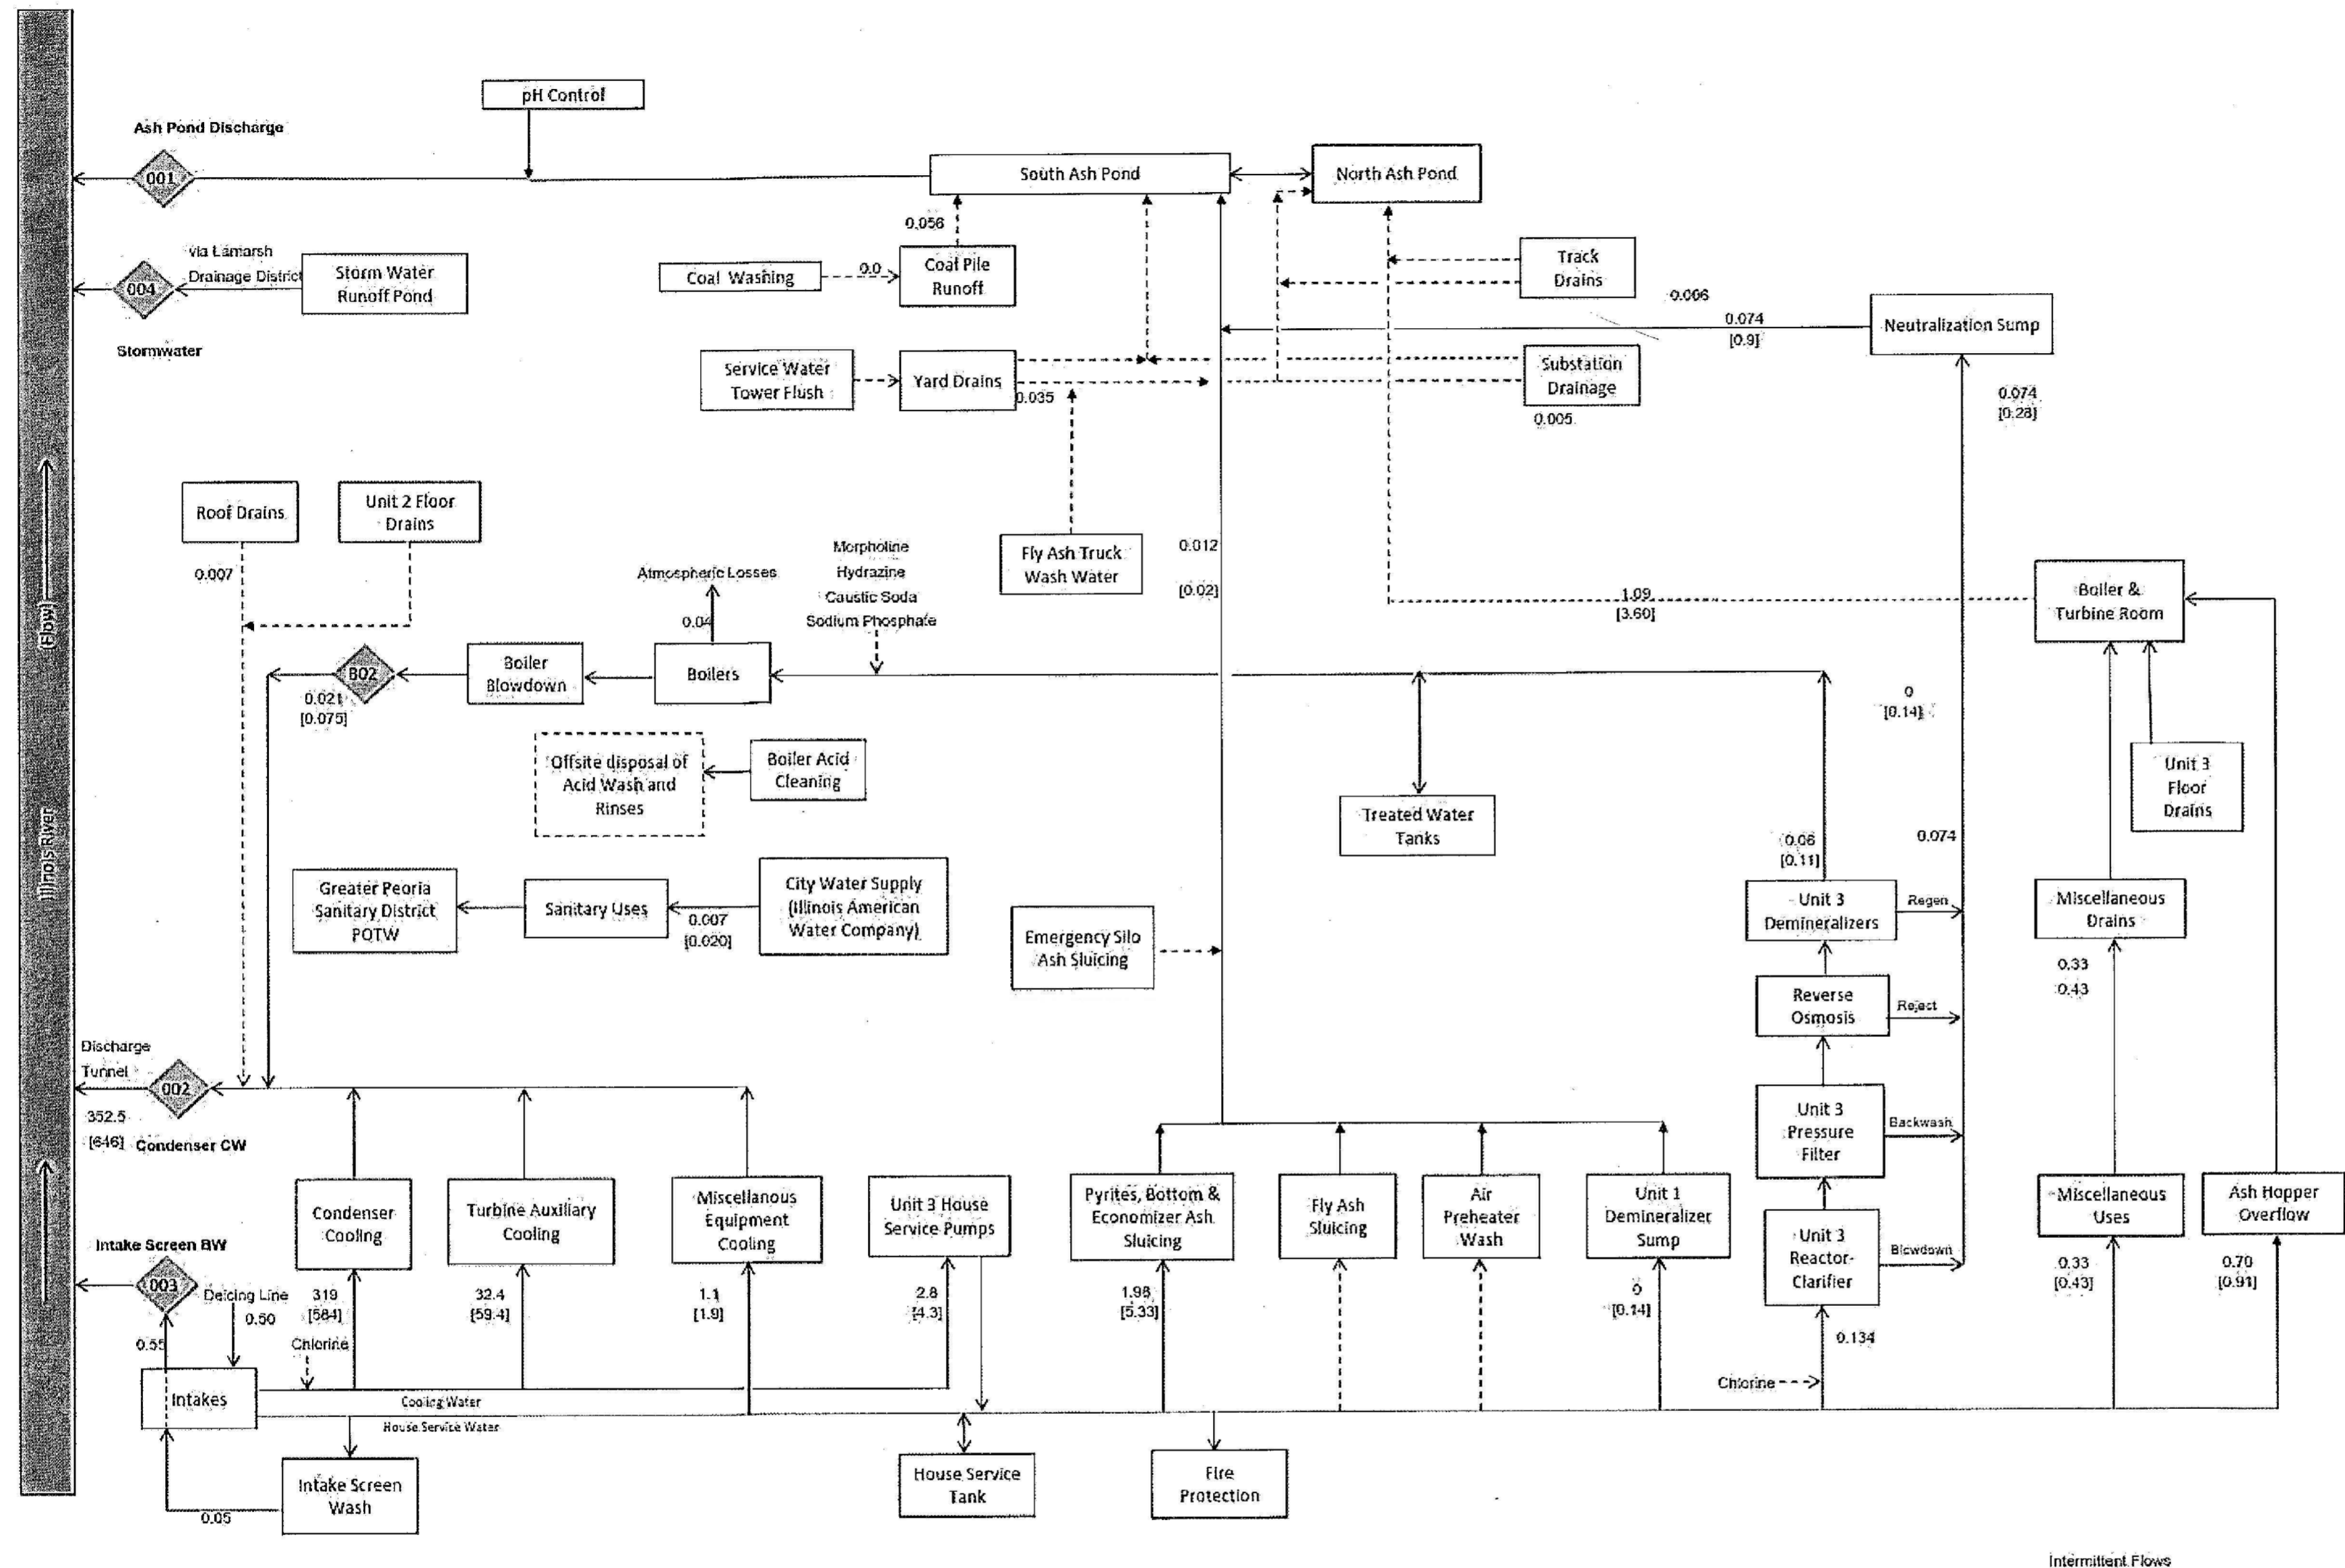

- Notes:
- 1 Flows shown as: Average [Maximum]
 - 2 Flow units = Million Gallons per Day
 - 3 Flows for Outfalls 001, 002, 003 and 004 from 2015 NPDES Balances

1
2
3
4

DYNEGY CONFIDENTIAL
This drawing is the property of DYNEGY INC. Neither this drawing, nor reproductions of it, nor information derived from it, shall be given to others without the expressed written consent of DYNEGY INC. No use is to be made of it which is, or may be, injurious to DYNEGY INC.

REFERENCE DRAWINGS

NO.	DATE	REVISION	BY	APPROVED

NO.	DATE	REVISION	BY	APPROVED
B	9/21/17	RECORD REVISION	CWB	M.DAVIS M.DAVIS
A1	12/11/15	CLIENT REVIEW	KB	MR AB
A0	11/4/15	INITIAL ISSUE	KC	MH WP

SCALE: SCALE

DWN. K.CHEONG DATE 11/4/15
CHK. M.HEERMAN DATE 11/4/15
APPV. W.PATEL DATE 11/4/15

DYNEGY

EFFLUENT LIMITATION GUIDELINES COMPLIANCE PLANNING STUDY
PRELIMINARY WATER BALANCE - EDWARDS

PROJECT NO.:	
CLIENT:	S&L
DWG. NO.:	C175-M150
REV.:	B

ATTACHMENT 1 – RISK MITIGATION PLAN

RISK MITIGATION PLAN - 40 C.F.R. § 257.103(f)(2)(v)(B)

INTRODUCTION

To demonstrate that the criteria in §40 C.F.R. 257.103(f)(2)(ii) has been met, Illinois Power Resources Generating, L.L.C. (“IPRG”) has prepared this Risk Mitigation Plan for the Ash Pond located in at the Edwards Power Station (“Edwards”) in Bartonville, Illinois.

- EPA is requiring a risk mitigation plan to “address the potential risk of continued operation of the CCR surface impoundment while the facility moves towards closure of their coal-fired boiler(s), to be consistent with the court’s holding in *USWAG* that RCRA requires EPA to set minimum criteria for sanitary landfills that prevent harm to either human health or the environment.” 85 Fed. Reg. at 53,516, 53,548 (Aug. 28, 2020).

As required by § 257.103(f)(2)(v)(B), the Risk Mitigation Plan must describe the “measures that will be taken to expedite any required corrective action,” and contain the three following elements:

- First, “a discussion of any physical or chemical measures a facility can take to limit any future releases to groundwater during operation.” § 257.103(f)(2)(v)(B)(1). In promulgating this requirement, EPA explained that this “might include stabilization of waste prior to disposition in the impoundment or adjusting the pH of the impoundment waters to minimize solubility of contaminants [and that] [t]his discussion should take into account the potential impacts of these measures on Appendix IV constituents.” 85 Fed. Reg. at 53,548.
- Second, “a discussion of the surface impoundment’s groundwater monitoring data and any found exceedances; the delineation of the plume (if necessary based on the groundwater monitoring data); identification of any nearby receptors that might be exposed to current or future groundwater contamination; and how such exposures could be promptly mitigated.” § 257.103(f)(2)(v)(B)(2).
- Third, “a plan to expedite and maintain the containment of any contaminant plume that is either present or identified during continued operation of the unit.” § 257.103(f)(2)(v)(B)(3). In promulgating this final requirement, EPA explained that “the purpose of this plan is to demonstrate that a plume can be fully contained and to define how this could be accomplished in the most accelerated timeframe feasible to prevent further spread and eliminate any potential for exposures.” 85 Fed. Reg. at 53,549. In addition, EPA stated that “this plan will be based on relevant site data, which may include groundwater chemistry, the variability of local hydrogeology, groundwater elevation and flow rates, and the presence of any surface water features that would influence rate and direction of contamination movement. For example, based on the rate and direction of groundwater flow and potential for diffusion of the plume, this plan could identify the design and spacing of extraction wells necessary to prevent further downgradient migration of contaminated groundwater.” 85 Fed. Reg. at 53,549.

Consistent with these requirements and guidance, IPRG plans to continue to mitigate the risks to human health and the environment from the Edwards Ash Pond as detailed in this Risk Mitigation Plan.

1 OPERATIONAL MEASURES TO LIMIT FUTURE RELEASES TO GROUNDWATER – 40 C.F.R. § 257.101(F)(2)(v)(B)(1)

The Edwards Ash Pond is a 91-acre CCR surface impoundment. Consistent with the requirements of the CCR rule, compliance documents on Edward's CCR public website reflect the characterization of the Ash Pond as a single unit for purposes of groundwater monitoring and closure activities.

The Edwards CCR surface impoundment receives CCR transport waters from bottom ash and economizer ash plus non-CCR process waters on-site before discharging to the Illinois River via Outfall 001 in accordance with NPDES Permit No. IL0001970.

At the Edwards Ash Pond, none of the Appendix IV parameter have reported statistically significant levels (SSLs) above their respective Ground Water Protection Standards (GWPSs), as sampled and analyzed per the ash impoundment's groundwater monitoring program. Therefore, Edwards' current physical treatment operation adequately limits potential risks to human health and the environment during operation. Edwards will continue this treatment process for the CCR surface impoundment until such time as closure is required per 40 CFR 257. The facility's current physical treatment process is discussed below, followed by a discussion of other treatment processes that could be implemented, as required per § 257.103(f)(2)(v)(B)(1).

1.1 CURRENT OPERATION OF PHYSICAL TREATMENT

Fly ash is captured dry. Therefore, current operations do not add fly ash transport waters to the CCR surface impoundment.

As part of normal operations, bottom ash is transported through the sluice lines into the CCR surface impoundment. The ash enters a settling basin where the solids settle out. These solids are periodically dipped from the basin and stacked on site for dewatering. Some of the bottom ash is then transported offsite for beneficial reuse. The CCR surface impoundment is also a wastewater treatment settling system which allows the solids to settle.

Therefore, since fly ash transport water is not conveyed to the CCR surface impoundment and bottom ash solids are removed from the CCR surface impoundment, the current operation of Edwards' CCR surface impoundment limits future releases to groundwater during operation, and consequently no potential safety impacts or exposure to human health or environmental receptors are expected to result.

If Appendix IV releases are discovered per the facility's groundwater monitoring program, IPRG will test, evaluate, and implement a chemical treatment method (i.e. pH adjustment, coagulation, precipitation, or other method as determined) for the Edwards CCR Impoundment to limit potential risks to human health and the environment during operation.

2 GROUNDWATER IMPACTS, RECEPTORS, AND POTENTIAL EXPOSURE MITIGATION - 40 C.F.R. § 257.101(F)(2)(V)(B)(2)

The Edwards Ash Pond, with a footprint of approximately 91 acres (Figure 1), currently remains in assessment monitoring. There have been no SSLs of Appendix IV parameter concentrations since assessment monitoring was established on April 9, 2018 in accordance with 40 CFR § 257.95. The most recent summary of groundwater monitoring activities is provided in the “2019 Annual Groundwater Monitoring and Corrective Action Report, Edwards Ash Pond, Edwards Power Station” (Ramboll, 2020) [see Attachment 1]. A summary of the assessment monitoring program is provided in Table 1. Since there have been no SSL exceedances of GWPS(s) to date, plume delineation has not been required. However, if one or more Appendix IV constituents are detected at SSLs above the GWPS(s), the nature and extent of the release would be characterized to delineate the contaminant plume. The existing conceptual site model and description of site hydrogeology provides site characterization data that will be used as the basis for executing supplemental plume delineation activities. A demonstration may also be made that a source other than the CCR unit caused the contamination, or that the SSL resulted from error in sampling, analysis, statistical evaluation, or natural variation in groundwater quality (§257.95(g)(3)(ii)).

Receptors

For constituents of potential concern (COPCs) found in groundwater to pose a risk to human health or the environment, a complete exposure pathway must be present to a receptor with elevated concentrations of COPCs via that pathway.

Should a release of one or more Appendix IV parameters from the Edwards Ash Pond to groundwater occur in the future, the two primary risks to human health and the environment are via groundwater exposure and surface water exposure. Groundwater exposure would be via ingestion or dermal contact, both of which are likely an incomplete exposure pathway for the reasons discussed below. Impacted groundwater potentially migrating to nearby surface water bodies – specifically the Illinois River located approximately 1,100 feet east of the north end of the Edwards Ash Pond and 1,500 feet east of the south end – is another potential exposure pathway; however, this is also likely incomplete for the reasons discussed below.

Ambient groundwater flow in the Uppermost Aquifer beneath the Edwards Ash Pond is generally west to west-southwest beneath the north portion of the impoundment, swinging around to southwest and south beneath the south end, eventually discharging into the Illinois River south of Edwards. The hydraulic gradient from the river to the west side of the impoundment under normal ambient conditions typically ranges from 0.002 to 0.003 ft/ft, becoming steeper towards the southern end of the impoundment as groundwater begins flowing southward back towards the Illinois River. Groundwater flow velocity within the Uppermost Aquifer ranged from approximately 0.001 to 0.12 ft/day as groundwater flowed from the Illinois River towards a bedrock channel beneath the impoundment in January 2017. During May 2017 velocities were slightly higher in portions of the site and ranged from 0.001 to 0.185 ft/day. In general, the flow velocity is slower near the river and increases in the southwest portion of the site (refer to the description of hydrogeology attached to the alternative closure demonstration letter).

There are no potable industrial, commercial or domestic use water wells in a downgradient or cross-gradient groundwater flow direction relative to the Edwards Ash Pond that are at risk of impacts from a release. In addition, there are no surface water intakes on the Illinois River within 2,500 feet of the Edwards property line.

Since there have been no SSLs above the GWPS, there is no risk to ecological receptors located near the Edwards Ash Pond. If a release to groundwater were to occur, ecological receptors could potentially be exposed to COPCs through ingestion or direct contact with impacted groundwater; however, should any surface water or sediment come into contact with impacted groundwater, the risk of exposure is likely low due to expected attenuation and dilution. Depending on the magnitude of the release and other factors, it may or may not be possible to estimate potential increases in COPC concentrations in surface water using mixing calculations.

Although current conditions do not pose a risk concern to human health or the environment, measures presented in the Contaminant Plume Containment Plan (Section 3.1 of this RMP) would address any future potential exposures and risks by containing potential groundwater impacts and mitigating impacts to potential receptors.

If one or more Appendix IV parameters are detected and confirmed in groundwater at a SSL above GWPS(s), and the SSL is not attributed to an alternate source, via an alternate source demonstration (ASD), the first steps to mitigating risk will involve the immediate implementation of source control, which, if necessary, could include installation and operation of a groundwater extraction well or recovery trench system. This immediate source control would allow for capture of impacted groundwater and prevention of further plume migration towards the principal potential receptors. Furthermore, to characterize the nature and extent of the release, plume delineation wells will be installed as necessary to define the magnitude and limits of the groundwater impacts.

Exposure Mitigation

Mitigation of future potential exposures to groundwater contamination from continued operation of the Edwards Ash Pond is discussed in detail in the following section.

3 CONTAMINANT PLUME CONTAINMENT: OPTIONS EVALUATION AND PLAN- 40 C.F.R. § 257.101(F)(2)(v)(B)(3)

Appropriate corrective measure(s) to address future potential impacted groundwater associated with the Edwards Ash Pond are based on impacts to the Uppermost Aquifer. The Uppermost Aquifer consists of unconfined clays and silts of the Upper Cahokia, where saturated, and the thin, moderate permeability sands and gravels of the Lower Cahokia Formation which at some locations also includes the bedrock interface. The thickness of the sand and gravel unit was measured up to 4 feet within a bedrock channel, although the sand and gravel is not laterally continuous. The unlithified deposits are underlain by Pennsylvanian age bedrock, much of which is shale, of the Carbondale Formation. The top of rock was described as shale, siltstone, and shaley limestone based on borings which were advanced to rock (refer to the description of hydrogeology attached to the alternative closure demonstration letter).

If one or more Appendix IV parameters are detected and confirmed in groundwater at a SSL above GWPS(s), and the SSL is not attributed to an alternate source, via an alternate source demonstration (ASD), the first steps to mitigating risk will involve the immediate implementation of source control, which, if necessary, could include installation and operation of a groundwater extraction well or recovery trench system. This immediate source control would allow for capture of impacted groundwater and prevention of further plume migration towards the principal potential receptors. Furthermore, to characterize the nature and extent of the release, plume delineation wells will be installed as necessary to define the magnitude and limits of the groundwater impacts. If applicable, notifications will be made to all persons who own the land or reside on the land that directly overlies any part of the groundwater plume. Additional soil and

groundwater data will be collected as necessary to support a Corrective Measures Assessment (CMA), which will be initiated within 90 days of detecting the SSL. Further discussion of short-term and long-term corrective measures is further discussed in Section 3.1.

Since there has been no release of Appendix IV parameters to groundwater above GWPS(s), which would trigger a CMA under 40 C.F.R. § 257.96 based on specific parameter concentrations and contaminant plume dimensions, several options are evaluated to address potential future plume containments. The evaluation criteria for assessing remedial options are the following: performance; reliability; ease of implementation; potential impacts of the remedies (safety, cross-media, and control of exposure to residual contamination); time required to begin and complete the remedy; and, institutional requirements that may substantially affect implementation of the remedy(s), such as permitting, environmental or public health requirements.

Although future potential source control measures (e.g. closure in place, closure by removal to on-site or off-site landfill, in-situ solidification/stabilization) to mitigate groundwater impacts are typically considered as part of a CMA process upon closure of the Edwards Ash Pond, the shorter-term options considered for mitigating groundwater impacts relative to a potential future release of one or more Appendix IV parameters at Edwards are as follows:

- Groundwater Extraction
- Groundwater Cutoff Wall
- Permeable Reactive Barrier
- In-Situ Chemical Treatment
- Monitored Natural Attenuation (MNA)

These same groundwater remedial corrective measures will be evaluated for all Appendix IV constituents that present a future risk to human health or the environment.

Groundwater Extraction

This corrective measure includes installation of one or more groundwater pumping wells or trenches to control and extract impacted groundwater. Groundwater extraction captures and contains impacted groundwater and can limit plume expansion and/or off-site migration. Construction of a groundwater extraction system typically includes, but is not limited to, the following primary project components:

- Designing and constructing a groundwater extraction system consisting of a series of extraction wells or trenches located around the perimeter of the contaminant plume and operating at a rate to allow capture of CCR impacted groundwater.
- Designing a system to manage extracted groundwater, which may include modification to the existing NPDES permit, including treatment prior to discharge, if necessary.
- Ongoing inspection and maintenance of the groundwater extraction system.

Installation of a groundwater extraction system, whether wells or trenches, can be expedited with the assumption that there is a good conceptual site model (CSM) of the hydrogeological system around the CCR unit, groundwater flow and transport model, and aquifer testing. Upon notification of an SSL exceedance of a GWPS for one or more Appendix IV parameters, an aquifer test will be conducted, and groundwater model developed for designing a groundwater extraction system for optimization of contaminant plume capture.

A schematic of a typical groundwater extraction well is shown on Figure 2. Based on site specific hydrogeology and future potential plume width and depth, a groundwater extraction system would likely consist of one to three extraction wells with pitless adapter's manifolded together with HDPE conveyance pipe to a common tank or lined collection vault prior to treatment at the on-site wastewater treatment plant and discharge via the NPDES permitted outfall.

Groundwater Cutoff Wall

Vertical cutoff walls are used to control and/or isolate impacted groundwater. Low permeability cutoff walls can be used to prevent horizontal off-site migration of potentially impacted groundwater. Cutoff walls act as barriers to migration of impacted groundwater and can isolate soils that have been impacted by CCR to prevent contact with unimpacted groundwater. Cutoff walls are often used in conjunction with an interior pumping system to establish a reverse gradient within the cutoff wall. The reverse gradient imparted by the pumping system maintains an inward flow through the wall, keeping it from acting as a groundwater dam and controlling potential end-around or breakout flow of contaminated groundwater.

A commonly used cutoff wall construction technology is the slurry trench method, which consists of excavating a trench and backfilling it with a soil-bentonite mixture, often created with the soils excavated from the trench. The trench is temporarily supported with bentonite slurry that is pumped into the trench as it is excavated. Excavation for cutoff walls is conducted with conventional hydraulic excavators, hydraulic excavators equipped with specialized booms to extend their reach (*i.e.*, long-stick excavators), or chisels and clamshells, depending upon the depth of the trench and the material to be excavated.

Permeable Reactive Barrier

Chemical treatment via a Permeable Reactive Barrier (PRB) is defined as an emplacement of reactive materials in the subsurface designed to intercept a contaminant plume, provide a flow path through the reactive media, and transform or otherwise render the contaminant(s) into environmentally acceptable forms to attain remediation concentration goals downgradient of the barrier (EPRI, 2006).

As groundwater passes through the PRB under natural gradients, dissolved constituents in the groundwater react with the media and are transformed or immobilized. A variety of media have been used or proposed for use in PRBs. Zero-valent iron has been shown to effectively immobilize CCR constituents, including arsenic, chromium, cobalt, molybdenum, selenium and sulfate. Zero-valent iron has not been proven effective for boron, antimony, or lithium (EPRI, 2006).

System configurations include continuous PRBs, in which the reactive media extends across the entire path of the contaminant plume; and funnel-and-gate systems, where barrier walls are installed to control groundwater flow through a permeable gate containing the reactive media. Continuous PRBs intersect the entire contaminant plume and do not materially impact the groundwater flow system. Design may or may not include keying the PRB into a low-permeability unit at depth. Funnel-and-gate systems utilize a system of barriers to groundwater flow (funnels) to direct the contaminant plume through the reactive gate. The barriers, typically some form of cutoff wall, are keyed into a low-permeability unit at depth to prevent short circuiting of the plume. Funnel-and-gate design must consider the residence time to allow chemical reactions to occur. Directing the contaminant plume through the reactive gate can significantly increase the flow velocity, thus reducing residence time.

Design of PRB systems requires rigorous site investigation to characterize the site hydrogeology and to delineate the contaminant plume. A thorough understanding of the geochemical and redox characteristics

of the plume is critical to assess the feasibility of the process and select appropriate reactive media. Laboratory studies, including batch studies and column studies using samples of site groundwater, are needed to determine the effectiveness of the selected reactive media at the site (EPRI, 2006).

This is a potential viable option for groundwater corrective measures, to be evaluated further, but is not a short-term solution that can be implemented expeditiously.

In-Situ Chemical Treatment

In-situ chemical treatment for inorganics are being tested and applied with increasing frequency. In-situ chemical treatment includes the targeted injection of reactive media into the subsurface to mitigate groundwater impacts. Inorganic contaminants are typically remediated through immobilization by reduction or oxidation followed by precipitation or adsorption (EPRI, 2006). Chemical reactants that have been applied or are in development for application in treating inorganic contaminants include ferrous sulfate, nanoscale zero-valent iron, organo-phosphorus nutrient mixture (PrecipiPHOS™) and sodium dithionite (EPRI, 2006). Zero-valent iron has been shown to effectively immobilize cobalt and molybdenum. Implementation of in-situ chemical treatment requires detailed technical analysis of field hydrogeological and geochemical conditions along with laboratory studies.

This is a potential viable option for groundwater corrective measures, to be evaluated further, but is not a short-term solution that can be implemented expeditiously.

Monitored Natural Attenuation (MNA)

Upon notification of a release of one or more Appendix IV constituent(s) to groundwater, MNA will be evaluated with site-specific characterization data and geochemical analysis as a long term remedial option, combined with source control measures, through application of the USEPA's tiered approach to MNA (USEPA 1999, 2007 and 2015):

1. Demonstrate that the area of groundwater impacts is not expanding.
2. Determine the mechanisms and rates of attenuation.
3. Determine that the capacity of the aquifer is sufficient to attenuate the mass of constituents in groundwater and that the immobilized constituents are stable and will not remobilize.
4. Design a performance monitoring program based on the mechanisms of attenuation and establish contingency remedies (tailored to site-specific conditions) should MNA not perform adequately.

MNA is not regarded as a short-term remedial option for contaminant plume containment, but as a potential long-term option following implementation of shorter term control measures.

3.1 CONTAINMENT PLAN

Based on the options evaluated for containment of a future potential groundwater contaminant plume originating from the Edwards Ash Pond for one or more Appendix IV constituents exceeding their GWPS(s), the most viable short-term option of those evaluated is a groundwater extraction or recovery trench system, which would allow for capture of impacted groundwater and prevention of further plume migration towards the principal potential receptor, which has been identified as the Illinois River.

In circumstances where there is not an immediate concern of endangerment to human health or the environment, other longer-term corrective measures may be more viable and will be further evaluated at the Edwards Ash Pond.

Depending on the location, depth, and plume geometry of any future potential Appendix IV exceedances of GWPSs, the specific constituent(s) with exceedances, and distance from potential receptors, the other groundwater corrective measures discussed as part of the corrective options evaluation – groundwater cutoff wall, permeable reactive barrier, in-situ chemical treatment, and MNA – are all secondary remedial alternatives available for consideration following the current primary option of groundwater extraction for short-term application.

4 REFERENCES

Electric Power Research Institute (EPRI), 2006. Groundwater Remediation of Inorganic Constituents at Coal Combustion Product Management Sites, Overview of Technologies, Focusing on Permeable Reactive Barriers. Electric Power Research Institute, Palo Alto, California. Final Report 1012584, October 2006.

Ramboll, 2020. 2019 Annual Groundwater Monitoring and Corrective Action Report, Edwards Ash Pond, Edwards Power Station. January 31, 2020.

USEPA, 1999. Use of Monitored Natural Attenuation at Superfund, RCRA Corrective Action, and Underground Storage Tank Sites. Directive No. 9200.U-17P. Washington, D.C.: EPA, Office of Solid Waste and Emergency Response.

USEPA, 2007. Monitored Natural Attenuation of Inorganic Contaminants in Ground Water, Volume 1 – Technical Basis for Assessment. EPA/600/R-07/139. National Risk Management Research Laboratory, Office of Research and Development, U.S. Environmental Protection Agency, Cincinnati, Ohio. October 2007.

USEPA, 2015. Use of Monitored Natural Attenuation for Inorganic Contaminants in Groundwater at Superfund Sites. Directive No. 9283.1-36. U.S. Environmental Protection Agency, Office of Solid Waste and Emergency Response. August 2015.

TABLES

Table 1 - Assessment Monitoring Program Summary, Edwards Ash Pond

Sampling Dates	Analytical Data Receipt Date	Parameters Collected	SSL(s) Appendix IV	SSL(s) Determination Date	ASD Completion Date	CMA Completion / Status
May 5-7 and 29, 2018	July 9, 2018	Appendix III Appendix IV	NA	NA	NA	NA
July 27, August 24, 27, 2018	October 8, 2018	Appendix III Appendix IV Detected ¹	None	January 7, 2019	NA	NA
February 27, 2019	April 15, 2019	Appendix III Appendix IV	None	July 15, 2019	NA	NA
August 6, 2019	October 15, 2019	Appendix III Appendix IV Detected ¹	None	January 13, 2020	NA	NA
February 27-28, 2020	April 15, 2020	Appendix III Appendix IV Detected	None	July 14, 2020	NA	NA

[O: RAB 9/11/20; C: EJT 9/14/20]

Notes:


CMA = Corrective Measures Assessment

NA = Not Applicable





1. Groundwater sample analysis was limited to Appendix IV parameters detected in previous events in accordance with 40 C.F.R. Part 257.95(d)(1).

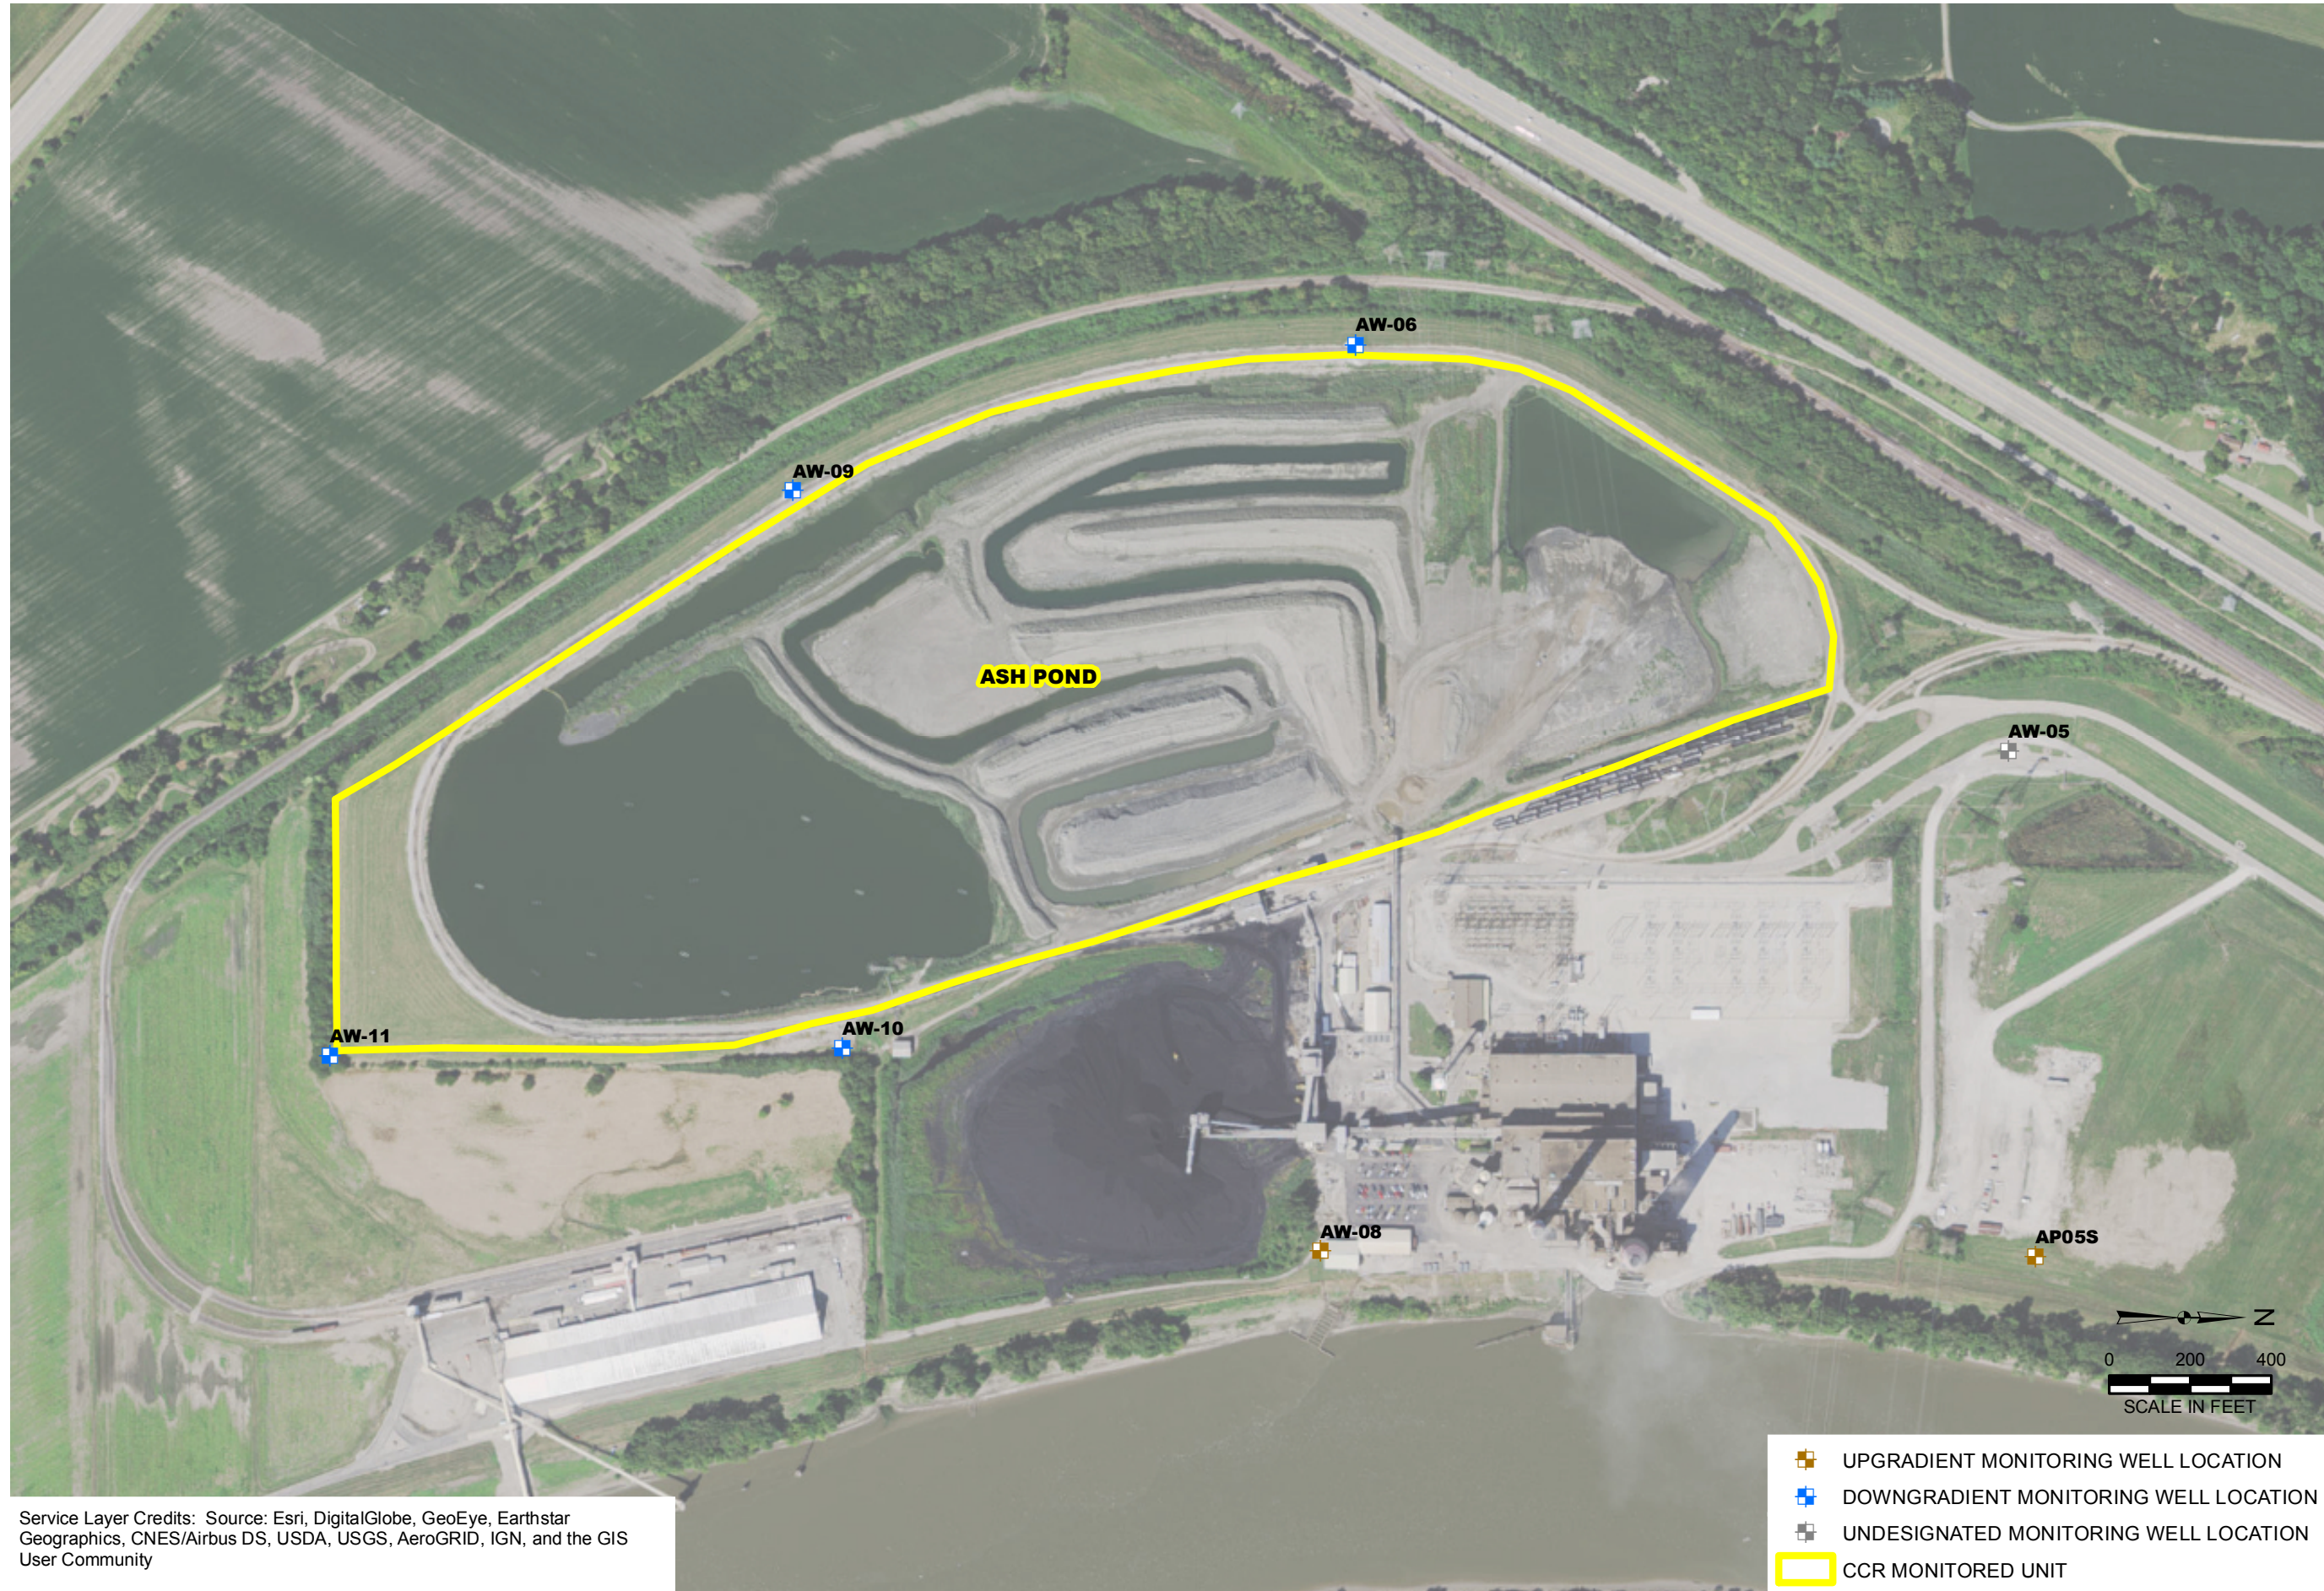FIGURES

Y:\Mapping\Projects\22285\MXD\SAP\Revised\Figure 1_Site and Well Location Map - Edwards Ash Pond_170908.mxd Author: stajscd Date/Time: 9/12/2017, 4:25:48 PM



Service Layer Credits: Source: Esri, DigitalGlobe, GeoEye, Earthstar Geographics, CNES/Airbus DS, USDA, USGS, AeroGRID, IGN, and the GIS User Community

-  UPGRADIENT MONITORING WELL LOCATION
-  DOWNGRADIENT MONITORING WELL LOCATION
-  UNDESIGNATED MONITORING WELL LOCATION
-  CCR MONITORED UNIT

DRAWN BY/DATE:
SDS 9/8/17
REVIEWED BY/DATE:
YAD 9/8/17
APPROVED BY/DATE:
SJC 9/12/17


SITE AND WELL LOCATION MAP
EDWARDS ASH POND
UNIT ID: 301

SAMPLING AND ANALYSIS PLAN
DYNEGY CCR RULE GROUNDWATER MONITORING
EDWARDS POWER STATION
BARTONSVILLE, ILLINOIS

PROJECT NO: 2285/4.3

FIGURE NO: 1



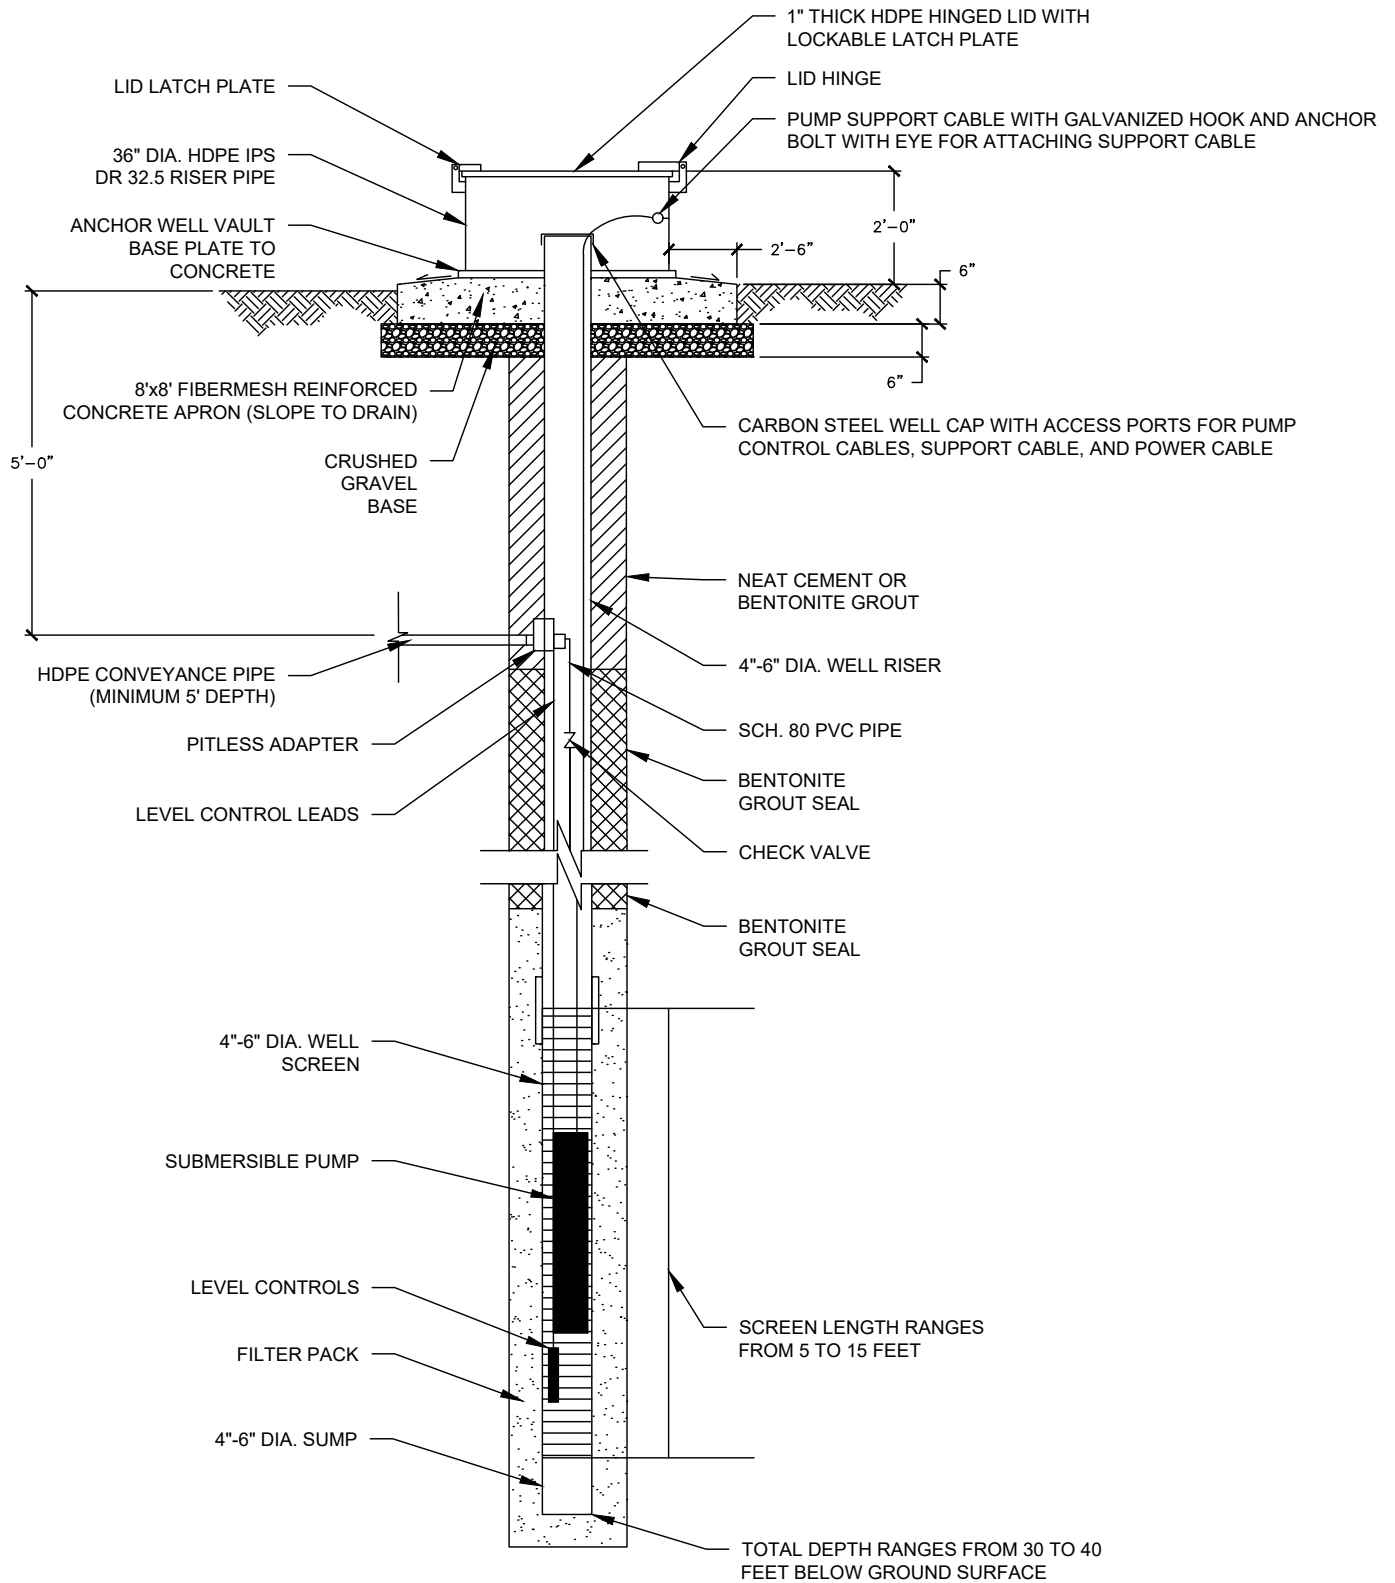

NOTES
 1. NOT TO SCALE

TYPICAL HYDRAULIC GRADIENT CONTROL WELL DETAIL

FIGURE 2

ATTACHMENT 1

Prepared for

Illinois Power Resources Generating, LLC

Document type

2019 Annual Groundwater Monitoring and Corrective Action Report

Date

January 31, 2020

2019 ANNUAL GROUNDWATER MONITORING AND CORRECTIVE ACTION REPORT

EDWARDS ASH POND, EDWARDS POWER STATION



Bright ideas. Sustainable change.

**2019 ANNUAL GROUNDWATER MONITORING AND
CORRECTIVE ACTION REPORT
EDWARDS ASH POND, EDWARDS POWER STATION**

Project name **Edwards Power Station**
Project no. **72754**
Recipient **Illinois Power Resources Generating, LLC**
Document type **Annual Groundwater Monitoring and Corrective Action Report**
Version **FINAL**
Date **January 31, 2020**
Prepared by **Kristen L. Theesfeld**
Checked by **Nathaniel R. Keller**
Approved by **Eric J. Tlachac**
Description **Annual Report in Support of the CCR Rule Groundwater Monitoring Program**

Ramboll
234 W. Florida Street
Fifth Floor
Milwaukee, WI 53204
USA

T 414-837-3607
F 414-837-3608
<https://ramboll.com>



Kristen L. Theesfeld
Hydrogeologist



Nathaniel R. Keller
Senior Hydrogeologist

CONTENTS

EXECUTIVE SUMMARY	3
1. Introduction	4
2. Monitoring and Corrective Action Program Status	5
3. Key Actions Completed in 2019	6
4. Problems Encountered and Actions to Resolve the Problems	8
5. Key Activities Planned for 2020	9
6. References	10

TABLES

Table A	2018-2019 Assessment Monitoring Program Summary (in text)
Table 1	2019 Analytical Results – Groundwater Elevation and Appendix III Parameters
Table 2	2019 Analytical Results – Appendix IV Parameters
Table 3	Statistical Background Values
Table 4	Groundwater Protection Standards

FIGURES

Figure 1	Monitoring Well Location Map
----------	------------------------------

ACRONYMS AND ABBREVIATIONS

AP	Ash Pond
CCR	Coal Combustion Residuals
GWPS	Groundwater Protection Standard
SAP	Sampling and Analysis Plan
SSL	Statistically Significant Level

EXECUTIVE SUMMARY

This report has been prepared to provide the information required by Title 40 of the Code of Federal Regulations (40 C.F.R.) § 257.90(e) for Edwards Ash Pond (AP) located at Edwards Power Station near Bartonville, Illinois.

Groundwater is being monitored at Edwards AP in accordance with the Assessment Monitoring Program requirements specified in 40 C.F.R. § 257.95.

No changes were made to the monitoring system in 2019 (no wells were installed or decommissioned).

No Statistically Significant Levels (SSLs) of 40 C.F.R. Part 257 Appendix IV parameters were determined in 2019 and Edwards AP remains in the Assessment Monitoring Program.

1. INTRODUCTION

This report has been prepared by Ramboll on behalf of Illinois Power Resources Generating, LLC, to provide the information required by 40 C.F.R. § 257.90(e) for Edwards AP located at Edwards Power Station near Bartonville, Illinois.

In accordance with 40 C.F.R. § 257.90(e), the owner or operator of a Coal Combustion Residuals (CCR) unit must prepare an Annual Groundwater Monitoring and Corrective Action Report for the preceding calendar year that documents the status of the Groundwater Monitoring and Corrective Action Program for the CCR unit, summarizes key actions completed, describes any problems encountered, discusses actions to resolve the problems, and projects key activities for the upcoming year. At a minimum, the Annual Report must contain the following information, to the extent available:

1. A map, aerial image, or diagram showing the CCR unit and all background (or upgradient) and downgradient monitoring wells, to include the well identification numbers, that are part of the groundwater monitoring program for the CCR unit.
2. Identification of any monitoring wells that were installed or decommissioned during the preceding year, along with a narrative description of why those actions were taken.
3. In addition to all the monitoring data obtained under §§ 257.90 through 257.98, a summary including the number of groundwater samples that were collected for analysis for each background and downgradient well, the dates the samples were collected, and whether the sample was required by the Detection Monitoring or Assessment Monitoring Programs.
4. A narrative discussion of any transition between monitoring programs (e.g., the date and circumstances for transitioning from Detection Monitoring to Assessment Monitoring in addition to identifying the constituent(s) detected at a Statistically Significant Increase relative to background levels).
5. Other information required to be included in the Annual Report as specified in §§ 257.90 through 257.98.

This report provides the required information for Edwards AP for calendar year 2019.

2. MONITORING AND CORRECTIVE ACTION PROGRAM STATUS

No changes have occurred to the Monitoring Program status in calendar year 2019, and Edwards AP remains in the Assessment Monitoring Program in accordance with 40 C.F.R. § 257.95.

3. KEY ACTIONS COMPLETED IN 2019

The Assessment Monitoring Program is summarized in Table A. The groundwater monitoring system, including the CCR unit and all background and downgradient monitoring wells is presented in Figure 1. No changes were made to the monitoring system in 2019 (no wells were installed or decommissioned). In general, one groundwater sample was collected from each background and downgradient well during each monitoring event. All samples were collected and analyzed in accordance with the Sampling and Analysis Plan (SAP) (NRT/OBG, 2017a). All monitoring data obtained under 40 C.F.R. §§ 257.90 through 257.98 (as applicable) in 2019 are presented in Tables 1 and 2. Analytical data were evaluated in accordance with the Statistical Analysis Plan (NRT/OBG, 2017b) to determine any SSLs of Appendix IV parameters over Groundwater Protection Standards (GWPSs).

Statistical background values are provided in Table 3 and GWPSs in Table 4.

Analytical results for the May and June/July 2018 sampling events were provided in the 2018 Annual Groundwater Monitoring and Corrective Action Report.

Table A – 2018-2019 Assessment Monitoring Program Summary

Sampling Dates	Analytical Data Receipt Date	Parameters Collected	SSL(s)	SSL(s) Determination Date
May 5-7 and 29, 2018	October 10, 2018	Appendix III Appendix IV	NA	NA
July 27 - August 27, 2018	October 10, 2018	Appendix III Appendix IV Detected ¹	None	January 7, 2019
February 27, 2019	April 15, 2019	Appendix III Appendix IV	None	July 15, 2019
August 6, 2019	October 15, 2019	Appendix III Appendix IV Detected ¹	NA	TBD

Notes:

NA: Not Applicable

TBD: To Be Determined

1. Groundwater sample analysis was limited to Appendix IV parameters detected in previous events in accordance with 40 C.F.R. § 257.95(d)(1).

4. PROBLEMS ENCOUNTERED AND ACTIONS TO RESOLVE THE PROBLEMS

No problems were encountered with the Groundwater Monitoring Program during 2019. Groundwater samples were collected and analyzed in accordance with the SAP (NRT/OBG, 2017a), and all data were accepted.

5. KEY ACTIVITIES PLANNED FOR 2020

The following key activities are planned for 2020:

- Continuation of the Assessment Monitoring Program with semi-annual sampling scheduled for the first and third quarters of 2020.
- Complete evaluation of analytical data from the downgradient wells, using GWPSs to determine whether an SSL of Appendix IV parameters has occurred.
- If an SSL is identified, potential alternate sources (i.e., a source other than the CCR unit caused the SSL or that that SSL resulted from error in sampling, analysis, statistical evaluation, or natural variation in groundwater quality) will be evaluated.
 - If an alternate source is demonstrated to be the cause of the SSL, a written demonstration will be completed within 90 days of SSL determination and included in the 2020 Annual Groundwater Monitoring and Corrective Action Report.
 - If an alternate source(s) is not identified to be the cause of the SSL, the applicable requirements of 40 C.F.R. §§ 257.94 through 257.98 (e.g., assessment of corrective measures) as may apply in 2020 will be met, including associated recordkeeping/notifications required by 40 C.F.R. §§ 257.105 through 257.108.

6. REFERENCES

Natural Resource Technology, an OBG Company (NRT/OBG), 2017a. Sampling and Analysis Plan, Edwards Ash Pond, Edwards Power Station, Bartonville, Illinois, Project No. 2285, Revision 0, October 17, 2017.

Natural Resource Technology, an OBG Company (NRT/OBG), 2017b. Statistical Analysis Plan, Duck Creek Power Station, Edwards Power Station, Illinois Power Resources Generating, LLC, October 17, 2017.

TABLES

TABLE 1.
2019 ANALYTICAL RESULTS - GROUNDWATER ELEVATION AND APPENDIX III PARAMETERS
2019 ANNUAL GROUNDWATER MONITORING AND CORRECTIVE ACTION REPORT
EDWARDS POWER STATION
UNIT ID 301 - EDWARDS ASH POND
BARTONVILLE, ILLINOIS
ASSESSMENT MONITORING PROGRAM

Well Identification Number	Latitude (Decimal Degrees)	Longitude (Decimal Degrees)	Date & Time Sampled	Depth to Groundwater (ft) ¹	Groundwater Elevation (ft NAVD88)	40 C.F.R. Part 257 Appendix III						
						Boron, total (mg/L)	Calcium, total (mg/L)	Chloride, total (mg/L)	Fluoride, total (mg/L)	pH (field) (S.U.)	Sulfate, total (mg/L)	Total Dissolved Solids (mg/L)
						6020A ²	6020A ²	9251 ²	9214 ²	SM 4500 H+B ²	9036 ²	SM 2540C ²
Background / Upgradient Monitoring Wells												
AP-05S	40.598814	-89.661916	2/27/2019 10:07	5.50	438.03	0.29	91	40	<0.250	7.1	4.0	880
			8/6/2019 13:16	3.22	440.31	0.24	110	37	<0.250	7.1	<1.0	900
AW-08	40.593964	-89.661996	2/27/2019 7:40	19.50	443.04	0.12	140	17	0.270	7.1	9.6	670
			8/6/2019 14:02	19.74	442.80	0.10	130	19	0.287	7.3	20	700
Downgradient Monitoring Wells												
AW-06	40.594237	-89.670051	2/27/2019 11:09	26.00	435.57	0.13	110	35	0.280	7.3	29	580
			8/6/2019 9:52	27.45	434.12	0.093	120	33	0.393	7.2	29	580
AW-09	40.590422	-89.668777	2/27/2019 8:32	25.74	435.71	0.52	120	29	0.250	7.0	12	780
			8/6/2019 10:41	25.82	435.63	0.20	140	27	<0.250	7.2	<1.0	770
AW-10	40.590733	-89.663826	2/27/2019 13:25	0.94	438.99	0.47	130	85	<0.250	7.2	<1.0	1100
			8/6/2019 14:55	0.92	439.01	0.50	160	100	<0.250	7.3	<1.0	1200
AW-11	40.587261	-89.663781	2/27/2019 12:16	7.62	432.25	0.22	160	30	<0.250	7.2	<1.0	970
			8/6/2019 11:35	7.17	432.70	0.18	160	30	<0.250	7.2	<1.0	980

[O: RAB 12/20/19, C: KLT 12/23/19]

Notes:
40 C.F.R. = Title 40 of the Code of Federal Regulations
ft = foot/feet
mg/L = milligrams per liter
NAVD88 = North American Vertical Datum of 1988
S.U. = Standard Units
< = concentration is less than the concentration shown, which corresponds to the reporting limit for the method; estimated concentrations below the reporting limit and associated qualifiers are not provided since not utilized in statistics to determine Statistically Significant Increases (SSIs) over background.
¹All depths to groundwater were measured on the first day of the sampling event.
²4-digit numbers represent SW-846 analytical methods.

TABLE 2.
2019 ANALYTICAL RESULTS - APPENDIX IV PARAMETERS
2019 ANNUAL GROUNDWATER MONITORING AND CORRECTIVE ACTION REPORT

EDWARDS POWER STATION
UNIT ID 301 - EDWARDS ASH POND
BARTONVILLE, ILLINOIS
ASSESSMENT MONITORING PROGRAM

Well Identification Number	Latitude (Decimal Degrees)	Longitude (Decimal Degrees)	Date & Time Sampled	40 C.F.R. Part 257 Appendix IV															
				Antimony, total (mg/L)	Arsenic, total (mg/L)	Barium, total (mg/L)	Beryllium, total (mg/L)	Cadmium, total (mg/L)	Chromium, total (mg/L)	Cobalt, total (mg/L)	Fluoride, total (mg/L)	Lead, total (mg/L)	Lithium, total (mg/L)	Mercury, total (mg/L)	Molybdenum, total (mg/L)	Radium 226/228, Combined (pCi/L)	Selenium, total (mg/L)	Thallium, total (mg/L)	
				6020A ¹	6020A ¹	6020A ¹	6020A ¹	6020A ¹	6020A ¹	6020A ¹	6020A ¹	6020A ¹	6020A ¹	6020A ¹	7470A ¹	6020A ¹	903/904 ¹	6020A ¹	6020A ¹
Background / Upgradient Monitoring Wells																			
AP-05S	40.598814	-89.661916	2/27/2019 10:07	<0.0030	0.0046	0.87	<0.0010	<0.0010	<0.0040	<0.0020	<0.250	<0.0010	0.020	<0.00020	0.0014	2.30	<0.0010	<0.0010	
			8/6/2019 13:16 ²	NA	0.0067	1.1	<0.0010	NA	<0.0040	<0.0020	<0.250	<0.0010	0.031	NA	<0.0010	3.00	<0.0010	NA	
AW-08	40.593964	-89.661996	2/27/2019 7:40	<0.0030	0.0190	0.22	<0.0010	<0.0010	<0.0040	<0.0020	<0.270	<0.0010	<0.01	<0.00020	0.0049	0.402	<0.0010	<0.0010	
			8/6/2019 14:02 ²	NA	0.0074	0.18	<0.0010	NA	<0.0040	<0.0020	0.287	<0.0010	0.017	NA	0.0037	3.95	<0.0010	NA	
Downgradient Monitoring Wells																			
AW-06	40.594237	-89.670051	2/27/2019 11:09	<0.0030	0.0046	0.18	<0.0010	<0.0010	<0.0040	<0.0020	0.280	0.0013	<0.01	<0.00020	0.0051	0.357	<0.0010	<0.0010	
			8/6/2019 9:52 ²	NA	0.020	0.35	<0.0010	NA	0.024	0.010	0.393	0.011	0.035	NA	0.0055	1.82	0.002	NA	
AW-09	40.590422	-89.668777	2/27/2019 8:32	<0.0030	0.0019	0.22	<0.0010	<0.0010	<0.0040	0.0036	0.250	<0.0010	0.013	<0.00020	0.016	0.771	<0.0010	<0.0010	
			8/6/2019 10:41 ²	NA	0.026	0.54	<0.0010	NA	0.017	0.011	<0.250	0.011	0.036	NA	0.015	1.94	0.0012	NA	
AW-10	40.590733	-89.663826	2/27/2019 13:25	<0.0030	0.012	0.93	<0.0010	<0.0010	<0.0040	0.0037	<0.250	0.0024	0.040	<0.00020	0.028	1.79	<0.0010	<0.0010	
			8/6/2019 14:55 ²	NA	0.019	1.5	0.0014	NA	0.050	0.026	<0.250	0.026	0.12	NA	0.0022	4.08	0.0033	NA	
AW-11	40.587261	-89.663781	2/27/2019 12:16	<0.0030	0.013	0.76	<0.0010	<0.0010	<0.0040	0.0031	<0.250	0.0012	0.017	<0.00020	0.0053	2.33	<0.0010	<0.0010	
			8/6/2019 11:35 ²	NA	0.018	0.88	<0.0010	NA	<0.0040	0.0023	<0.250	<0.0010	0.031	NA	0.0046	1.69	<0.0010	NA	

[O: 12/20/19, C: KLT 12/23/19]

Notes:

40 C.F.R. = Title 40 of the Code of Federal Regulations

mg/L = milligrams per liter

NA = Not Analyzed

pCi/L = picoCuries per liter

< = concentration is less than concentration shown, which corresponds to the reporting limit for the method; estimated concentrations below the reporting limit and associated qualifiers are not provided since not utilized in statistics to determine

Statistically Significant Levels (SSLs) over Groundwater Protection Standards.

¹4-digit numbers represent SW-846 analytical methods and 3-digit numbers represent Clean Water Act analytical methods.

²Only the parameters detected during the previous sampling events were analyzed during this sampling event, in accordance with 40 C.F.R. § 257.95(d)(1).

TABLE 3.
STATISTICAL BACKGROUND VALUES
2019 ANNUAL GROUNDWATER MONITORING AND CORRECTIVE ACTION REPORT
EDWARDS POWER STATION
UNIT ID 301 - EDWARDS ASH POND
BARTONVILLE, ILLINOIS
ASSESSMENT MONITORING PROGRAM

Parameter	Statistical Background Value (UPL)
40 C.F.R. Part 257 Appendix III	
Boron (mg/L)	0.42
Calcium (mg/L)	174
Chloride (mg/L)	44
Fluoride (mg/L)	0.376
pH (S.U.)	6.6 / 7.4
Sulfate (mg/L)	77.7
Total Dissolved Solids (mg/L)	940

[O: RAB 12/20/19, C: KLT 12/23/19]

Notes:

40 C.F.R. = Title 40 of the Code of Federal Regulations
mg/L = milligrams per liter
S.U. = Standard Units
UPL = Upper Prediction Limit

TABLE 4.
GROUNDWATER PROTECTION STANDARDS
2019 ANNUAL GROUNDWATER MONITORING AND CORRECTIVE ACTION REPORT
EDWARDS POWER STATION
UNIT ID 301 - EDWARDS ASH POND
BARTONVILLE, ILLINOIS
ASSESSMENT MONITORING PROGRAM

Parameter	Groundwater Protection Standard ¹
40 C.F.R. Part 257 Appendix IV	
Antimony (mg/L)	0.006
Arsenic (mg/L)	0.019
Barium (mg/L)	2
Beryllium (mg/L)	0.014
Cadmium (mg/L)	0.005
Chromium (mg/L)	0.10
Cobalt (mg/L)	0.006
Fluoride (mg/L)	4
Lead (mg/L)	0.015
Lithium (mg/L)	0.054
Mercury (mg/L)	0.002
Molybdenum (mg/L)	0.10
Radium 226+228 (pCi/L)	5
Selenium (mg/L)	0.05
Thallium (mg/L)	0.002

[O: RAB 12/20/19, C: KLT 12/23/19]

Notes:

40 C.F.R. = Title 40 of the Code of Federal Regulations


mg/L = milligrams per liter

pCi/L = picoCuries per liter

¹Groundwater Protection Standard is the higher of the Maximum Contaminant Level / Health-Based Level or background.

FIGURES

Y:\Mapping\Projects\222285\MXD\2019_AnnualGWM_CAR\Figure 1_GWS_WellLoc_Edwards.mxd
PROJECT: 169000XXXXX | DATED: 1/13/2020 | DESIGNER: GALARNIC

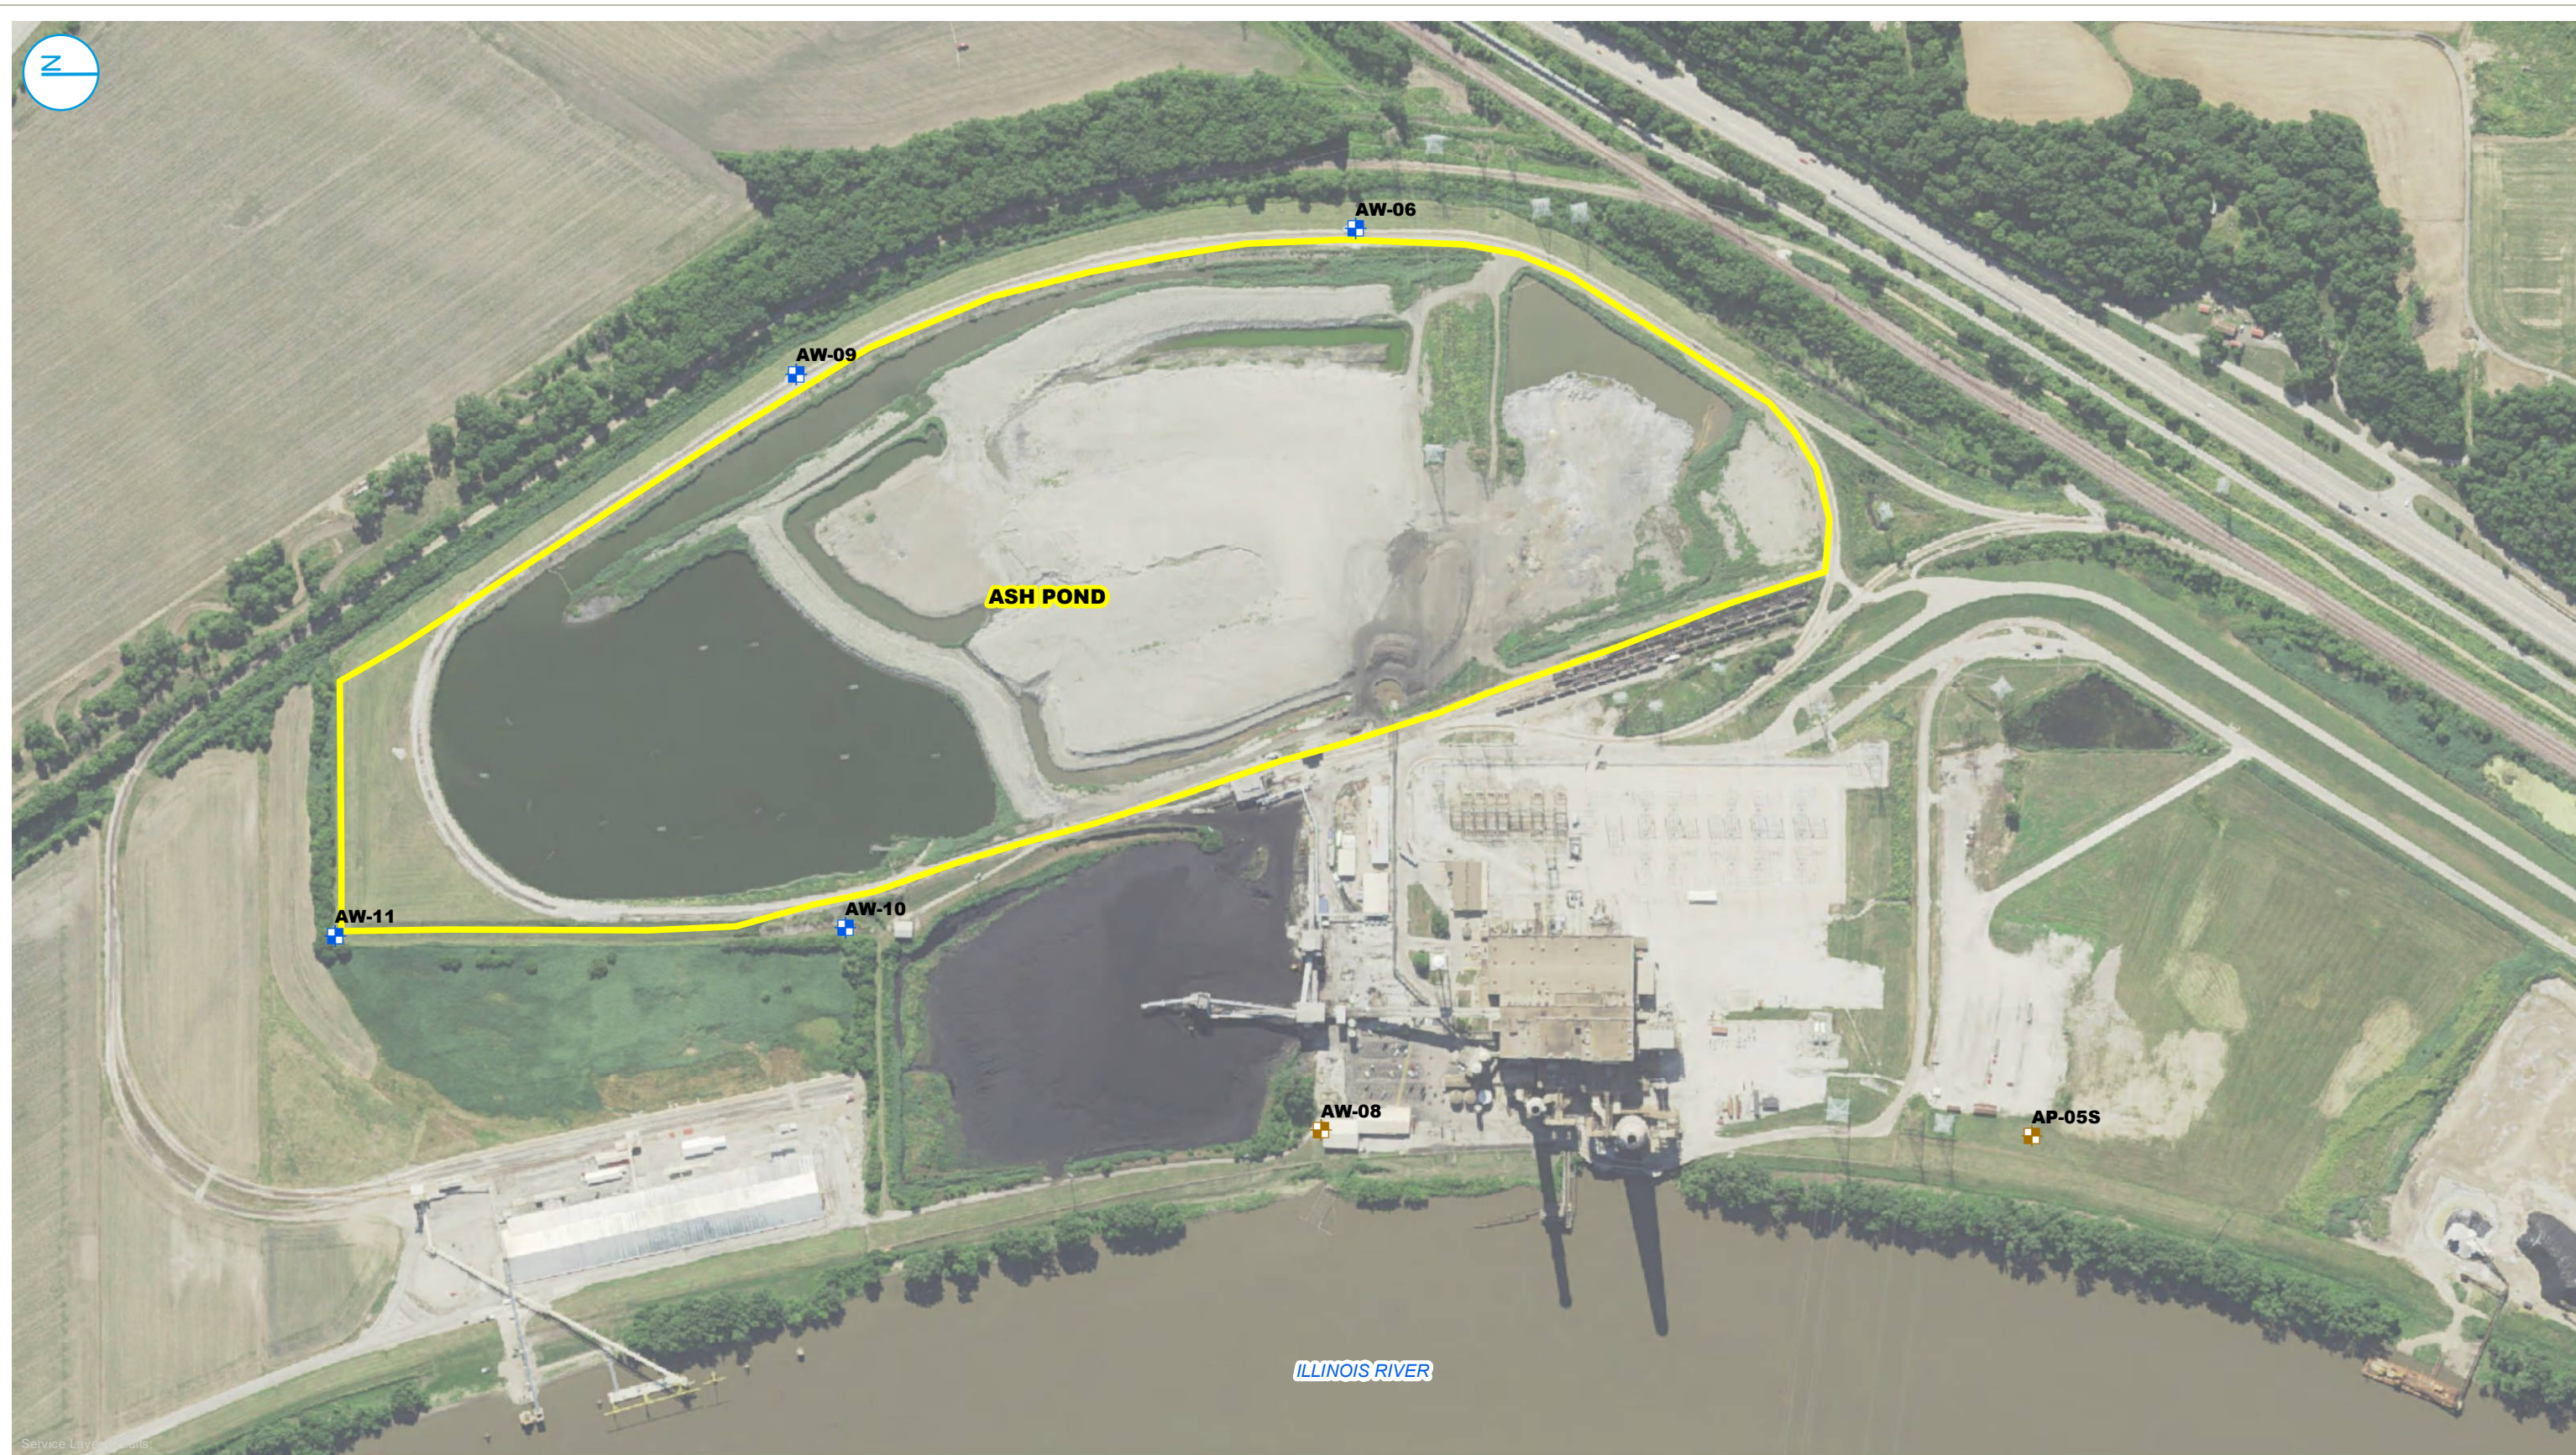

- UPGRADIENT MONITORING WELL LOCATION
- DOWNGRADIENT MONITORING WELL LOCATION
- CCR MONITORED UNIT



**MONITORING WELL LOCATION MAP
EDWARDS ASH POND
UNIT ID:301**

2019 ANNUAL GROUNDWATER MONITORING AND CORRECTIVE ACTION REPORT
VISTRA CCR RULE GROUNDWATER MONITORING
EDWARDS POWER STATION
BARTONVILLE, ILLINOIS


FIGURE 1

O'BRIEN & GERE ENGINEERS, INC.
A RAMBOLL COMPANY





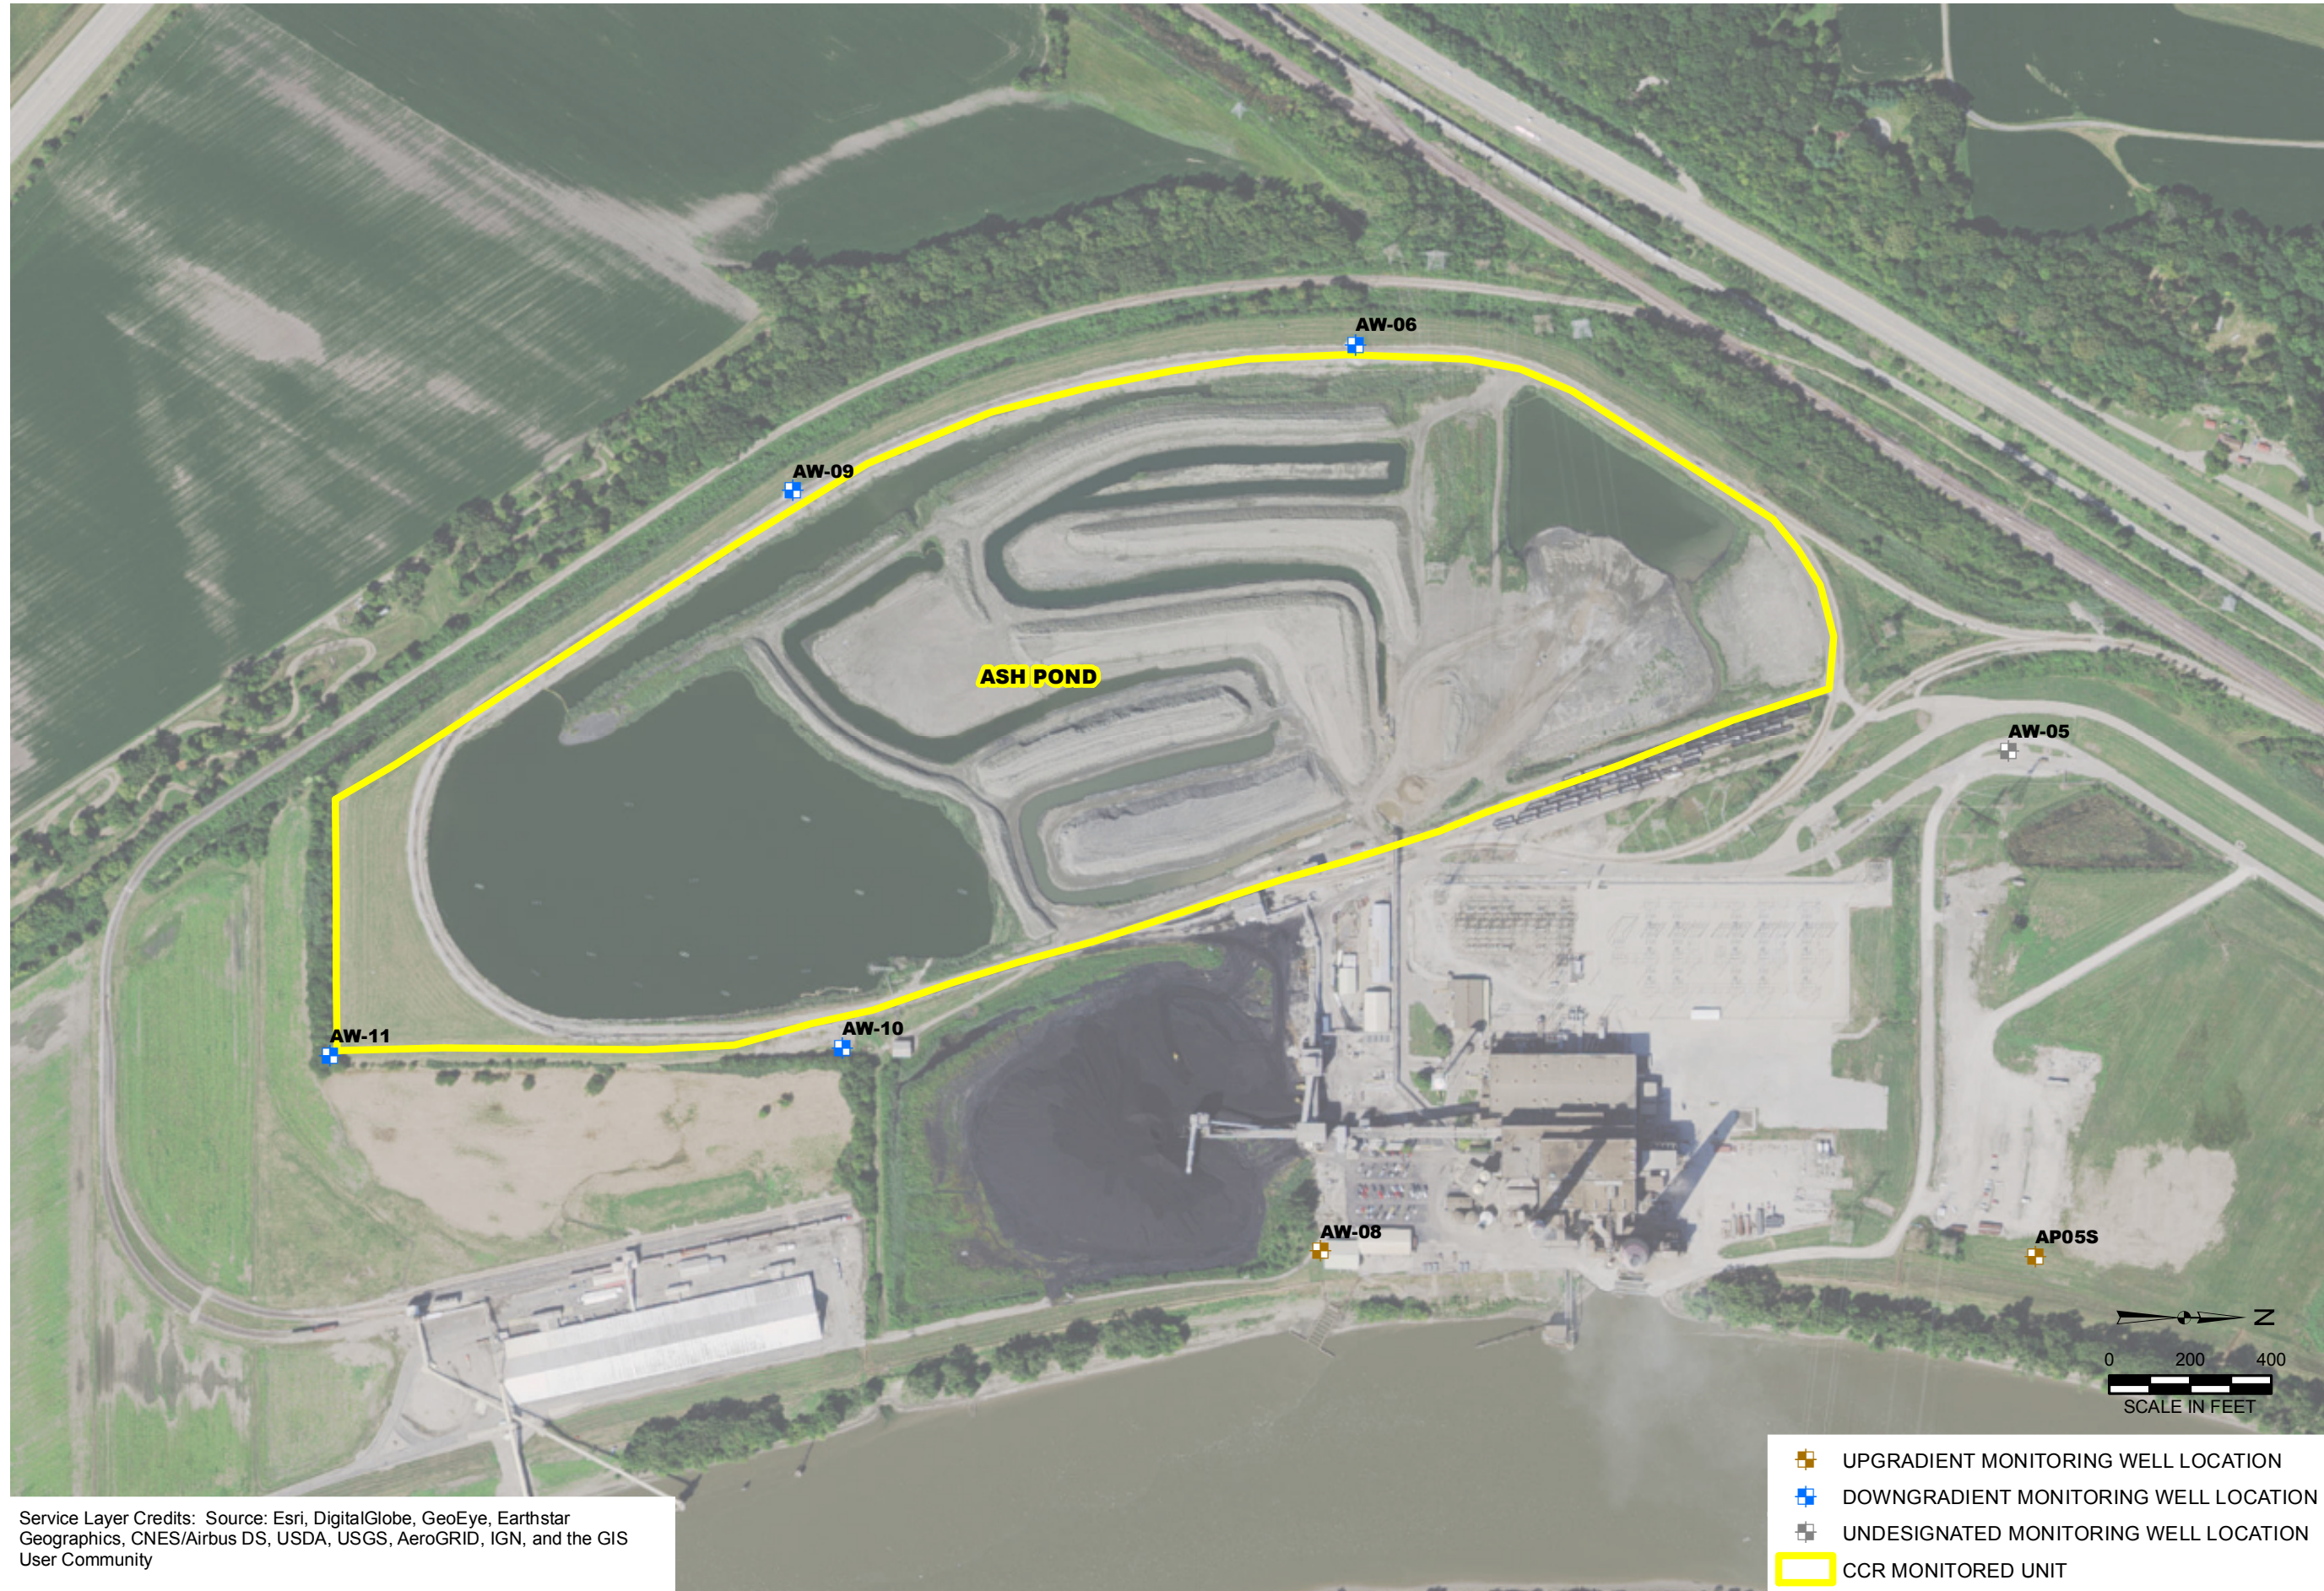

ATTACHMENT 2 – MAP OF GROUNDWATER MONITORING WELL LOCATIONS

Y:\Mapping\Projects\22285\MXD\SAP\Revised\Figure 1_Site and Well Location Map - Edwards Ash Pond_170908.mxd Author: stajscd Date/Time: 9/12/2017, 4:25:48 PM



Service Layer Credits: Source: Esri, DigitalGlobe, GeoEye, Earthstar Geographics, CNES/Airbus DS, USDA, USGS, AeroGRID, IGN, and the GIS User Community

-  UPGRADIENT MONITORING WELL LOCATION
-  DOWNGRADIENT MONITORING WELL LOCATION
-  UNDESIGNATED MONITORING WELL LOCATION
-  CCR MONITORED UNIT

DRAWN BY/DATE:
SDS 9/8/17
REVIEWED BY/DATE:
YAD 9/8/17
APPROVED BY/DATE:
SJC 9/12/17

SITE AND WELL LOCATION MAP
EDWARDS ASH POND
UNIT ID: 301

SAMPLING AND ANALYSIS PLAN
DYNEGY CCR RULE GROUNDWATER MONITORING
EDWARDS POWER STATION
BARTONSVILLE, ILLINOIS

PROJECT NO: 2285/4.3

FIGURE NO: 1



ATTACHMENT 3 – WELL CONSTRUCTION DIAGRAMS AND DRILLING LOGS

FIELD BORING LOG



CLIENT: Natural Resource Technology, Inc.
Site: Edwards Power Station
Location: Bartonville, Illinois
Project: 15E0030
DATES: Start: 7/22/2015
Finish: 7/22/2015
WEATHER: Sunny, warm, mid-70s

CONTRACTOR: Ramsey Geotechnical Engineering, LLC
Rig mfg/model: Diedrich D-50
Drilling Method: 4 1/4" HSA, split spoon sampler
FIELD STAFF: Driller: B. Williamson
Helper: D. Crump
Eng/Geo: S. Keim

BOREHOLE ID: AW-05
Well ID: AW-05
Surface Elev: 440.55 ft. MSL
Completion: 21.10 ft. BGS
Station: 1,432,339.67N
 2,435,498.04E

SAMPLE		TESTING					TOPOGRAPHIC MAP INFORMATION:		WATER LEVEL INFORMATION:		
Number	Recov / Total (in) % Recovery	Type	Blows / 6 in N - Value RQD	Moisture (%)	Dry Den. (lb/ft ³)	Q _u (tsf) / Q _p (tsf) Failure Type	Depth ft. BGS	Lithologic Description	Borehole Detail	Elevation ft. MSL	Remarks
1A	16/24 67%	ss	2-3 2-7 N=5	20		2.00	0	Black (10YR2/1), moist, medium, SILT with few clay and trace very fine- to fine-grained sand, roots.		440	
							2	FILL - Dark yellowish brown (10YR4/4), moist, stiff, SILT with few clay and trace very fine- to fine-grained sand.			
2A	17/24 71%	ss	5-7 7-7 N=14	21		2.00	4	FILL - Very dark grayish brown (10YR3/2), moist, stiff, silty CLAY with trace very fine-grained sand.		438	
3A	18/24 75%	ss	2-2 2-2 N=4	23		0.80	6	Dark grayish brown (10YR4/2) with 5% dark yellowish brown (10YR4/6) mottles, moist, medium, silty CLAY with trace fine-grained sand.		436	
4A	16/24 67%	ss	2-2 2-2 N=4	22		0.30	8	Brown (10YR5/3) with 5% gray (10YR5/1) mottles, moist, soft, CLAY with very fine- to fine-grained sand.		434	
5A	18/24 75%	ss	2-1 3-2 N=4	31		1.10	10	Gray (10YR5/1) with 15% dark yellowish brown (10YR3/4) mottles, moist, stiff, silty CLAY with trace very fine- to fine-grained sand.		432	
6A	22/24 92%	ss	1-1 2-2 N=3	31		0.50	12	Gray (10YR5/1) with 15% dark yellowish brown (10YR3/4) mottles, moist, soft, silty CLAY with trace very fine- to fine-grained sand.		430	
7A	24/24 100%	ss	2-2 1-1 N=3	52		0.20	14	Gray (10YR5/1) with 10% yellowish brown (10YR5/6) mottles, moist, soft, silty CLAY with trace coarse-grained sand.		428	
8-1							16			426	
8-2	24/24 100%	sh					16			426	
8-3							16			426	
8-4						0.80	16			426	
9A	24/24 100%	ss	1-2 2-4 N=4	32		0.30	18	Dark gray (10YR4/1), moist, medium, silty CLAY with trace very fine-grained sand.		424	
10A	18/24 75%	ss	1-1 3-14 N=4	39		0.30	20	Dark gray (10YR4/1), moist, hard, weathered SHALE.		422	

NOTE(S): AW-05 installed in bore hole.

FIELD BORING LOG



CLIENT: Natural Resource Technology, Inc.
Site: Edwards Power Station
Location: Bartonville, Illinois
Project: 15E0030
DATES: Start: 7/22/2015
Finish: 7/22/2015
WEATHER: Sunny, warm, mid-70s

CONTRACTOR: Ramsey Geotechnical Engineering, LLC
Rig mfg/model: Diedrich D-50
Drilling Method: 4 1/4" HSA, split spoon sampler
FIELD STAFF: Driller: B. Williamson
Helper: D. Crump
Eng/Geo: S. Keim

BOREHOLE ID: AW-05
Well ID: AW-05
Surface Elev: 440.55 ft. MSL
Completion: 21.10 ft. BGS
Station: 1,432,339.67N
 2,435,498.04E

SAMPLE			TESTING				TOPOGRAPHIC MAP INFORMATION:		WATER LEVEL INFORMATION:		
Number	Recov / Total (in) % Recovery	Type	Blows / 6 in N - Value RQD	Moisture (%)	Dry Den. (lb/ft ³)	Qu (tsf) Qp (tsf) Failure Type	Depth ft. BGS	Lithologic Description	Borehole Detail	Elevation ft. MSL	Remarks
	0/5 0%	ss	50/5"					Dark gray (10YR4/1), moist, hard, weathered SHALE. <i>[Continued from previous page]</i>		420	
End of boring = 21.10 feet											

NOTE(S): AW-05 installed in bore hole.

FIELD BORING LOG



CLIENT: Natural Resource Technology, Inc.
Site: Edwards Power Station
Location: Bartonville, Illinois
Project: 15E0030
DATES: Start: 7/29/2015
Finish: 8/3/2015
WEATHER: Sunny, warm, hi-80s

CONTRACTOR: Ramsey Geotechnical Engineering, LLC
Rig mfg/model: Diedrich D-50
Drilling Method: 4 1/4" HSA, split spoon sampler
FIELD STAFF: Driller: B. Williamson
Helper: D. Crump
Eng/Geo: S. Keim

BOREHOLE ID: AW-06
Well ID: AW-06
Surface Elev: 459.19 ft. MSL
Completion: 42.25 ft. BGS
Station: 1,430,727.75N
 2,434,495.33E

SAMPLE		TESTING					TOPOGRAPHIC MAP INFORMATION:		WATER LEVEL INFORMATION:		
Number	Recov / Total (in) % Recovery	Type	Blows / 6 in N - Value RQD	Moisture (%)	Dry Den. (lb/ft ³)	Q _u (tsf) Q _p (tsf) Failure Type	Depth ft. BGS	Lithologic Description	Borehole Detail	Elevation ft. MSL	Remarks
	24/24 100%	BD						GRAVEL FILL		458	
2A	24/24 100%	BD		24			2	FILL - Dark gray (10YR4/1) and brown (10YR4/3), moist, medium, silty CLAY with trace medium- to coarse-grained sand.		456	sample from cuttings
3A	14/24 58%	SS	4-6 29-23 N=35	23			4	FILL - Very dark gray (10YR3/1), moist, hard, FLY ASH.		454	
4A	21/24 88%	SS	14-18 21-26 N=39	29			6			452	
5A	20/24 83%	SS	7-7 6-4 N=13	37			8	FILL - Very dark gray (10YR3/1), moist, medium, FLY ASH.		450	
6A	18/24 75%	SS	1-1 3-3 N=4	26			10	FILL - Very dark gray (10YR3/1), moist, soft, FLY ASH.		448	
7A	17/24 71%	SS	2-3 4-5 N=7	22	1.30		12	FILL - Dark gray (10YR4/1), moist, medium, SILT and FLY ASH with few clay and trace coarse-grained sand and small gravel.		446	
8A	14/24 58%	SS	1-1 3-3 N=4	22	0.50		14	Gray (10YR5/1) and brown (10YR5/3), moist, medium, SILT with few clay and trace medium- to coarse-grained sand and roots.		444	
9A	17/24 71%	SS	4-6 5-6 N=11	23	0.70		16			442	
10A	22/24 92%	SS	2-2 3-4 N=5	21	1.30		18	Very dark grayish brown (10YR3/2), moist, stiff, silty CLAY with trace very fine- to fine-grained sand.		440	

NOTE(S): AW-06 installed in bore hole. Well was constructed using a pre-packed screen.

FIELD BORING LOG



CLIENT: Natural Resource Technology, Inc.
Site: Edwards Power Station
Location: Bartonville, Illinois
Project: 15E0030
DATES: Start: 7/29/2015
Finish: 8/3/2015
WEATHER: Sunny, warm, hi-80s

CONTRACTOR: Ramsey Geotechnical Engineering, LLC
Rig mfg/model: Diedrich D-50
Drilling Method: 4 1/4" HSA, split spoon sampler
FIELD STAFF: Driller: B. Williamson
Helper: D. Crump
Eng/Geo: S. Keim

BOREHOLE ID: AW-06
Well ID: AW-06
Surface Elev: 459.19 ft. MSL
Completion: 42.25 ft. BGS
Station: 1,430,727.75N
 2,434,495.33E

SAMPLE		TESTING					TOPOGRAPHIC MAP INFORMATION:		WATER LEVEL INFORMATION:		
Number	Recov / Total (in) % Recovery	Type	Blows / 6 in N - Value RQD	Moisture (%)	Dry Den. (lb/ft ³)	Q _u (tsf) Q _p (tsf) Failure Type	Depth ft. BGS	Lithologic Description	Borehole Detail	Elevation ft. MSL	Remarks
11-1											
11-2	12/24 50%	SH				0.80				438	
11-3											
11-4				20			22	Dark gray (10YR4/1) with 10% dark grayish brown (10YR4/2) mottles, moist, medium, SILT with little clay and trace very fine- to fine-grained sand.			
12A	18/24 75%	SS	3-4 6-7 N=10			0.80	22			436	
13A	22/24 92%	SS	3-2 3-3 N=5	24		0.50	24	Dark gray (10YR4/1), moist, medium, SILT with few to little clay and trace fine- to medium-grained sand, woody material and shell fragments.			
14-1											
14-2	16/24 67%	SH				0.50	26			434	
14-3											
14-4				31			28				
15A	20/24 83%	SS	2-3 3-3 N=6	39		0.80	30	Dark gray (10YR4/1), moist, medium, SILT with little clay and trace fine- to medium-grained sand and shell fragments.			
16A	24/24 100%	BD					32			430	
17-1				29							
17-2	24/24 100%	SH				1.00	32	Gray (10YR5/1) with 35% yellowish brown (10YR5/6) mottles, moist, stiff, silty CLAY with trace fine-grained sand.			
17-3										428	
17-4							34				
18A	16/24 67%	SS	0-3 3-3 N=6	32		1.20	36	Dark gray (10YR4/1), moist, stiff, silty CLAY with trace very fine-grained sand and roots.			
19-1										426	
19-2	16/24 67%	SH				0.80	36				
19-3										424	
19-4				34			38				
20A	20/24 83%	SS	2-5 6-6 N=11	29			40	Dark gray (10YR4/1) with 5% olive brown (2.5Y4/3) mottles, moist, stiff, silty CLAY with trace fine- to coarse-grained sand and small gravel, trace roots.			
								Gray (10YR4/1) with 15% olive brown (2.5Y4/3) mottles,			420

NOTE(S): AW-06 installed in bore hole. Well was constructed using a pre-packed screen.

FIELD BORING LOG



CLIENT: Natural Resource Technology, Inc.
Site: Edwards Power Station
Location: Bartonville, Illinois
Project: 15E0030
DATES: Start: 7/29/2015
Finish: 8/3/2015
WEATHER: Sunny, warm, hi-80s

CONTRACTOR: Ramsey Geotechnical Engineering, LLC
Rig mfg/model: Diedrich D-50
Drilling Method: 4 1/4" HSA, split spoon sampler
FIELD STAFF: Driller: B. Williamson
Helper: D. Crump
Eng/Geo: S. Keim

BOREHOLE ID: AW-06
Well ID: AW-06
Surface Elev: 459.19 ft. MSL
Completion: 42.25 ft. BGS
Station: 1,430,727.75N
 2,434,495.33E

SAMPLE			TESTING				TOPOGRAPHIC MAP INFORMATION:		WATER LEVEL INFORMATION:		
Number	Recov / Total (in) % Recovery	Type	Blows / 6 in N - Value RQD	Moisture (%)	Dry Den. (lb/ft ³)	Qu (tsf) Qp (tsf) Failure Type	TOPOGRAPHIC MAP INFORMATION:		WATER LEVEL INFORMATION:		
							Depth ft. BGS	Lithologic Description	Borehole Detail	Elevation ft. MSL	Remarks
21A	4/4 100%	☒ ss	50/4"	14			42	moist, stiff, weathered SHALE, slightly laminated.		418	
22A	3/3 100%	☒ ss	50/3"	13				Dark gray (10YR4/1), moist, hard, weathered SHALE.			
End of boring = 42.25 feet											

NOTE(S): AW-06 installed in bore hole. Well was constructed using a pre-packed screen.

FIELD BORING LOG



CLIENT: Natural Resource Technology, Inc.
Site: Edwards Power Station
Location: Bartonville, Illinois
Project: 15E0030
DATES: Start: 7/20/2015
Finish: 7/21/2015
WEATHER: Sunny, warm, hi-70s

CONTRACTOR: Ramsey Geotechnical Engineering, LLC
Rig mfg/model: Diedrich D-50
Drilling Method: 4 1/4" HSA, split spoon sampler
FIELD STAFF: Driller: B. Williamson
Helper: D. Crump
Eng/Geo: S. Keim

BOREHOLE ID: AW-08
Well ID: AW-08
Surface Elev: 460.66 ft. MSL
Completion: 57.67 ft. BGS
Station: 1,430,641.18N
 2,436,732.68E

SAMPLE		TESTING					TOPOGRAPHIC MAP INFORMATION:		WATER LEVEL INFORMATION:		
Number	Recov / Total (in) % Recovery	Type	Blows / 6 in N - Value RQD	Moisture (%)	Dry Den. (lb/ft ³)	Q _u (tsf) Q _p (tsf) Failure Type	Depth ft. BGS	Lithologic Description	Borehole Detail	Elevation ft. MSL	Remarks
1A	16/24 67%	ss	4-3 5-7 N=8	15	3.30		0	FILL - Very dark grayish brown (10YR3/2), moist, medium, clayey SILT with trace fine- to coarse-grained sand, trace small gravel.		460	
2A	16/24 67%	ss	4-3 3-4 N=6	25	3.00		2	FILL - Gray (10YR5/1), moist, medium, SILT with little clay, trace fine- to coarse-grained sand, trace small gravel.		458	
3A	17/24 71%	ss	1-2 1-2 N=3	16	2.50		4	Very dark gray (10YR3/1), moist, soft, silty CLAY with trace fine-grained sand.		456	
4A	19/24 79%	ss	5-6 6-6 N=12	22	1.30		6	Gray (10YR5/1) with 30% dark yellowish brown (10YR4/6) mottles, moist, stiff, silty CLAY with trace fine-grained sand.		454	
5A	21/24 88%	ss	1-2 2-2 N=4	28	2.30		8			452	
6A	24/24 100%	ss	1-2 2-3 N=4	37	0.80		10	Dark gray (10YR4/1) with 15% dark brown (10YR3/3) mottles, moist, soft, silty CLAY with trace fine-grained sand.		450	
7A	21/24 88%	ss	3-3 4-4 N=7	27	0.80		12			448	
8-1							14			446	
8-2	8/24 33%	SH					14	Dark gray (10YR4/1) with 5% dark yellowish brown (10YR4/6) mottles, moist, medium, very fine- to fine-grained sandy CLAY.		446	
8-3							16			444	
8-4				24	0.80		16			444	
9A	22/24 92%	ss	2-2 3-4 N=5	30	0.80		18	Dark gray (10YR4/1) with 5% dark yellowish brown (10YR4/6) mottles, moist, medium, very fine- to fine-grained sandy CLAY with trace very fine- to fine-grained sand seams (wet).		444	
10A	22/24 92%	ss	2-1 2-1 N=3	42	0.30		20	Dark gray (N4/0), moist, soft, SILT with few clay and slight trace shell fragments.		442	

NOTE(S): AW-08 installed in bore hole.

FIELD BORING LOG



CLIENT: Natural Resource Technology, Inc.
Site: Edwards Power Station
Location: Bartonville, Illinois
Project: 15E0030
DATES: Start: 7/20/2015
Finish: 7/21/2015
WEATHER: Sunny, warm, hi-70s

CONTRACTOR: Ramsey Geotechnical Engineering, LLC
Rig mfg/model: Diedrich D-50
Drilling Method: 4 1/4" HSA, split spoon sampler
FIELD STAFF: Driller: B. Williamson
Helper: D. Crump
Eng/Geo: S. Keim

BOREHOLE ID: AW-08
Well ID: AW-08
Surface Elev: 460.66 ft. MSL
Completion: 57.67 ft. BGS
Station: 1,430,641.18N
 2,436,732.68E

SAMPLE		TESTING					TOPOGRAPHIC MAP INFORMATION:		WATER LEVEL INFORMATION:		
Number	Recov / Total (in) % Recovery	Type	Blows / 6 in N - Value RQD	Moisture (%)	Dry Den. (lb/ft ³)	Q _u (tsf) Q _p (tsf) Failure Type	Depth ft. BGS	Lithologic Description	Borehole Detail	Elevation ft. MSL	Remarks
11-1											
11-2	18/24 75%	SH						Dark gray (10YR4/1), moist, stiff, SILT with trace clay and trace shell fragments.		440	
11-3											
11-4				25		1.30	22				
12A	24/24 100%	SS	5-7 14-15 N=21	18		3.30	24	Dark gray (10YR4/1), moist, very stiff, SILT with few clay, trace medium- to coarse-grained sand, slight trace shell fragments.		438	
13A	24/24 100%	SS	2-3 4-4 N=7	32		1.50	26	Dark gray (10YR4/1), moist, stiff, SILT with few clay and slight trace very fine- to fine-grained sand.		436	
14A	24/24 100%	SS	6-7 7-8 N=14	28		1.20	28			434	
15A	22/24 92%	SS	1-2 3-3 N=5	27		1.30	30	Dark gray (10YR4/1) with 5% yellowish brown (10YR5/4) mottles, moist, stiff, SILT with few clay and trace fine- to medium-grained sand.		432	
16A	24/24 100%	SS	1-2 2-2 N=4	29		1.20	32			430	
17A	24/24 100%	SS	3-4 6-7 N=10	29		1.60	34			428	
18A	24/24 100%	SS	2-2 2-4 N=4	32		0.80	36	Gray (10YR5/1) with 35% dark yellowish brown (10YR4/4) mottles, moist, medium, SILT with few clay and trace very fine- to fine-grained sand.		426	
19A	24/24 100%	SS	4-4 5-6 N=9	28		1.00	38			424	
20A	24/24 100%	SS	1-1 1-2 N=2	30		0.70	40	Grayish brown (10YR5/2) with 25% yellowish brown (10YR5/4) mottles, moist, medium, SILT with few clay and trace very fine-grained sand.		422	

NOTE(S): AW-08 installed in bore hole.

FIELD BORING LOG



CLIENT: Natural Resource Technology, Inc.
Site: Edwards Power Station
Location: Bartonville, Illinois
Project: 15E0030
DATES: Start: 7/20/2015
Finish: 7/21/2015
WEATHER: Sunny, warm, hi-70s

CONTRACTOR: Ramsey Geotechnical Engineering, LLC
Rig mfg/model: Diedrich D-50
Drilling Method: 4 1/4" HSA, split spoon sampler
FIELD STAFF: Driller: B. Williamson
Helper: D. Crump
Eng/Geo: S. Keim

BOREHOLE ID: AW-08
Well ID: AW-08
Surface Elev: 460.66 ft. MSL
Completion: 57.67 ft. BGS
Station: 1,430,641.18N
 2,436,732.68E

SAMPLE		TESTING					TOPOGRAPHIC MAP INFORMATION:		WATER LEVEL INFORMATION:		
Number	Recov / Total (in) % Recovery	Type	Blows / 6 in N - Value RQD	Moisture (%)	Dry Den. (lb/ft ³)	Q _u (tsf) Q _p (tsf) Failure Type	Depth ft. BGS	Lithologic Description	Borehole Detail	Elevation ft. MSL	Remarks
21A	24/24 100%	ss	0-0 2-2 N=2	28	0.30		42	Dark gray (10YR4/1) and dark yellowish brown (10YR4/4), moist, soft, SILT with few clay and trace very fine-grained sand.		420	
22A	24/24 100%	ss	3-2 3-3 N=5	27	0.20		44			418	
23A	24/24 100%	ss	3-3 4-4 N=7	41	0.50		46			416	
24A	24/24 100%	ss	4-5 4-4 N=9	41	0.30		48			414	
25A	24/24 100%	ss	0-0 3-3 N=3	48	0.20		50	Dark gray (10YR4/1), moist, very soft to medium, SILT with few clay and trace very fine-grained sand and shell fragments.		412	
26A	24/24 100%	ss	2-2 3-3 N=5	43	0.30		52			410	
27A	24/24 100%	ss	3-3 4-5 N=7	60	0.50		54			408	
28A	24/24 100%	ss	2-4 8-10 N=12	29	1.00		56			406	
29A	11/24 46%	ss	23-50/5*	20			56	Gray (10YR5/1), moist, stiff, very fine-grained sandy SILT, little clay.		404	
								Gray (10YR5/1), moist, hard, weathered SHALE.			

End of boring = 57.67 feet

NOTE(S): AW-08 installed in bore hole.

FIELD BORING LOG



CLIENT: Natural Resource Technology, Inc.
Site: Edwards Power Station
Location: Bartonville, Illinois
Project: 15E0030
DATES: Start: 7/29/2015
 Finish: 8/3/2015
WEATHER: Sunny, warm, lo-80s

CONTRACTOR: Ramsey Geotechnical Engineering, LLC
Rig mfg/model: Diedrich D-50
Drilling Method: 4 1/4" HSA, split spoon sampler
FIELD STAFF: Driller: B. Williamson
 Helper: D. Crump
 Eng/Geo: S. Keim

BOREHOLE ID: AW-09
Well ID: AW-09
Surface Elev: 458.32 ft. MSL
Completion: 52.23 ft. BGS
Station: 1,429,340.11N
 2,434,856.97E

SAMPLE			TESTING				TOPOGRAPHIC MAP INFORMATION:		WATER LEVEL INFORMATION:		
Number	Recov / Total (in) % Recovery	Type	Blows / 6 in N - Value RQD	Moisture (%)	Dry Den. (lb/ft ³)	Q _u (tsf) Q _p (tsf) Failure Type	Quadrangle: Pekin Quadrangle (7 1/2' series) Township: Hollis Township Section 14, Tier 7N; Range 7E		▼ = Dry - during drilling ▼ = ▼ =		
							Depth ft. BGS	Lithologic Description	Borehole Detail	Elevation ft. MSL	Remarks
							0	GRAVEL FILL		458	
2A	24/24 100%	BD		23			2	FILL - Dark gray (10YR4/1), very moist, SILT with few clay and gravel.		456	Sample from cuttings
3A	21/24 88%	SS	1-3 6-9 N=9	29	0.50		4	FILL - Yellowish brown (10YR5/4), moist, medium, silty CLAY with trace fine- to coarse-grained sand.		454	
4A	19/24 79%	SS	10-13 14-15 N=27	28			6	FILL - Very dark gray (10YR3/1), moist, stiff, FLY ASH.		452	
5A	22/24 92%	SS	5-5 5-5 N=10	36			8			450	
6A	18/24 75%	SS	2-3 3-2 N=6	36			10			448	
7A	20/24 83%	SS	3-4 7-9 N=11	32			12	FILL - Very dark gray (10YR3/1), moist, medium, FLY ASH.		446	
8A	21/24 88%	SS	2-3 4-4 N=7	37			14			444	
9A	22/24 92%	SS	3-5 4-3 N=9	38			16			442	
							18	Very dark gray (10YR3/1), moist, medium, SILT with few clay and trace very fine - to fine-grained sand.		440	
10A	15/24 63%	SS	2-2 4-4 N=6	26	1.50		20	Dark gray (10YR4/1) with 35% yellowish brown (10YR5/6) mottles, moist, medium, SILT with few clay, trace very fine- to fine-grained sand and organics.			

NOTE(S): AW-09 installed in bore hole. Well was constructed using a pre-packed screen.

FIELD BORING LOG



CLIENT: Natural Resource Technology, Inc.
Site: Edwards Power Station
Location: Bartonville, Illinois
Project: 15E0030
DATES: Start: 7/29/2015
Finish: 8/3/2015
WEATHER: Sunny, warm, lo-80s

CONTRACTOR: Ramsey Geotechnical Engineering, LLC
Rig mfg/model: Diedrich D-50
Drilling Method: 4 1/4" HSA, split spoon sampler
FIELD STAFF: Driller: B. Williamson
Helper: D. Crump
Eng/Geo: S. Keim

BOREHOLE ID: AW-09
Well ID: AW-09
Surface Elev: 458.32 ft. MSL
Completion: 52.23 ft. BGS
Station: 1,429,340.11N
 2,434,856.97E

SAMPLE		TESTING					TOPOGRAPHIC MAP INFORMATION:		WATER LEVEL INFORMATION:		
Number	Recov / Total (in) % Recovery	Type	Blows / 6 in N - Value RQD	Moisture (%)	Dry Den. (lb/ft ³)	Q _u (tsf) Q _p (tsf) Failure Type	Depth ft. BGS	Lithologic Description	Borehole Detail	Elevation ft. MSL	Remarks
11A	16/24 67%	SS	1-2 4-5 N=6	24	2.30		22	Grayish brown (10YR5/2), moist, medium, SILT with little clay, trace coarse-grained sand and roots.		438	
12A	18/24 75%	SS	7-9 9-9 N=18	26	1.80		24	Gray (10YR5/1) with 25% yellowish brown (10YR5/6) mottles, moist, stiff, silty CLAY with trace fine-grained sand.		436	
13-1					1.80					434	
13-2	21/24 88%	SH			1.80			Very dark gray (10YR3/1), moist, stiff, SILT with few clay and trace very fine- to fine-grained sand.			
13-3					1.80						
13-4					28						
14A	19/24 79%	SS	6-6 5-6 N=11	28	0.50		28	Dark gray (10YR4/1) with 20% very dark grayish brown (10YR3/2) mottles, moist, medium, SILT with few clay and trace very fine- to fine-grained sand.		432	
15A	22/24 92%	SS	1-3 3-4 N=6	25	1.30		30	Gray (10YR5/1) with 30% dark yellowish brown (10YR4/4) mottles, moist, stiff, SILT with few clay and trace very fine- to fine-grained sand, woody material and shell fragments.		428	
16-1					1.30						
16-2	18/24 75%	SH			1.30						
16-3					40						
16-4					32					426	
17A	24/24 100%	SS	1-1 3-4 N=4	31	0.80		34	Gray (10YR5/1) with 30% dark yellowish brown (10YR4/4) mottles, moist, medium, SILT with few clay and trace very fine- to fine-grained sand and woody material.		424	
18-1					0.80						
18-2	24/24 100%	SH			0.80						
18-3					0.80						
18-4					32			Dark gray (10YR4/1), moist, medium, SILT with little clay and trace very fine-grained sand.		422	
19A	24/24 100%	SS	1-2 3-3 N=5	36	0.70		38			420	
20A	13/24 54%	SS	3-3 3-3 N=6	34	0.50			Dark gray (10YR4/1), moist, medium to stiff, SILT with little clay and trace very fine-grained sand and shell fragments.			

NOTE(S): AW-09 installed in bore hole. Well was constructed using a pre-packed screen.

FIELD BORING LOG



CLIENT: Natural Resource Technology, Inc.
Site: Edwards Power Station
Location: Bartonville, Illinois
Project: 15E0030
DATES: Start: 7/29/2015
Finish: 8/3/2015
WEATHER: Sunny, warm, lo-80s

CONTRACTOR: Ramsey Geotechnical Engineering, LLC
Rig mfg/model: Diedrich D-50
Drilling Method: 4 1/4" HSA, split spoon sampler
FIELD STAFF: Driller: B. Williamson
Helper: D. Crump
Eng/Geo: S. Keim

BOREHOLE ID: AW-09
Well ID: AW-09
Surface Elev: 458.32 ft. MSL
Completion: 52.23 ft. BGS
Station: 1,429,340.11N
 2,434,856.97E

SAMPLE		TESTING					TOPOGRAPHIC MAP INFORMATION:		WATER LEVEL INFORMATION:			
Number	Recov / Total (in) % Recovery	Type	Blows / 6 in N - Value RQD	Moisture (%)	Dry Den. (lb/ft ³)	Q _u (tsf) / Q _p (tsf) Failure Type	Quadrangle: Pekin Quadrangle (7 1/2' series) Township: Hollis Township Section 14, Tier 7N; Range 7E		▽ = Dry - during drilling ▽ = ▽ =			
							Depth ft. BGS	Lithologic Description	Borehole Detail	Elevation ft. MSL	Remarks	
21-1											418	
21-2	16/24 67%	SH				1.30						
21-3												
21-4				40			42					
22A	20/24 83%	SS	3-4 5-5 N=9	52		0.80					416	
23A	24/24 100%	SS	2-3 3-4 N=6	81		0.80	44	Dark gray (10YR4/1), moist, medium to stiff, SILT with little clay and trace very fine-grained sand and shell fragments. [Continued from previous page]			414	
24-1							46				412	
24-2	24/24 100%	SH										
24-3						1.00						
24-4				77			48				410	
25A	24/24 100%	SS	1-3 3-5 N=6	41		0.80	50					
26-1	11/12 92%	SH				0.50					408	
26-2				13								
26A	9/12 75%	SS	50-50/3"					Dark gray (10YR4/1), moist, hard, weathered SHALE.				
27A	2/2 100%	SS	50/2"	14			52					

End of boring = 52.23 feet

NOTE(S): AW-09 installed in bore hole. Well was constructed using a pre-packed screen.

FIELD BORING LOG



CLIENT: Natural Resource Technology, Inc.
Site: Edwards Power Station
Location: Bartonville, Illinois
Project: 15E0030
DATES: Start: 7/23/2015
Finish: 7/23/2015
WEATHER: Sunny, warm, calm, mid-70s

CONTRACTOR: Ramsey Geotechnical Engineering, LLC
Rig mfg/model: Diedrich D-50
Drilling Method: 4 1/4" HSA, split spoon sampler
FIELD STAFF: Driller: B. Williamson
Helper: D. Crump
Eng/Geo: S. Keim

BOREHOLE ID: AW-10
Well ID: AW-10
Surface Elev: 437.64 ft. MSL
Completion: 32.74 ft. BGS
Station: 1,429,461.05N
 2,436,231.40E

SAMPLE		TESTING					TOPOGRAPHIC MAP INFORMATION:		WATER LEVEL INFORMATION:				
Number	Recov / Total (in) % Recovery	Type	Blows / 6 in N - Value RQD	Moisture (%)	Dry Den. (lb/ft ³)	Q _u (tsf) / Q _p (tsf) Failure Type	Quadrangle: Pekin Quadrangle (7 1/2' series) Township: Hollis Township Section 14, Tier 7N; Range 7E	▼ = 7.00 - during drilling ▽ = 6.68 - 7/23/15 ▽ =	Depth ft. BGS	Lithologic Description	Borehole Detail	Elevation ft. MSL	Remarks
1A	16/24 67%	ss	6-5 5-5 N=10	25					0	Very dark grayish brown (10YR3/2), moist, very stiff, SILT with few clay and trace very fine- to fine-grained sand and roots.		436	
2A	20/24 83%	ss	2-2 2-3 N=4	30	1.50				2			434	
3A	15/24 63%	ss	1-1 3-3 N=4	25	2.30				4	Very dark gray (10YR3/1) with 3% dark yellowish brown (10YR4/4) mottles, moist, stiff, silty CLAY with trace very fine- to fine-grained sand.		432	
4A	16/24 67%	ss	4-3 4-3 N=7	29	1.00				6			430	
5A	19/24 79%	ss	1-1 2-2 N=3	29	0.80				8	Gray (10YR5/1) with 5% dark gray (10YR4/1) and 5% dark yellowish brown (10YR4/4) mottles, moist, medium, silty CLAY with trace fine-grained sand.		428	
6A	24/24 100%	ss	1-1 1-2 N=2	45	0.80				10	Dark gray (10YR4/1) with 5% dark yellowish brown (10YR4/4) mottles, moist, medium, SILT with few clay and trace very fine- to fine-grained sand.		426	
7A	24/24 100%	ss	2-2 2-3 N=4	43	0.30				12	Dark gray (10YR4/1), moist, soft, SILT with few clay and trace very fine-grained sand and shell fragments.		424	
8A	24/24 100%	ss	1-1 1-1 N=2	55	0.30				14			422	
9A	24/24 100%	ss	2-2 2-3 N=4	41	0.50				16	Dark gray (10YR4/1), moist, soft, SILT with few clay and trace very fine-grained sand, shell fragments, and woody fragments.		420	
10A	24/24 100%	ss	1-1 1-1 N=2	34	0.30				18			418	

NOTE(S): AW-10 installed in bore hole.

FIELD BORING LOG



CLIENT: Natural Resource Technology, Inc.
Site: Edwards Power Station
Location: Bartonville, Illinois
Project: 15E0030
DATES: Start: 7/23/2015
Finish: 7/23/2015
WEATHER: Sunny, warm, calm, mid-70s

CONTRACTOR: Ramsey Geotechnical Engineering, LLC
Rig mfg/model: Diedrich D-50
Drilling Method: 4 1/4" HSA, split spoon sampler
FIELD STAFF: Driller: B. Williamson
Helper: D. Crump
Eng/Geo: S. Keim

BOREHOLE ID: AW-10
Well ID: AW-10
Surface Elev: 437.64 ft. MSL
Completion: 32.74 ft. BGS
Station: 1,429,461.05N
 2,436,231.40E

SAMPLE			TESTING				TOPOGRAPHIC MAP INFORMATION:		WATER LEVEL INFORMATION:		
Number	Recov / Total (in) % Recovery	Type	Blows / 6 in N - Value RQD	Moisture (%)	Dry Den. (lb/ft ³)	Q _u (tsf) / Q _p (tsf) Failure Type	Depth ft. BGS	Lithologic Description	Borehole Detail	Elevation ft. MSL	Remarks
11A	24/24 100%	ss	0-0 1-1 N=1	57	0.30		22			416	
12A	24/24 100%	ss	2-1 1-2 N=2	58	0.30		24			414	
13-1								Dark gray (10YR4/1), moist, soft, SILT with few clay and trace very fine-grained sand, shell fragments, and woody fragments. [Continued from previous page]			
13-2	24/24 100%	sh					26				412
13-3											
13-4				89	0.80						
14A	24/24 100%	ss	1-1 2-2 N=3	100	0.30		28			410	
15A	24/24 100%	ss	0-1 2-1 N=3	56	0.50		30			408	
16A	24/24 100%	ss	0-6 6-9 N=12	26	1.80		32	Gray (10YR5/1), moist, hard, weathered SHALE.		406	
17A	9/9 100%	ss	33-50/6"	18							

End of boring = 32.74 feet

NOTE(S): AW-10 installed in bore hole.

FIELD BORING LOG



CLIENT: Natural Resource Technology, Inc.
Site: Edwards Power Station
Location: Bartonville, Illinois
Project: 15E0030
DATES: Start: 7/24/2015
Finish: 7/28/2015
WEATHER: Sunny, warm, mid-70s

CONTRACTOR: Ramsey Geotechnical Engineering, LLC
Rig mfg/model: Diedrich D-50
Drilling Method: 4 1/4" HSA, split spoon sampler
FIELD STAFF: Driller: B. Williamson
Helper: D. Crump
Eng/Geo: R. Hasenyager

BOREHOLE ID: AW-11
Well ID: AW-11
Surface Elev: 437.16 ft. MSL
Completion: 30.00 ft. BGS
Station: 1,428,196.31N
 2,436,251.05E

SAMPLE		TESTING					TOPOGRAPHIC MAP INFORMATION:		WATER LEVEL INFORMATION:				
Number	Recov / Total (in) % Recovery	Type	Blows / 6 in N - Value RQD	Moisture (%)	Dry Den. (lb/ft ³)	Q _u (tsf) / Q _p (tsf) Failure Type	Quadrangle: Pekin Quadrangle (7 1/2' series) Township: Hollis Township Section 14, Tier 7N; Range 7E	▼ = 9.00 - during drilling ▽ = 5.77 - 7/27/15 ▽ =	Depth ft. BGS	Lithologic Description	Borehole Detail	Elevation ft. MSL	Remarks
1	10/24 42%	ss	3-4 4-5 N=8	23	2.80		FILL - Black (10YR2/1), moist, medium, CLAY with some silt and trace sand and small gravel.		0			436	
2	13/24 54%	ss	2-2 2-2 N=4	26	0.80		Very dark gray (10YR3/1) with 20% dark yellowish brown (10YR4/6) mottles, moist, soft, CLAY with some silt and trace sand.		2			434	
3	10/24 42%	ss	1-1 2-1 N=3	25	1.30		Gray (10YR5/1) with 30% yellowish brown (10YR5/6) mottles, moist, soft, CLAY with some silt and trace very fine-grained sand.	▽	6			432	
4	14/24 58%	ss	1-2 2-1 N=4	28	0.50		Very dark gray (10YR3/1), wet, very soft, SILT with few clay and trace very fine-grained sand.		8			430	
5-1								▽	8			428	
5-2	24/24 100%	SH		40	0.80				10			426	
5-3									12			424	
5-4									14			422	
6	20/24 83%	ss	1-1 1-1 N=2	53	0.30		Gray (10YR5/1) with 10% yellowish brown (10YR5/6) mottles, moist, soft, SILT with few clay and trace very fine-grained sand.		16			420	
7	24/24 100%	ss	2-2 2-2 N=4	66	0.30		Gray (10YR5/1), moist, soft, SILT with few clay and trace very fine-grained sand.		18			418	
8	24/24 100%	ss	1-1 1-1 N=2	50	0.30				20				
9	24/24 100%	ss	1-1 1-1 N=2	56	0.00		Gray (10YR5/1), moist, soft, SILT with few clay and trace very fine-grained sand, shell fragments and woody fragments.						
10	24/24 100%	ss	woh-1 1-1 N=2	61	0.50								

NOTE(S): AW-11 installed in bore hole.

FIELD BORING LOG



CLIENT: Natural Resource Technology, Inc.
Site: Edwards Power Station
Location: Bartonville, Illinois
Project: 15E0030
DATES: Start: 7/24/2015
Finish: 7/28/2015
WEATHER: Sunny, warm, mid-70s

CONTRACTOR: Ramsey Geotechnical Engineering, LLC
Rig mfg/model: Diedrich D-50
Drilling Method: 4 1/4" HSA, split spoon sampler
FIELD STAFF: Driller: B. Williamson
Helper: D. Crump
Eng/Geo: R. Hasenyager

BOREHOLE ID: AW-11
Well ID: AW-11
Surface Elev: 437.16 ft. MSL
Completion: 30.00 ft. BGS
Station: 1,428,196.31N
 2,436,251.05E

SAMPLE		TESTING				TOPOGRAPHIC MAP INFORMATION:		WATER LEVEL INFORMATION:					
Number	Recov / Total (in) % Recovery	Type	Blows / 6 in N - Value RQD	Moisture (%)	Dry Den. (lb/ft ³)	Q _u (tsf) Q _p (tsf) Failure Type	Quadrangle: Pekin Quadrangle (7 1/2' series) Township: Hollis Township Section 14, Tier 7N; Range 7E	▽ = 9.00 - during drilling ▽ = 5.77 - 7/27/15 ▽ =	Depth ft. BGS	Lithologic Description	Borehole Detail	Elevation ft. MSL	Remarks
11	22/24 92%	ss	woh-woh 1-1	61	0.20							416	
12	24/24 100%	ss	1-1 1-1 N=2	86	0.50		Gray (10YR5/1), moist, soft, SILT with few clay and trace very fine-grained sand, shell fragments and woody fragments. [Continued from previous page]					414	
13	24/24 100%	ss	1-1 2-1 N=3	84	0.50							412	
14A	22/24 92%	ss	2-3 5-11 N=8	36	0.50							410	
14B				11			Gray (10YR5/1), wet, loose, very fine- to very coarse-grained SAND with some small to medium gravel.						
15A				83			Gray (10YR5/1), moist, soft, SILT with few clay and trace very fine-grained sand, shell fragments and woody fragments.						
15B	24/24 100%	ss	3-39 27-62 N=66	16			Gray (10YR5/1), wet, loose, medium- to very coarse-grained SAND.					408	
							Gray (10YR5/1), moist, hard, weathered SHALE.						
End of boring = 30.00 feet													

NOTE(S): AW-11 installed in bore hole.

FIELD BORING LOG



CLIENT: Natural Resource Technology, Inc.
Site: Edwards Power Station
Location: 7800 S Cilco Ln, Bartonville, Illinois
Project: 16E0433
DATES: Start: 11/28/2016
Finish: 11/29/2016
WEATHER: Sunny, cool (hi-30s)

CONTRACTOR: Bulldog Drilling, Inc.
Rig mfg/model: CME-550X ATV Drill
Drilling Method: 4/4" Hollow Stem Auger
FIELD STAFF: Driller: C. Dutton
Helper: M. Baetje
Eng/Geo: R. Hasenyager

BOREHOLE ID: AP05S
Well ID: AP05S
Surface Elev: 441.13 ft. MSL
Completion: 38.06 ft. BGS
Station: 1,432,405.64N
 2,436,746.64E

SAMPLE		TESTING					TOPOGRAPHIC MAP INFORMATION:			WATER LEVEL INFORMATION:							
Number	Recov / Total (in) % Recovery	Type	Blows / 6 in N - Value	Moisture (%)	Dry Den. (lb/ft ³)	Q _u (tsf) Q _p (tsf) Failure Type	Quadrangle: Pekin	Township: Hollis	Section 11, Tier 7N; Range 7E	▽ = 6.25 - During drilling	▽ = 5.23 - 01/18/2017	▽ =	Depth ft. BGS	Lithologic Description	Borehole Detail	Elevation ft. MSL	Remarks
	0/24 0%	BD											0	Black (10YR3/1), moist, soft, CLAY with some silt, trace sand, and trace gravel.		440	
	0/24 0%	BD											2	Black (10YR2/1), moist, soft, SILT with few clay, trace sand, and trace gravel.		438	
	0/24 0%	BD											4	Dark yellowish brown (10YR4/4), moist, medium, CLAY with some silt and trace sand.		436	
	0/24 0%	BD											6			434	
	0/24 0%	BD											8	Gray (10YR5/1), moist, soft, CLAY with some silt and trace sand.		432	
	0/24 0%	BD											10	Gray (10YR5/1) with 20% yellowish brown (10YR5/6) mottles, moist, soft, CLAY with some silt and trace sand.		430	
	0/24 0%	BD											12	Yellowish brown (10YR5/6) with 25% Gray (10YR5/1) mottles, moist, soft, CLAY with some silt and trace sand.		428	
	0/24 0%	BD											14	Dark yellowish brown (10YR4/4) with 10% yellowish brown (10YR5/6) mottles, moist, very soft, CLAY with some silt and trace sand.		426	
	0/24 0%	BD											16			424	
	0/24 0%	BD											18	Gray (10YR5/1) with 15% yellowish brown (10YR5/6) mottles, moist, very soft, SILT with few clay, trace sand, and trace shell fragments.		422	
	0/24 0%	BD											20				

NOTE(S): AP05S drilled approx. 5 ft. north of AP05D.

FIELD BORING LOG



CLIENT: Natural Resource Technology, Inc.
Site: Edwards Power Station
Location: 7800 S Cilco Ln, Bartonville, Illinois
Project: 16E0433
DATES: Start: 11/28/2016
Finish: 11/29/2016
WEATHER: Sunny, cool (hi-30s)

CONTRACTOR: Bulldog Drilling, Inc.
Rig mfg/model: CME-550X ATV Drill
Drilling Method: 4/4" Hollow Stem Auger
FIELD STAFF: Driller: C. Dutton
Helper: M. Baetje
Eng/Geo: R. Hasenyager

BOREHOLE ID: AP05S
Well ID: AP05S
Surface Elev: 441.13 ft. MSL
Completion: 38.06 ft. BGS
Station: 1,432,405.64N
 2,436,746.64E

SAMPLE		TESTING					TOPOGRAPHIC MAP INFORMATION:			WATER LEVEL INFORMATION:		
Number	Recov / Total (in) % Recovery	Type	Blows / 6 in N - Value RQD	Moisture (%)	Dry Den. (lb/ft ³)	Q _u (tsf) Q _p (tsf) Failure Type	Quadrangle: Pekin	Township: Hollis	Section 11, Tier 7N; Range 7E	▽ = 6.25 - During drilling	▽ = 5.23 - 01/18/2017	▽ =
							Depth ft. BGS	Lithologic Description	Borehole Detail	Elevation ft. MSL	Remarks	
0/24	0%	BD										
0/24	0%	BD										
0/24	0%	BD										
0/24	0%	BD										
0/24	0%	BD					Gray (10YR5/1), moist, very soft, CLAY with some silt, trace sand, and trace shell fragments.					
0/24	0%	BD										
0/24	0%	BD										
0/24	0%	BD										
0/24	0%	BD										
0/24	0%	BD										
0/24	0%	BD					Medium light gray (N6/1), dry, hard, SILTSTONE with little very fine-grained sand.					
							38					

End of Boring = 38.06 ft. BGS

NOTE(S): AP05S drilled approx. 5 ft. north of AP05D.



Site #: _____ County: Peoria County Well #: AW-05

Site Name: Edwards Power Station Borehole #: AW-05

State _____
Plane Coordinate: X 2,435,498.0 Y 1,432,339.7 (or) Latitude: _____ Longitude: _____

Surveyed By: Gary C. Rogers IL Registration #: 035-002957

Drilling Contractor: Ramsey Geotechnical Engineering, LLC Driller: B. Williamson

Consulting Firm: Hanson Professional Services Inc. Geologist: Rhonald W. Hasenyager, LPG #196-000246


Drilling Method: Hollow Stem Auger Drilling Fluid (Type): None

Logged By: Suzanna L. Keim Date Started: 7/22/2015 Date Finished: 7/22/2015

Report Form Completed By: Suzanna L. Keim Date: 7/24/2015

ANNULAR SPACE DETAILS

	Elevations (MSL)*	Depths (BGS)	(0.01 ft.)
	<u>443.55</u>	<u>-3.00</u>	Top of Protective Casing
	<u>443.37</u>	<u>-2.82</u>	Top of Riser Pipe
Type of Surface Seal: <u>Concrete</u>	<u>440.55</u>	<u>0.00</u>	Ground Surface
Type of Annular Sealant: <u>High-solids bentonite</u>	<u>438.05</u>	<u>2.50</u>	Top of Annular Sealant
Installation Method: <u>Tremie</u>			
Setting Time: <u>>48 hours</u>			
Type of Bentonite Seal -- <input checked="" type="checkbox"/> Granular <input type="checkbox"/> Pellet <input type="checkbox"/> Slurry (choose one)	<u>431.39</u>	<u>9.16</u>	Static Water Level (After Completion) 9/23/2015
Installation Method: <u>Gravity</u>	<u>428.55</u>	<u>12.00</u>	Top of Seal
Setting Time: <u>30 minutes</u>	<u>426.35</u>	<u>14.20</u>	Top of Sand Pack
Type of Sand Pack: <u>Quartz Sand</u>			
Grain Size: <u>10-20</u> (sieve size)	<u>424.68</u>	<u>15.87</u>	Top of Screen
Installation Method: <u>Gravity</u>	<u>420.08</u>	<u>20.47</u>	Bottom of Screen
Type of Backfill Material: <u>n/a</u> (if applicable)	<u>419.45</u>	<u>21.10</u>	Bottom of Well
Installation Method: _____	<u>419.45</u>	<u>21.10</u>	Bottom of Borehole

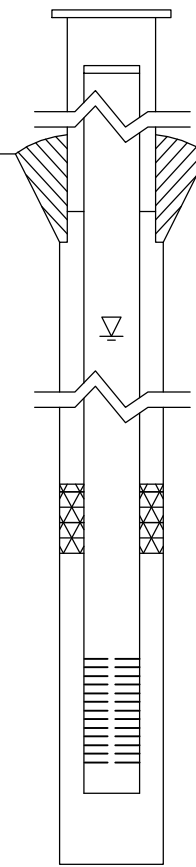

* Referenced to a National Geodetic Datum

WELL CONSTRUCTION MATERIALS (Choose one type of material for each area)

Protective Casing	SS304	SS316	PTFE	PVC	OTHER: <input checked="" type="checkbox"/> Steel
Riser Pipe Above W.T.	SS304	SS316	PTFE	<input checked="" type="checkbox"/> PVC	OTHER:
Riser Pipe Below W.T.	SS304	SS316	PTFE	<input checked="" type="checkbox"/> PVC	OTHER:
Screen	SS304	SS316	PTFE	<input checked="" type="checkbox"/> PVC	OTHER:

CASING MEASUREMENTS

Diameter of Borehole	(inches)	8.0
ID of Riser Pipe	(inches)	2.0
Protective Casing Length	(feet)	5.0
Riser Pipe Length	(feet)	18.69
Bottom of Screen to End Cap	(feet)	0.63
Screen Length (1st slot to last slot)	(feet)	4.60
Total Length of Casing	(feet)	23.92
Screen Slot Size **	(inches)	0.010



Site #: County: Peoria County Well #: AW-06
Site Name: Edwards Power Station Borehole #: AW-06
State
Plane Coordinate: X 2,434,495.3 Y 1,430,727.7 (or) Latitude: Longitude:
Surveyed By: Gary C. Rogers IL Registration #: 035-002957
Drilling Contractor: Ramsey Geotechnical Engineering, LLC Driller: B. Williamson
Consulting Firm: Hanson Professional Services Inc. Geologist: Rhonald W. Hasenyager, LPG #196-000246
Drilling Method: Hollow Stem Auger Drilling Fluid (Type): None
Logged By: Suzanna L. Keim Date Started: 7/29/2015 Date Finished: 8/3/2015
Report Form Completed By: Suzanna L. Keim Date: 8/5/2015

ANNULAR SPACE DETAILS

Table with 4 columns: Description, Elevations (MSL)*, Depths (BGS), and (0.01 ft.). Includes a central diagram of a well cross-section. Rows include: Top of Protective Casing (461.79, -2.60), Top of Riser Pipe (461.57, -2.38), Ground Surface (459.19, 0.00), Top of Annular Sealant (457.19, 2.00), Static Water Level (432.88, 26.31), Top of Seal (426.89, 32.30), Top of Sand Pack (424.69, 34.50), Top of Screen (422.59, 36.60), Bottom of Screen (418.10, 41.09), Bottom of Well (417.50, 41.69), Bottom of Borehole (416.94, 42.25).

* Referenced to a National Geodetic Datum

CASING MEASUREMENTS

Table with 3 columns: Measurement, Unit, and Value. Rows include: Diameter of Borehole (6.0 inches), ID of Riser Pipe (2.0 inches), Protective Casing Length (5.0 feet), Riser Pipe Length (38.98 feet), Bottom of Screen to End Cap (0.60 feet), Screen Length (4.49 feet), Total Length of Casing (44.07 feet), Screen Slot Size (0.010 inches).

WELL CONSTRUCTION MATERIALS
(Choose one type of material for each area)


Table with 6 columns: Material Type, SS304, SS316, PTFE, PVC, OTHER. Rows include: Protective Casing (Steel), Riser Pipe Above W.T. (PVC), Riser Pipe Below W.T. (PVC), Screen (PVC).



Site #: _____ County: Peoria County Well #: AW-08
Site Name: Edwards Power Station Borehole #: AW-08
State _____
Plane Coordinate: X 2,436,732.7 Y 1,430,641.2 (or) Latitude: _____ Longitude: _____
Surveyed By: Gary C. Rogers IL Registration #: 035-002957
Drilling Contractor: Ramsey Geotechnical Engineering, LLC Driller: B. Williamson
Consulting Firm: Hanson Professional Services Inc. Geologist: Rhonald W. Hasenyager, LPG #196-000246
Drilling Method: Hollow Stem Auger Drilling Fluid (Type): None
Logged By: Suzanna L. Keim Date Started: 7/20/2015 Date Finished: 7/21/2015
Report Form Completed By: Suzanna L. Keim Date: 7/24/2015

ANNULAR SPACE DETAILS

	Elevations (MSL)*	Depths (BGS)	(0.01 ft.)
	<u>462.72</u>	<u>-2.06</u>	Top of Protective Casing
	<u>462.54</u>	<u>-1.88</u>	Top of Riser Pipe
Type of Surface Seal: <u>Concrete</u>	<u>460.66</u>	<u>0.00</u>	Ground Surface
Type of Annular Sealant: <u>High-solids bentonite</u>	<u>458.66</u>	<u>2.00</u>	Top of Annular Sealant
Installation Method: <u>Tremie</u>			
Setting Time: <u>>48 hours</u>			
Type of Bentonite Seal -- <input checked="" type="checkbox"/> Granular <input type="checkbox"/> Pellet <input type="checkbox"/> Slurry (choose one)	<u>441.09</u>	<u>19.57</u>	Static Water Level (After Completion) 9/21/2015
Installation Method: <u>Gravity</u>	<u>416.16</u>	<u>44.50</u>	Top of Seal
Setting Time: <u>30 minutes</u>	<u>415.16</u>	<u>45.50</u>	Top of Sand Pack
Type of Sand Pack: <u>Quartz Sand</u>			
Grain Size: <u>10-20</u> (sieve size)	<u>413.11</u>	<u>47.55</u>	Top of Screen
Installation Method: <u>Gravity</u>	<u>403.47</u>	<u>57.19</u>	Bottom of Screen
Type of Backfill Material: <u>n/a</u> (if applicable)	<u>402.99</u>	<u>57.67</u>	Bottom of Well
Installation Method: _____	<u>402.99</u>	<u>57.67</u>	Bottom of Borehole

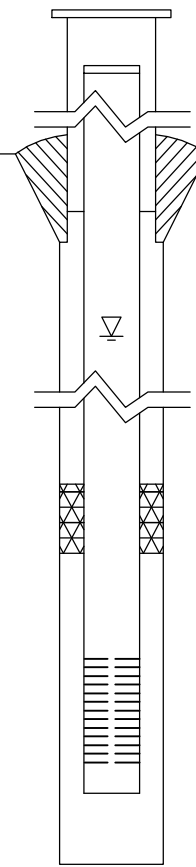

* Referenced to a National Geodetic Datum

WELL CONSTRUCTION MATERIALS
(Choose one type of material for each area)

Protective Casing	SS304	SS316	PTFE	PVC	OTHER: <input checked="" type="checkbox"/> Steel
Riser Pipe Above W.T.	SS304	SS316	PTFE	<input checked="" type="checkbox"/> PVC	OTHER:
Riser Pipe Below W.T.	SS304	SS316	PTFE	<input checked="" type="checkbox"/> PVC	OTHER:
Screen	SS304	SS316	PTFE	<input checked="" type="checkbox"/> PVC	OTHER:

CASING MEASUREMENTS

Diameter of Borehole	(inches)	8.0
ID of Riser Pipe	(inches)	2.0
Protective Casing Length	(feet)	5.0
Riser Pipe Length	(feet)	49.43
Bottom of Screen to End Cap	(feet)	0.48
Screen Length (1st slot to last slot)	(feet)	9.64
Total Length of Casing	(feet)	59.55
Screen Slot Size **	(inches)	0.010



Site #: _____ County: Peoria County Well #: AW-09

Site Name: Edwards Power Station Borehole #: AW-09

State _____
Plane Coordinate: X 2,434,857.0 Y 1,429,340.1 (or) Latitude: _____ Longitude: _____

Surveyed By: Gary C. Rogers IL Registration #: 035-002957

Drilling Contractor: Ramsey Geotechnical Engineering, LLC Driller: B. Williamson

Consulting Firm: Hanson Professional Services Inc. Geologist: Rhonald W. Hasenyager, LPG #196-000246

Drilling Method: Hollow Stem Auger Drilling Fluid (Type): None

Logged By: Suzanna L. Keim Date Started: 7/29/2015 Date Finished: 8/3/2015

Report Form Completed By: Suzanna L. Keim Date: 8/7/2015

ANNULAR SPACE DETAILS

	Elevations (MSL)*	Depths (BGS)	(0.01 ft.)
	<u>461.65</u>	<u>-3.33</u>	Top of Protective Casing
	<u>461.45</u>	<u>-3.13</u>	Top of Riser Pipe
Type of Surface Seal: <u>Concrete</u>	<u>458.32</u>	<u>0.00</u>	Ground Surface
Type of Annular Sealant: <u>High-solids bentonite</u>	<u>455.82</u>	<u>2.50</u>	Top of Annular Sealant
Installation Method: <u>Tremie</u>			
Setting Time: <u>>24 hours</u>			
Type of Bentonite Seal -- <input checked="" type="checkbox"/> Granular <input type="checkbox"/> Pellet <input type="checkbox"/> Slurry (choose one)	<u>432.22</u>	<u>26.10</u>	Static Water Level (After Completion) 9/23/2015
Installation Method: <u>Gravity</u>	<u>415.12</u>	<u>43.20</u>	Top of Seal
Setting Time: <u>30 minutes</u>	<u>413.22</u>	<u>45.10</u>	Top of Sand Pack
Type of Sand Pack: <u>Quartz Sand</u>			
Grain Size: <u>10-20</u> (sieve size)	<u>411.18</u>	<u>47.14</u>	Top of Screen
Installation Method: <u>Gravity</u>	<u>406.70</u>	<u>51.62</u>	Bottom of Screen
Type of Backfill Material: <u>n/a</u> (if applicable)	<u>406.09</u>	<u>52.23</u>	Bottom of Well
Installation Method: _____	<u>406.09</u>	<u>52.23</u>	Bottom of Borehole

* Referenced to a National Geodetic Datum

CASING MEASUREMENTS

Diameter of Borehole	(inches)	6.0
ID of Riser Pipe	(inches)	2.0
Protective Casing Length	(feet)	5.0
Riser Pipe Length	(feet)	50.27
Bottom of Screen to End Cap	(feet)	0.61
Screen Length (1st slot to last slot)	(feet)	4.48
Total Length of Casing	(feet)	55.36
Screen Slot Size **	(inches)	0.010

WELL CONSTRUCTION MATERIALS
(Choose one type of material for each area)

Protective Casing	SS304	SS316	PTFE	PVC	OTHER: <input checked="" type="checkbox"/> Steel
Riser Pipe Above W.T.	SS304	SS316	PTFE	<input checked="" type="checkbox"/> PVC	OTHER:
Riser Pipe Below W.T.	SS304	SS316	PTFE	<input checked="" type="checkbox"/> PVC	OTHER:
Screen	SS304	SS316	PTFE	<input checked="" type="checkbox"/> PVC	OTHER:



Site #: County: Peoria County Well #: AW-10
Site Name: Edwards Power Station Borehole #: AW-10
State
Plane Coordinate: X 2,436,231.4 Y 1,429,461.1 (or) Latitude: Longitude:
Surveyed By: Gary C. Rogers IL Registration #: 035-002957
Drilling Contractor: Ramsey Geotechnical Engineering, LLC Driller: B. Williamson
Consulting Firm: Hanson Professional Services Inc. Geologist: Rhonald W. Hasenyager, LPG #196-000246
Drilling Method: Hollow Stem Auger Drilling Fluid (Type): None
Logged By: Suzanna L. Keim Date Started: 7/23/2015 Date Finished: 7/23/2015
Report Form Completed By: Suzanna L. Keim Date: 7/24/2015

ANNULAR SPACE DETAILS

Diagram of well construction with elevations and depths table. Includes details for surface seal, annular sealant, bentonite seal, sand pack, and screen.

* Referenced to a National Geodetic Datum

WELL CONSTRUCTION MATERIALS
(Choose one type of material for each area)

Table with 6 columns: Material Type, SS304, SS316, PTFE, PVC, OTHER. Rows include Protective Casing, Riser Pipe Above W.T., Riser Pipe Below W.T., and Screen.

CASING MEASUREMENTS

Table with 3 columns: Measurement, Unit, Value. Rows include Diameter of Borehole, ID of Riser Pipe, Protective Casing Length, Riser Pipe Length, Bottom of Screen to End Cap, Screen Length, Total Length of Casing, and Screen Slot Size.



Site #: County: Peoria County Well #: AW-11
Site Name: Edwards Power Station Borehole #: AW-11
State
Plane Coordinate: X 2,436,251.1 Y 1,428,196.3 (or) Latitude: Longitude:
Surveyed By: Gary C. Rogers IL Registration #: 035-002957
Drilling Contractor: Ramsey Geotechnical Engineering, LLC Driller: B. Williamson
Consulting Firm: Hanson Professional Services Inc. Geologist: Rhonald W. Hasenyager, LPG #196-000246
Drilling Method: Hollow Stem Auger Drilling Fluid (Type): None
Logged By: Rhonald W. Hasenyager Date Started: 7/24/2015 Date Finished: 7/28/2015
Report Form Completed By: Suzanna L. Keim Date: 7/28/2015

ANNULAR SPACE DETAILS

Table with 4 columns: Description, Elevations (MSL)*, Depths (BGS), and (0.01 ft.). Includes a central diagram of a well cross-section. Rows include: Top of Protective Casing (440.08, -2.92), Top of Riser Pipe (439.87, -2.71), Ground Surface (437.16, 0.00), Top of Annular Sealant (435.16, 2.00), Static Water Level (404.91, 32.25), Top of Seal (416.56, 20.60), Top of Sand Pack (414.81, 22.35), Top of Screen (412.95, 24.21), Bottom of Screen (408.35, 28.81), Bottom of Well (407.85, 29.31), Bottom of Borehole (407.16, 30.00).

* Referenced to a National Geodetic Datum

CASING MEASUREMENTS

Table with 3 columns: Measurement, Unit, and Value. Rows include: Diameter of Borehole (8.0 inches), ID of Riser Pipe (2.0 inches), Protective Casing Length (5.0 feet), Riser Pipe Length (26.92 feet), Bottom of Screen to End Cap (0.50 feet), Screen Length (4.60 feet), Total Length of Casing (32.02 feet), Screen Slot Size (0.010 inches).

WELL CONSTRUCTION MATERIALS
(Choose one type of material for each area)

Table with 6 columns: Material Type, SS304, SS316, PTFE, PVC, OTHER. Rows include: Protective Casing (Steel), Riser Pipe Above W.T. (PVC), Riser Pipe Below W.T. (PVC), Screen (PVC).



Site #: _____ County: Peoria Well #: AP05S
Site Name: Edwards Power Station Borehole #: AP05S
State _____
Plane Coordinate: X 2,436,746.6 Y 1,432,405.6 (or) Latitude: 40° 35' 55.705" Longitude: -89° 39' 42.875"
Surveyed By: Andrew D. Canopy IL Registration #: 035-003391
Drilling Contractor: Bulldog Drilling, Inc. Driller: C. Dutton
Consulting Firm: Hanson Professional Services Inc. Geologist: Rhonald W. Hasenyager, LPG #196-000246
Drilling Method: Hollow Stem Auger Drilling Fluid (Type): _____
Logged By: Rhonald W. Hasenyager Date Started: 11/28/2016 Date Finished: 11/29/2016
Report Form Completed By: Rhonald W. Hasenyager Date: 1/12/2017

ANNULAR SPACE DETAILS

Diagram of well construction with elevations and depths table. Includes details for surface seal, annular sealant, sand pack, and screen.

WELL CONSTRUCTION MATERIALS
(Choose one type of material for each area)


Table with 6 columns: Material Type, SS304, SS316, PTFE, PVC, OTHER. Rows include Protective Casing, Riser Pipe Above W.T., Riser Pipe Below W.T., and Screen.

CASING MEASUREMENTS

Table with 3 columns: Measurement, Unit, Value. Rows include Diameter of Borehole, ID of Riser Pipe, Protective Casing Length, Riser Pipe Length, Bottom of Screen to End Cap, Screen Length, Total Length of Casing, and Screen Slot Size.

ATTACHMENT 4 – MAPS OF THE DIRECTION OF GROUNDWATER FLOW

Y:\Mapping\Projects\22285\MXD\GW_Contours\Round_01\NR1_Edwards_AP_GW_Contours.mxd Author: stolbszd Date/Time: 7/30/2017 6:13:32 PM

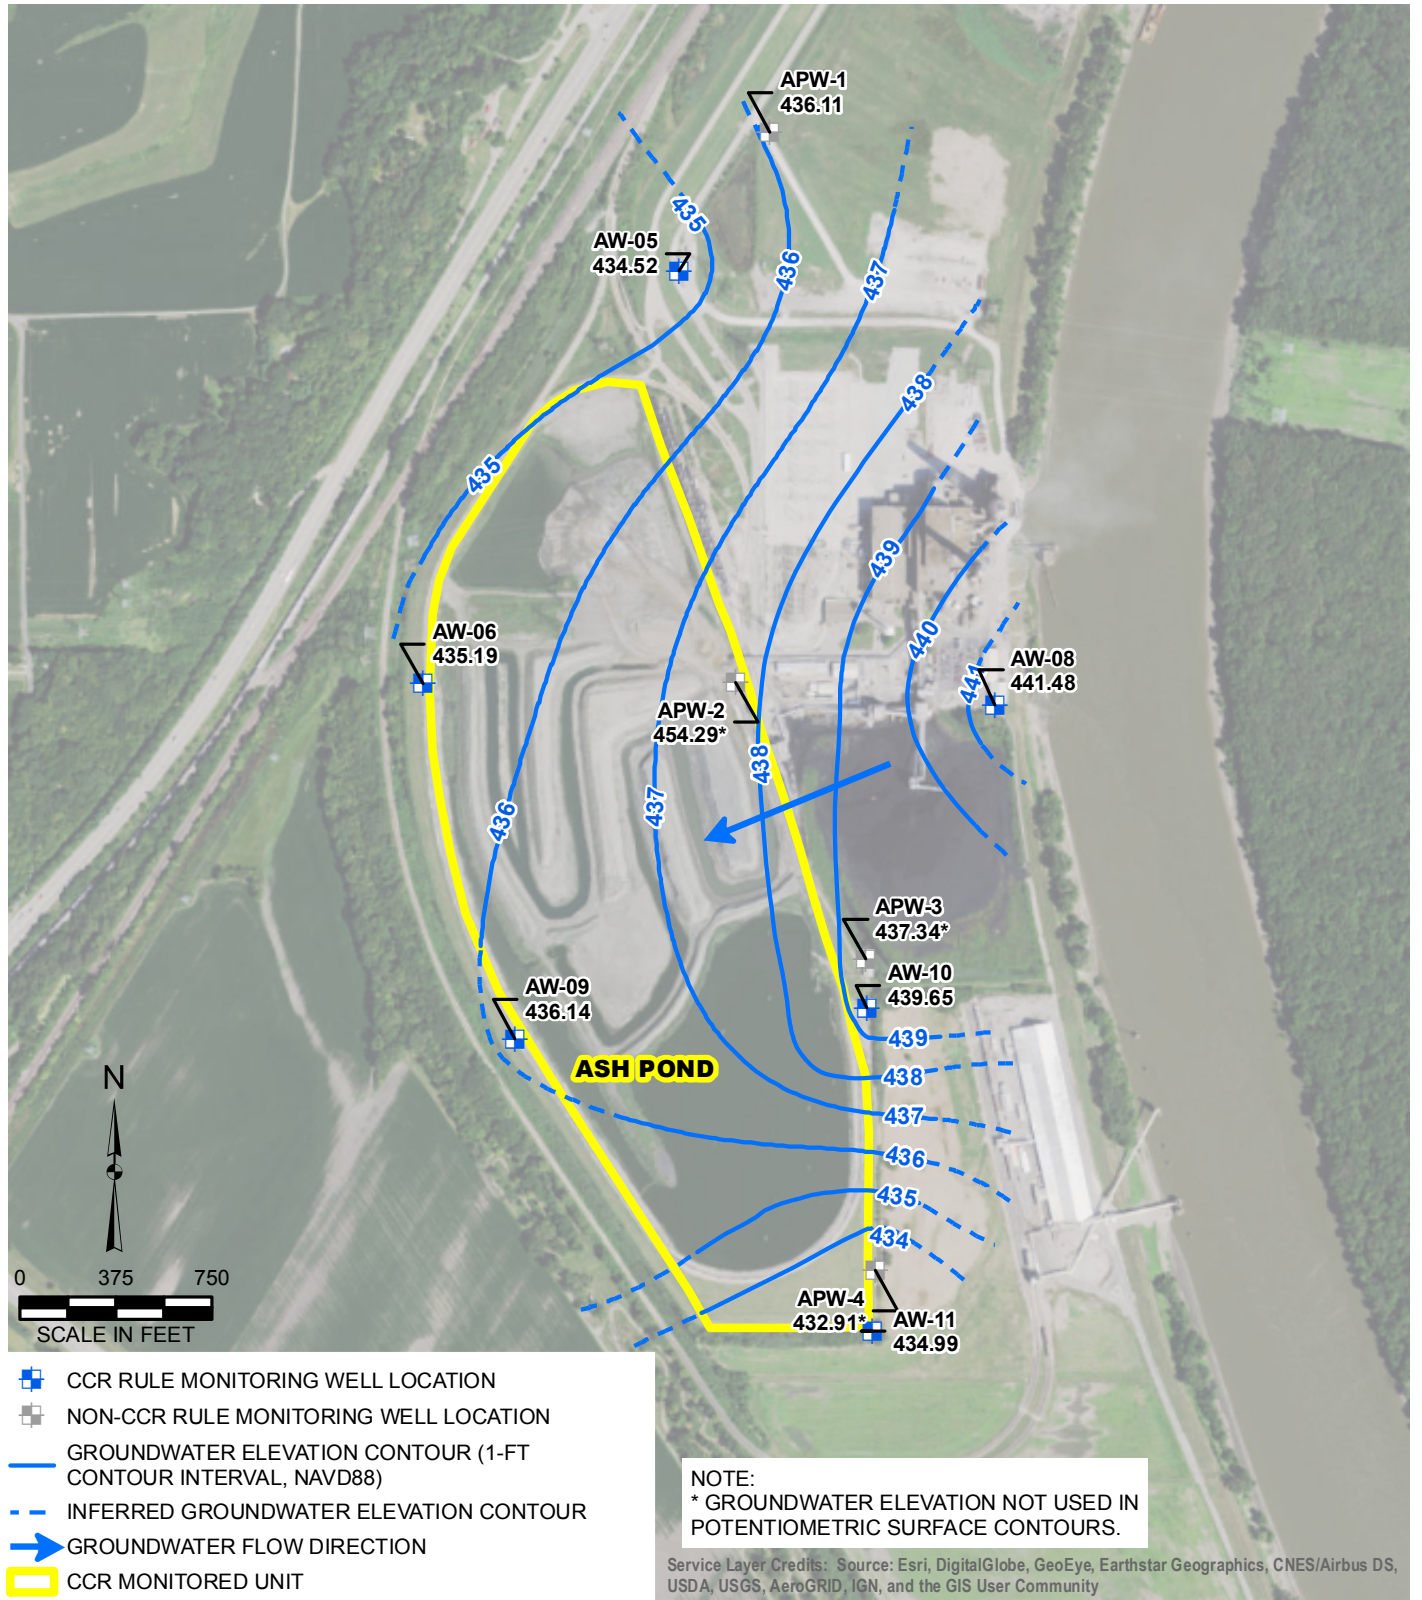

**EDWARDS ASH POND (UNIT ID: 301)
UPPERMOST AQUIFER UNIT
GROUNDWATER ELEVATION CONTOUR MAP
ROUND 1: DECEMBER 21, 2015**

DYNEGY CCR RULE GROUNDWATER MONITORING
EDWARDS POWER STATION
BARTONSVILLE, ILLINOIS


PROJECT NO: 2285

FIGURE NO: 1



DRAWN BY/DATE:
SDS 1/23/17
REVIEWED BY/DATE:
ANS 1/25/17
APPROVED BY/DATE:
JJW 2/7/17

Y:\Mapping\Projects\222285\MXD\GW_Contours\Round_02\R2_Edwards_AP_GW_Contours.mxd Author: stolbszd Date/Time: 7/30/2017 6:16:55 PM

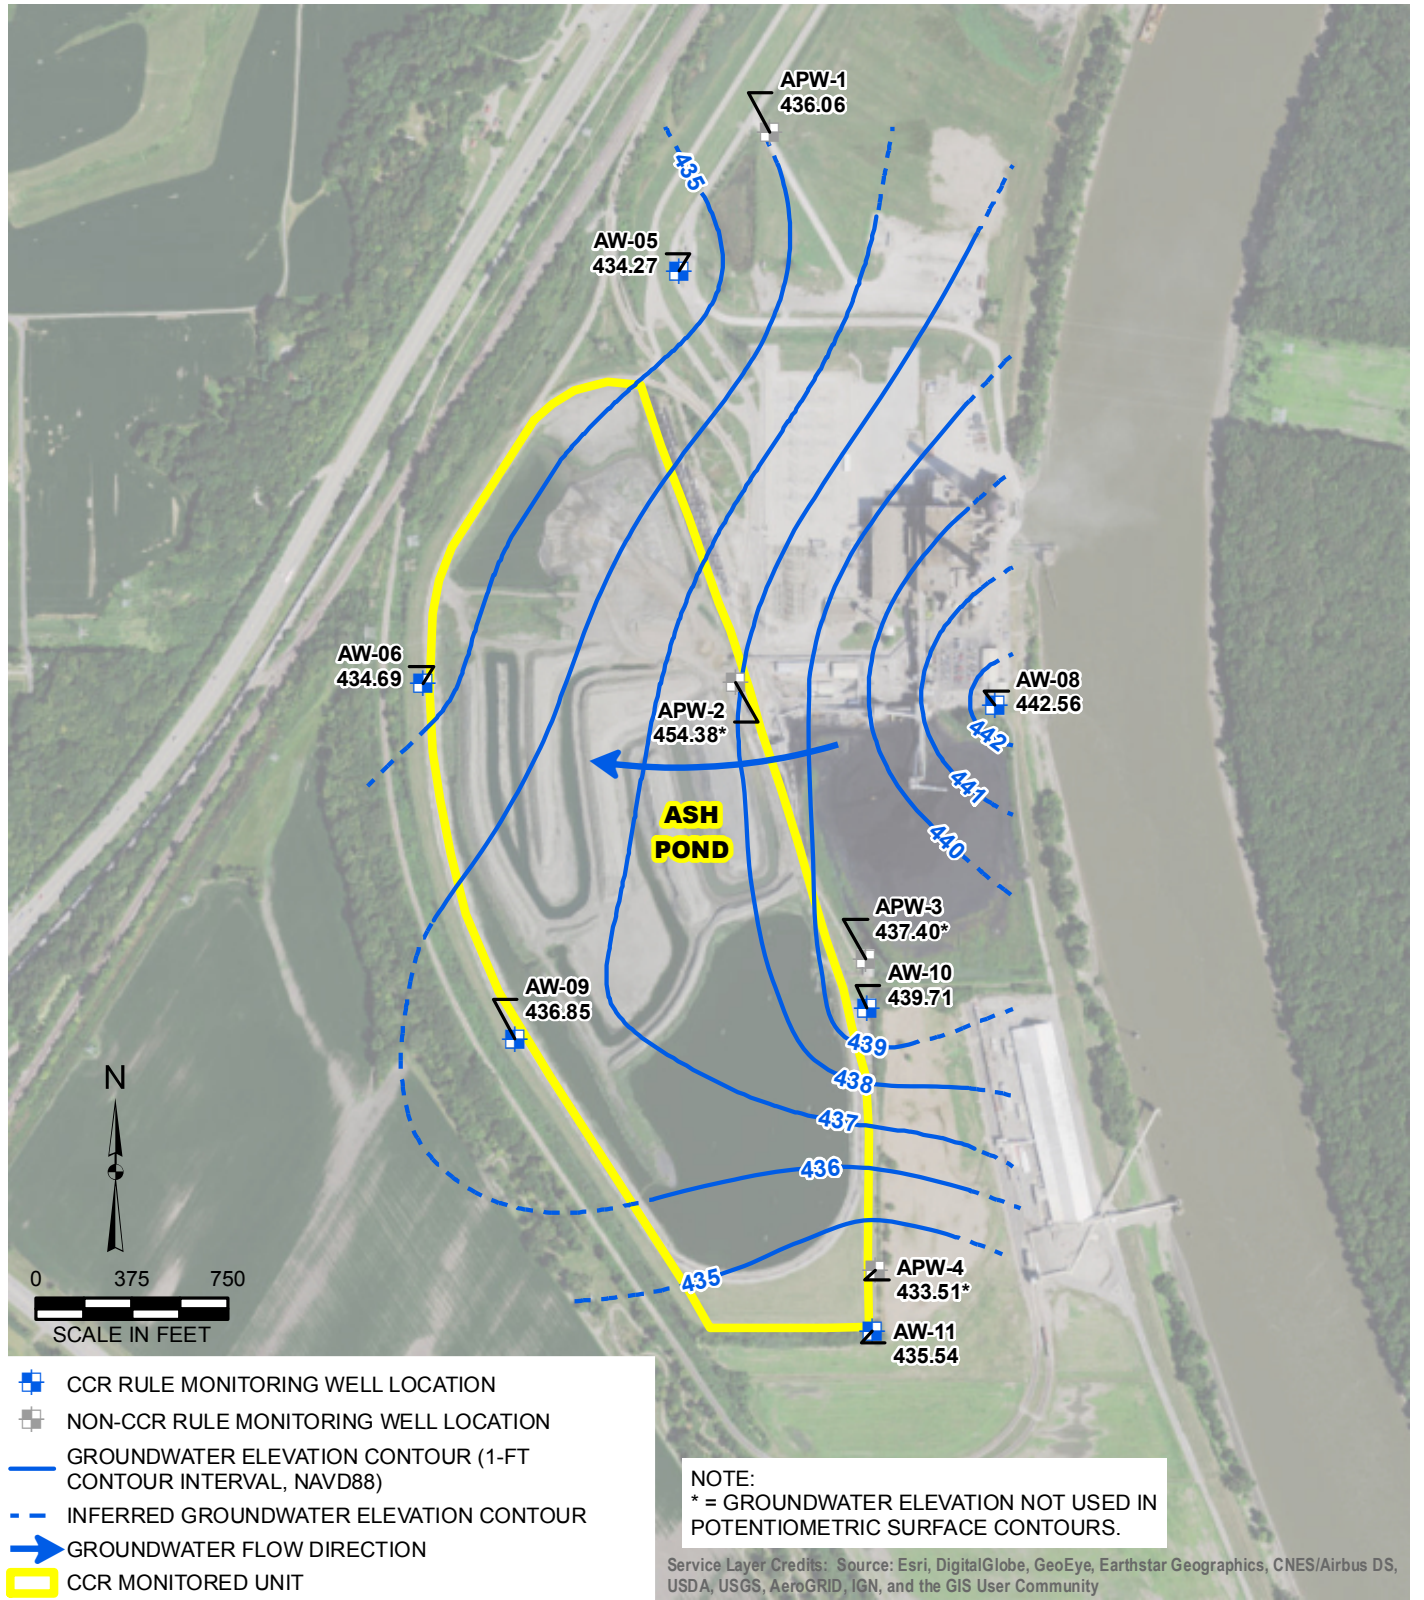

**EDWARDS ASH POND (UNIT ID: 301)
UPPERMOST AQUIFER UNIT
GROUNDWATER ELEVATION CONTOUR MAP
ROUND 2: FEBRUARY 17, 2016**

DYNEGY CCR RULE GROUNDWATER MONITORING
EDWARDS POWER STATION
BARTONSVILLE, ILLINOIS


PROJECT NO: 2285

FIGURE NO: 1



DRAWN BY/DATE:
SDS 1/23/17
REVIEWED BY/DATE:
ANS 1/25/17
APPROVED BY/DATE:
JJW 2/8/17

Y:\Mapping\Projects\222285\MXD\GW_Contours\Round_03\R3_Edwards_AP_GW_Contours.mxd Author: stolzsod Date/Time: 7/30/2017 6:20:26 PM

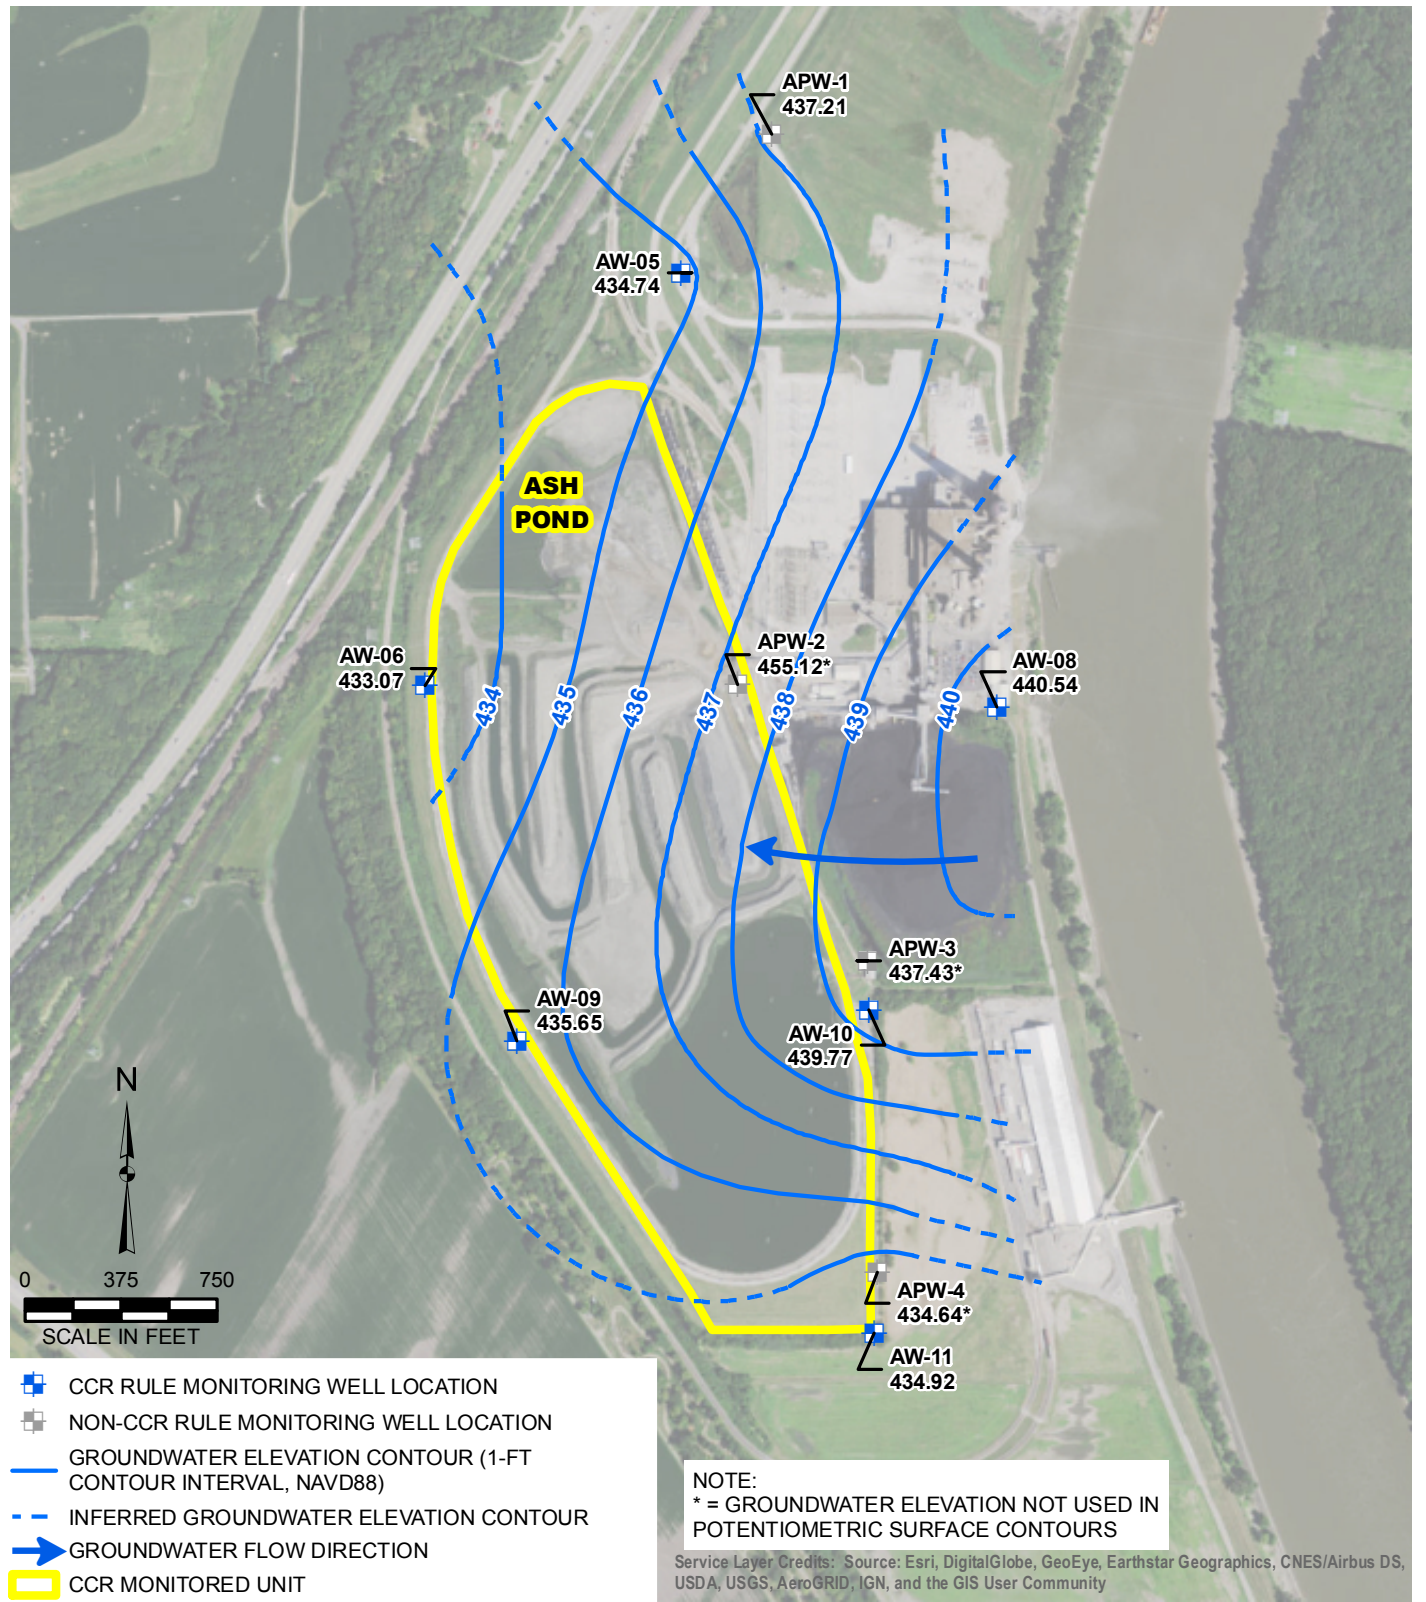

**EDWARDS ASH POND (UNIT ID: 301)
UPPERMOST AQUIFER UNIT
GROUNDWATER ELEVATION CONTOUR MAP
ROUND 3: MAY 17, 2016**


PROJECT NO: 2285
FIGURE NO: 1

DRAWN BY/DATE:
SDS 1/23/17
REVIEWED BY/DATE:
ANS 1/25/17
APPROVED BY/DATE:
JJW 2/8/17

DYNEGY CCR RULE GROUNDWATER MONITORING
EDWARDS POWER STATION
BARTONSVILLE, ILLINOIS



Y:\Mapping\Projects\22285\MXD\GW_Contours\Round_04\R4_Edwards_AP_GW_Contours.mxd Author: stolbsd; Date/Time: 7/30/2017, 6:21:40 PM

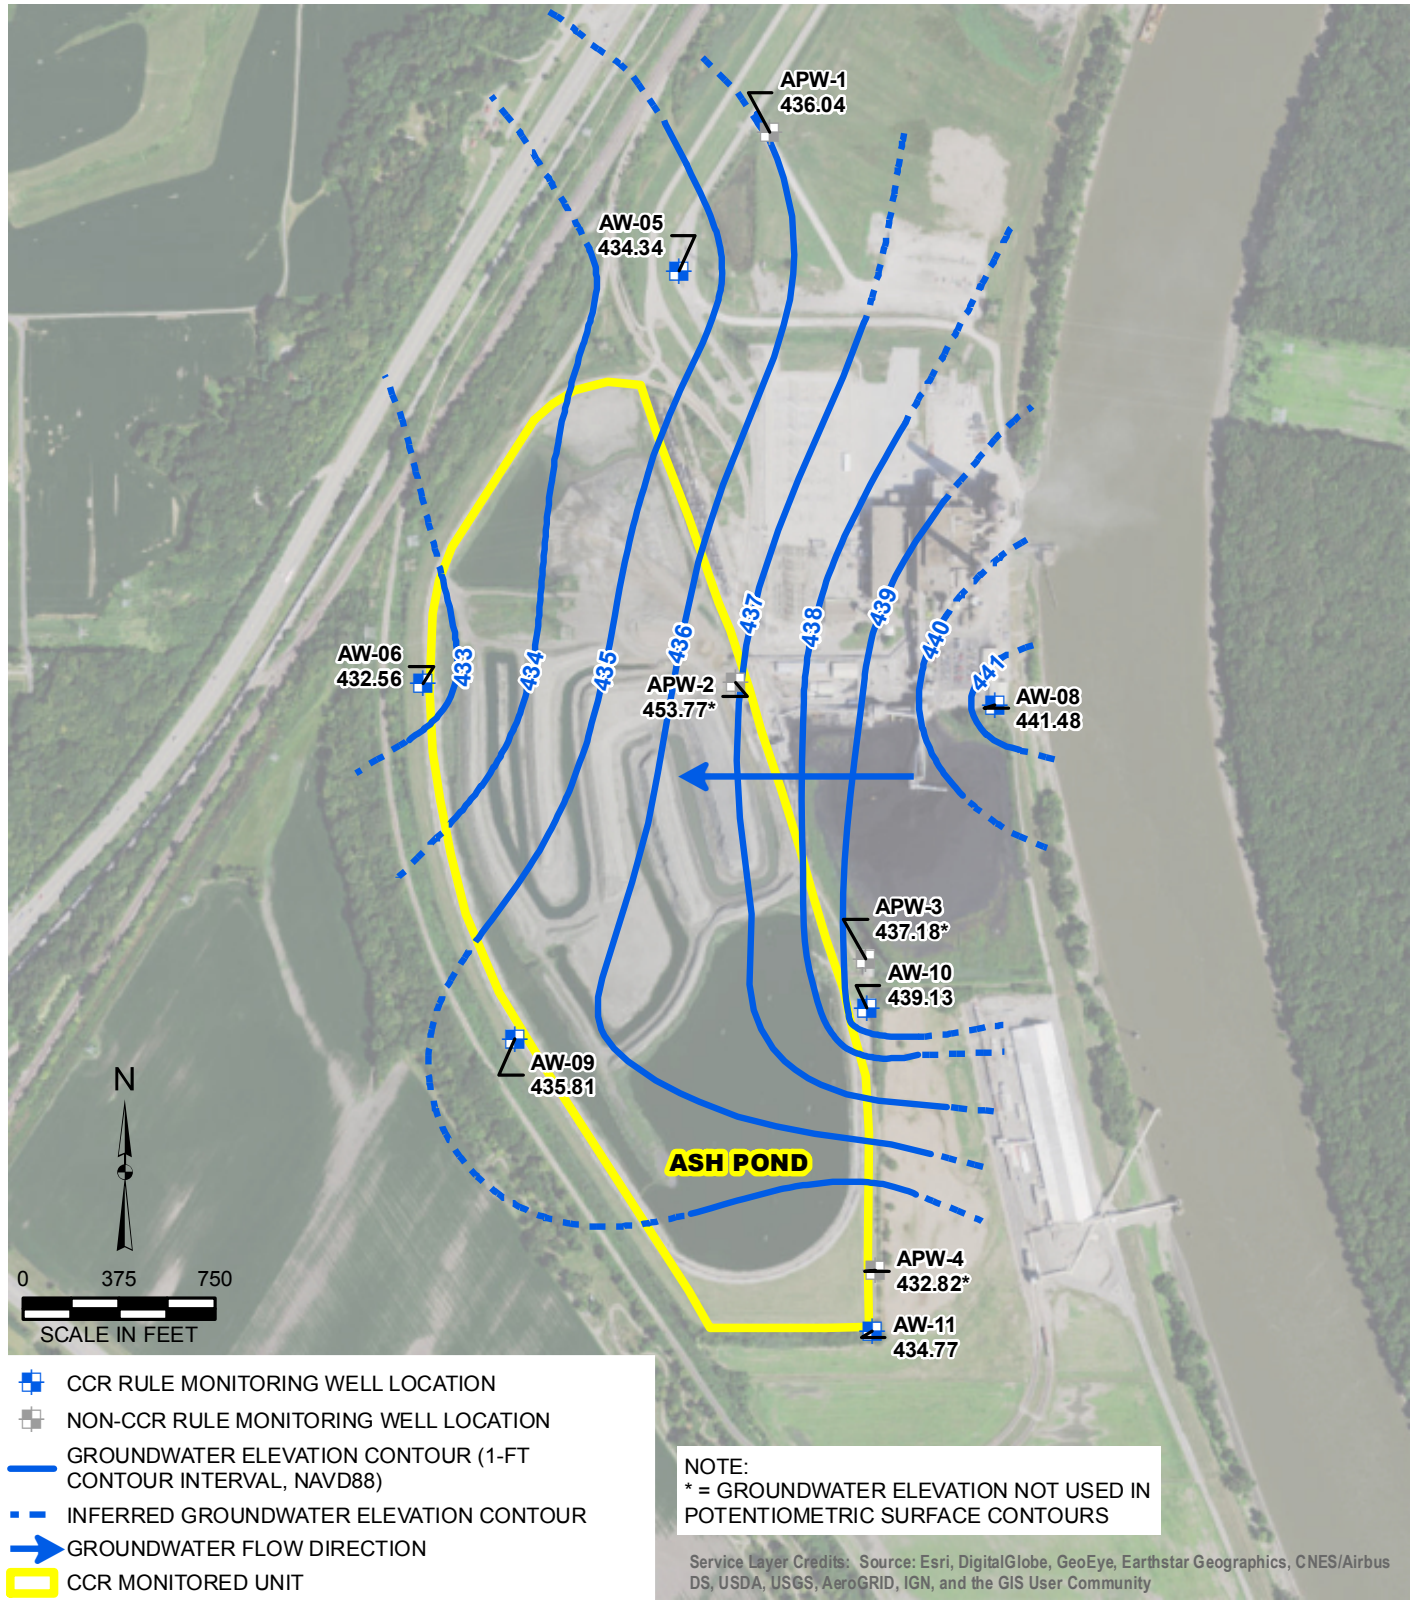

DRAWN BY/DATE:
SDS 1/23/17
REVIEWED BY/DATE:
ANS 1/25/17
APPROVED BY/DATE:
JJW 2/8/17

**EDWARDS ASH POND (UNIT ID: 301)
UPPERMOST AQUIFER UNIT
GROUNDWATER ELEVATION CONTOUR MAP
ROUND 4: JULY 21, 2016**


DYNEGY CCR RULE GROUNDWATER MONITORING
EDWARDS POWER STATION
BARTONSVILLE, ILLINOIS

PROJECT NO: 2285

FIGURE NO: 1



Y:\Mapping\Projects\22285\MXD\GW_Contours\Round_05\R5_Edwards_AP_GW_Contours.mxd Author: stolzsod Date/Time: 9/8/2017, 4:09:07 PM

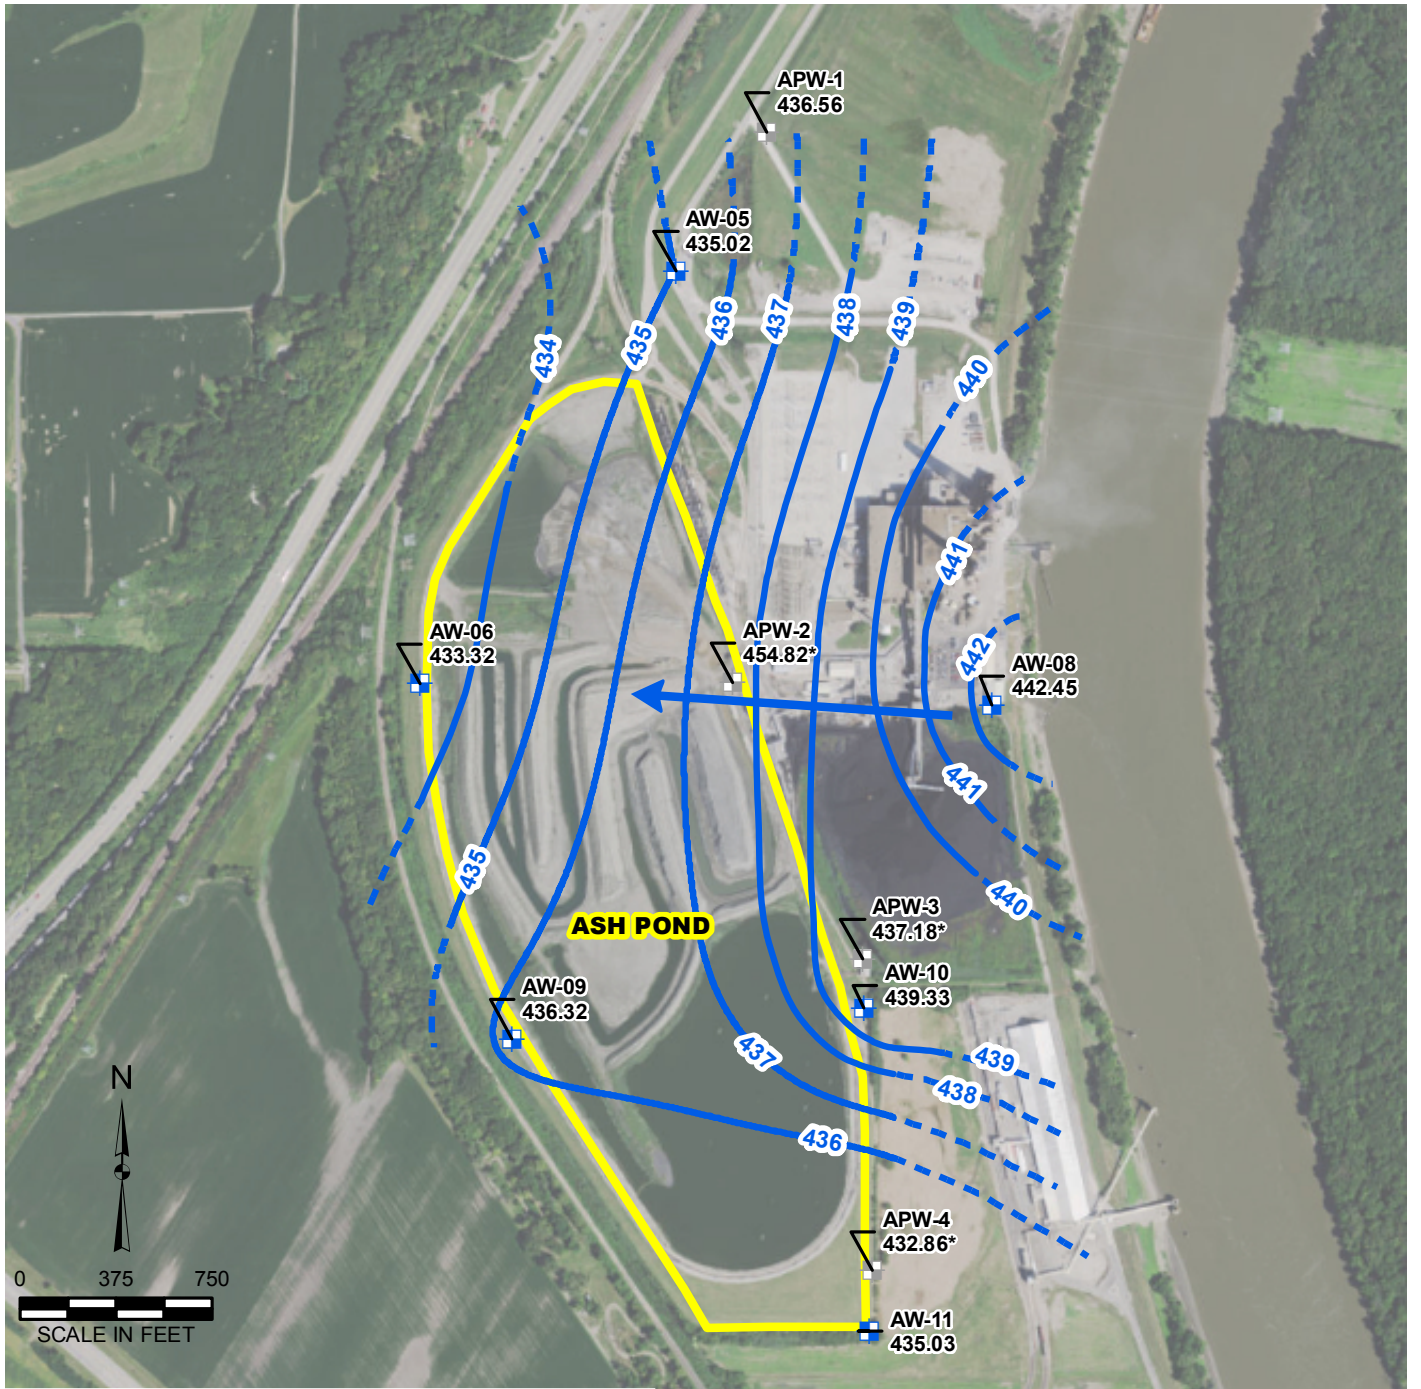

- CCR RULE MONITORING WELL LOCATION
- NON-CCR RULE MONITORING WELL LOCATION
- GROUNDWATER ELEVATION CONTOUR (1-FT INTERVAL)
- INFERRED GROUNDWATER ELEVATION CONTOUR
- GROUNDWATER FLOW DIRECTION
- CCR MONITORED UNIT

NOTE:
 * = GROUNDWATER ELEVATION NOT USED IN POTENTIOMETRIC SURFACE CONTOURS

Service Layer Credits: Source: Esri, DigitalGlobe, GeoEye, Earthstar Geographics, CNES/Airbus DS, USDA, USGS, AeroGRID, IGN, and the GIS User Community

**EDWARDS ASH POND (UNIT ID: 301)
 UPPERMOST AQUIFER UNIT
 GROUNDWATER ELEVATION CONTOUR MAP
 ROUND 5: NOVEMBER 10, 2016**


DRAWN BY/DATE:
 SDS 3/6/17
 REVIEWED BY/DATE:
 ANS 3/6/17
 APPROVED BY/DATE:
 JJW 9/1/17

DYNEGY CCR RULE GROUNDWATER MONITORING
 EDWARDS POWER STATION
 BARTONSVILLE, ILLINOIS

PROJECT NO: 2285
 FIGURE NO: 1



Y:\Mapping\Projects\22285\MXD\GW_Contours\Round_06\R6_Edwards_AP_GW_Contours.mxd Author: stolzsod Date/Time: 9/8/2017, 4:12:36 PM

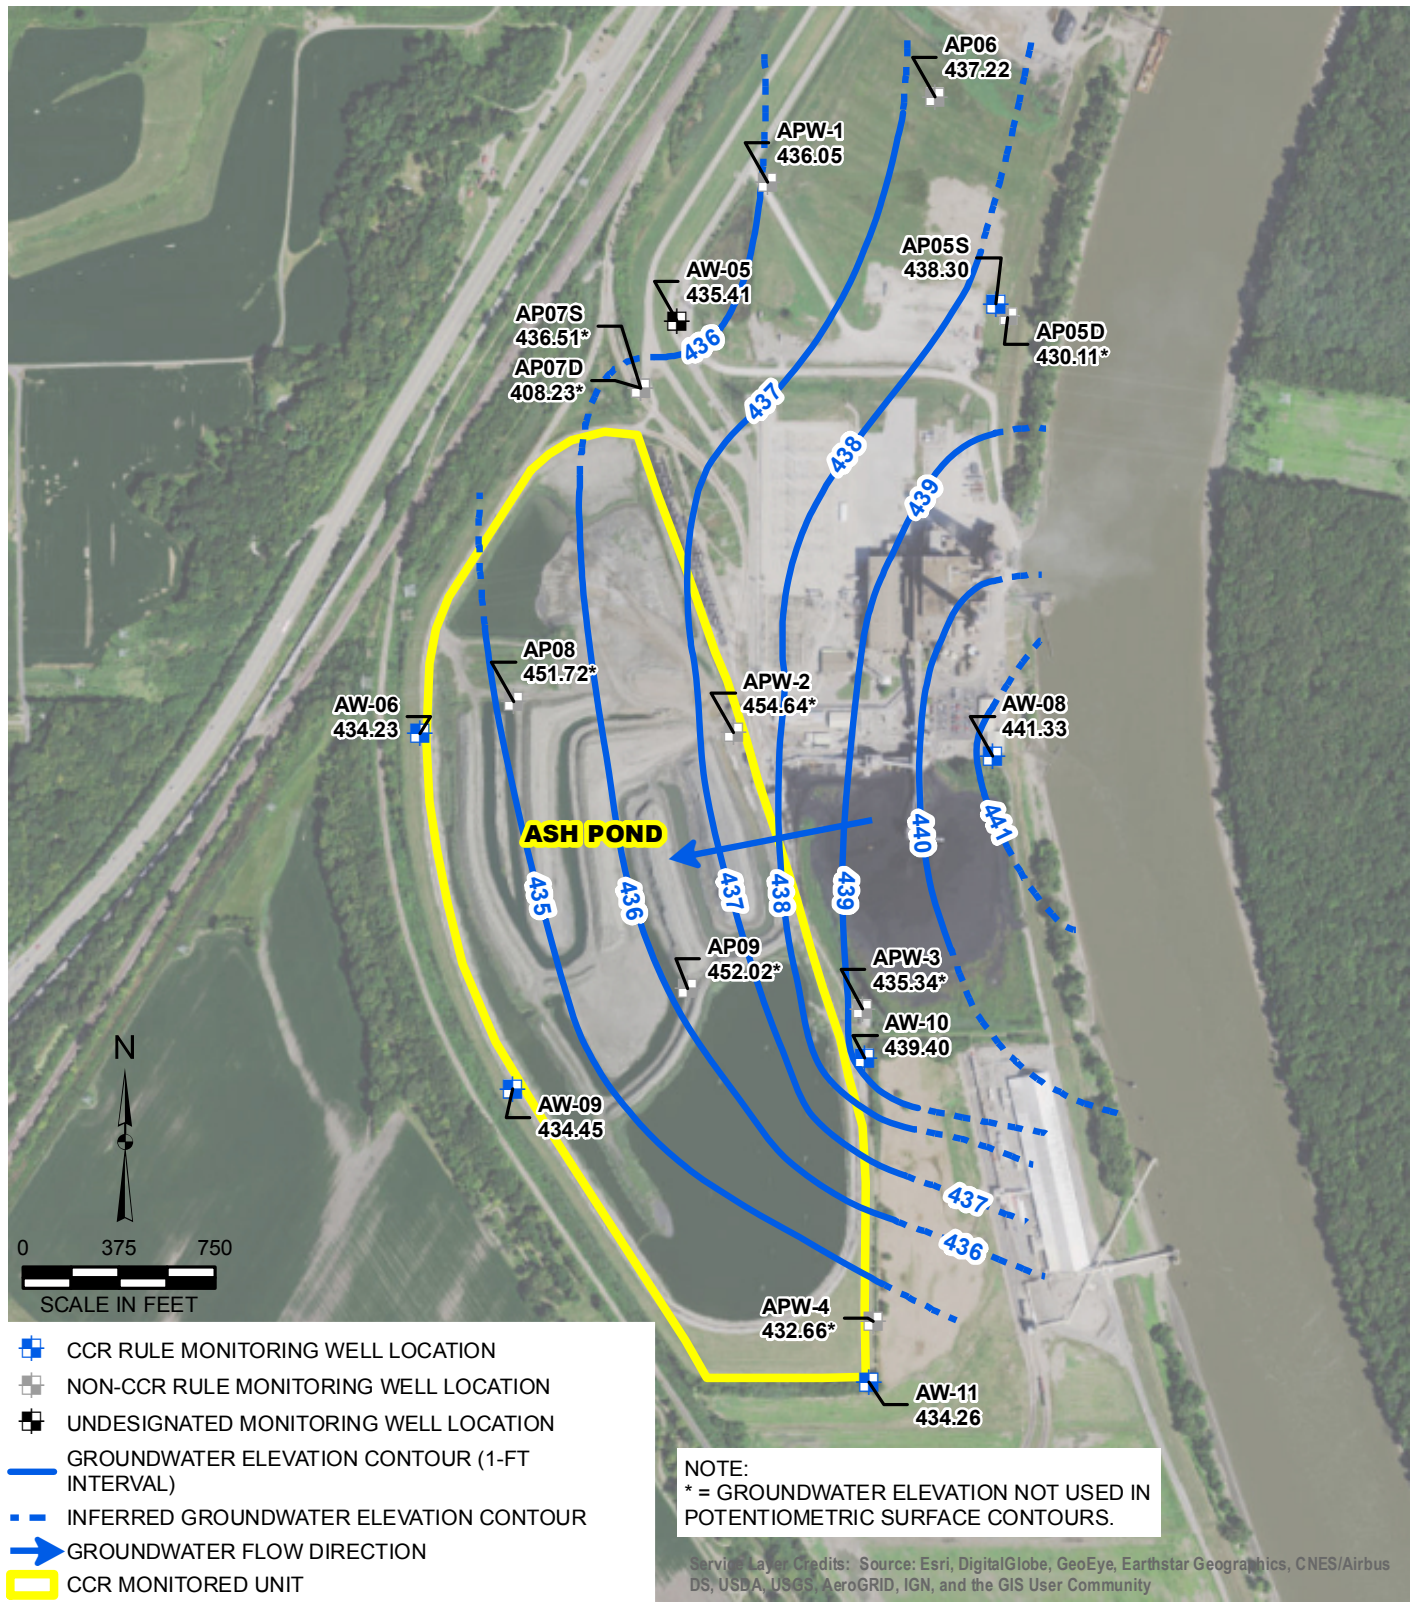

**EDWARDS ASH POND (UNIT ID: 301)
UPPERMOST AQUIFER UNIT
GROUNDWATER ELEVATION CONTOUR MAP
ROUND 6: JANUARY 16, 2017**


DYNEGY CCR RULE GROUNDWATER MONITORING
EDWARDS POWER STATION
BARTONSVILLE, ILLINOIS

PROJECT NO: 2285
FIGURE NO: 1



DRAWN BY/DATE:
SDS 3/6/17
REVIEWED BY/DATE:
ANS 3/6/17
APPROVED BY/DATE:
JJW 9/1/17

Y:\Mapping\Projects\222285\MXD\GW_Contours\Round_07\R7_Edwards_AP_GW_Contours.mxd Author: stolbszd Date/Time: 9/8/2017, 4:15:14 PM

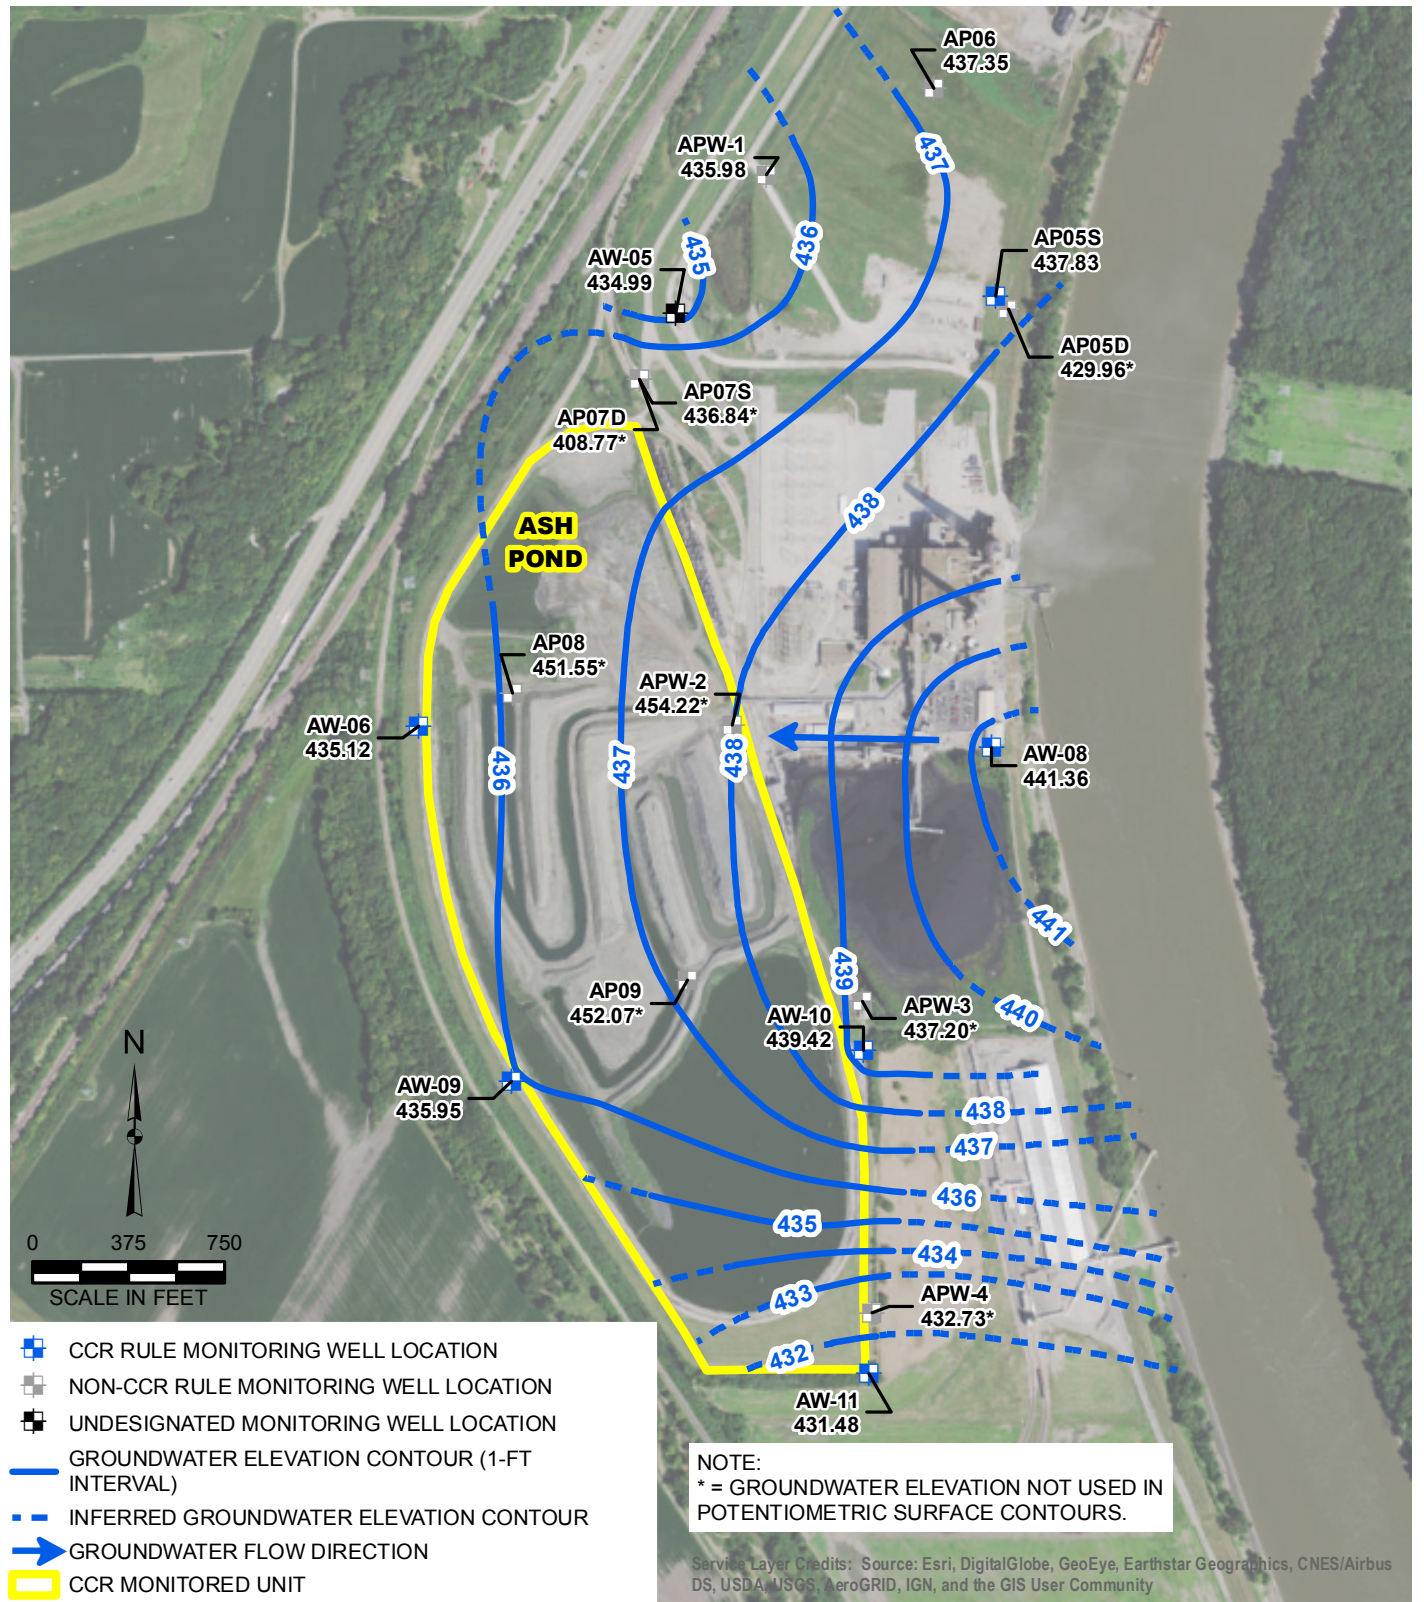

**EDWARDS ASH POND (UNIT ID: 301)
UPPERMOST AQUIFER UNIT
GROUNDWATER ELEVATION CONTOUR MAP
ROUND 7: MAY 8, 2017**


PROJECT NO: 2285
FIGURE NO: 1

DRAWN BY/DATE:
SDS 6/21/17
REVIEWED BY/DATE:
ANS 6/21/17
APPROVED BY/DATE:
JJW 9/1/17

DYNEGY CCR RULE GROUNDWATER MONITORING
EDWARDS POWER STATION
BARTONSVILLE, ILLINOIS



Y:\Mapping\Projects\222285\MXD\GW_Contours\Round_08\R8_Edwards_AP_GW_Contours.mxd Author: stolzsod Date/Time: 9/8/2017, 4:17:36 PM

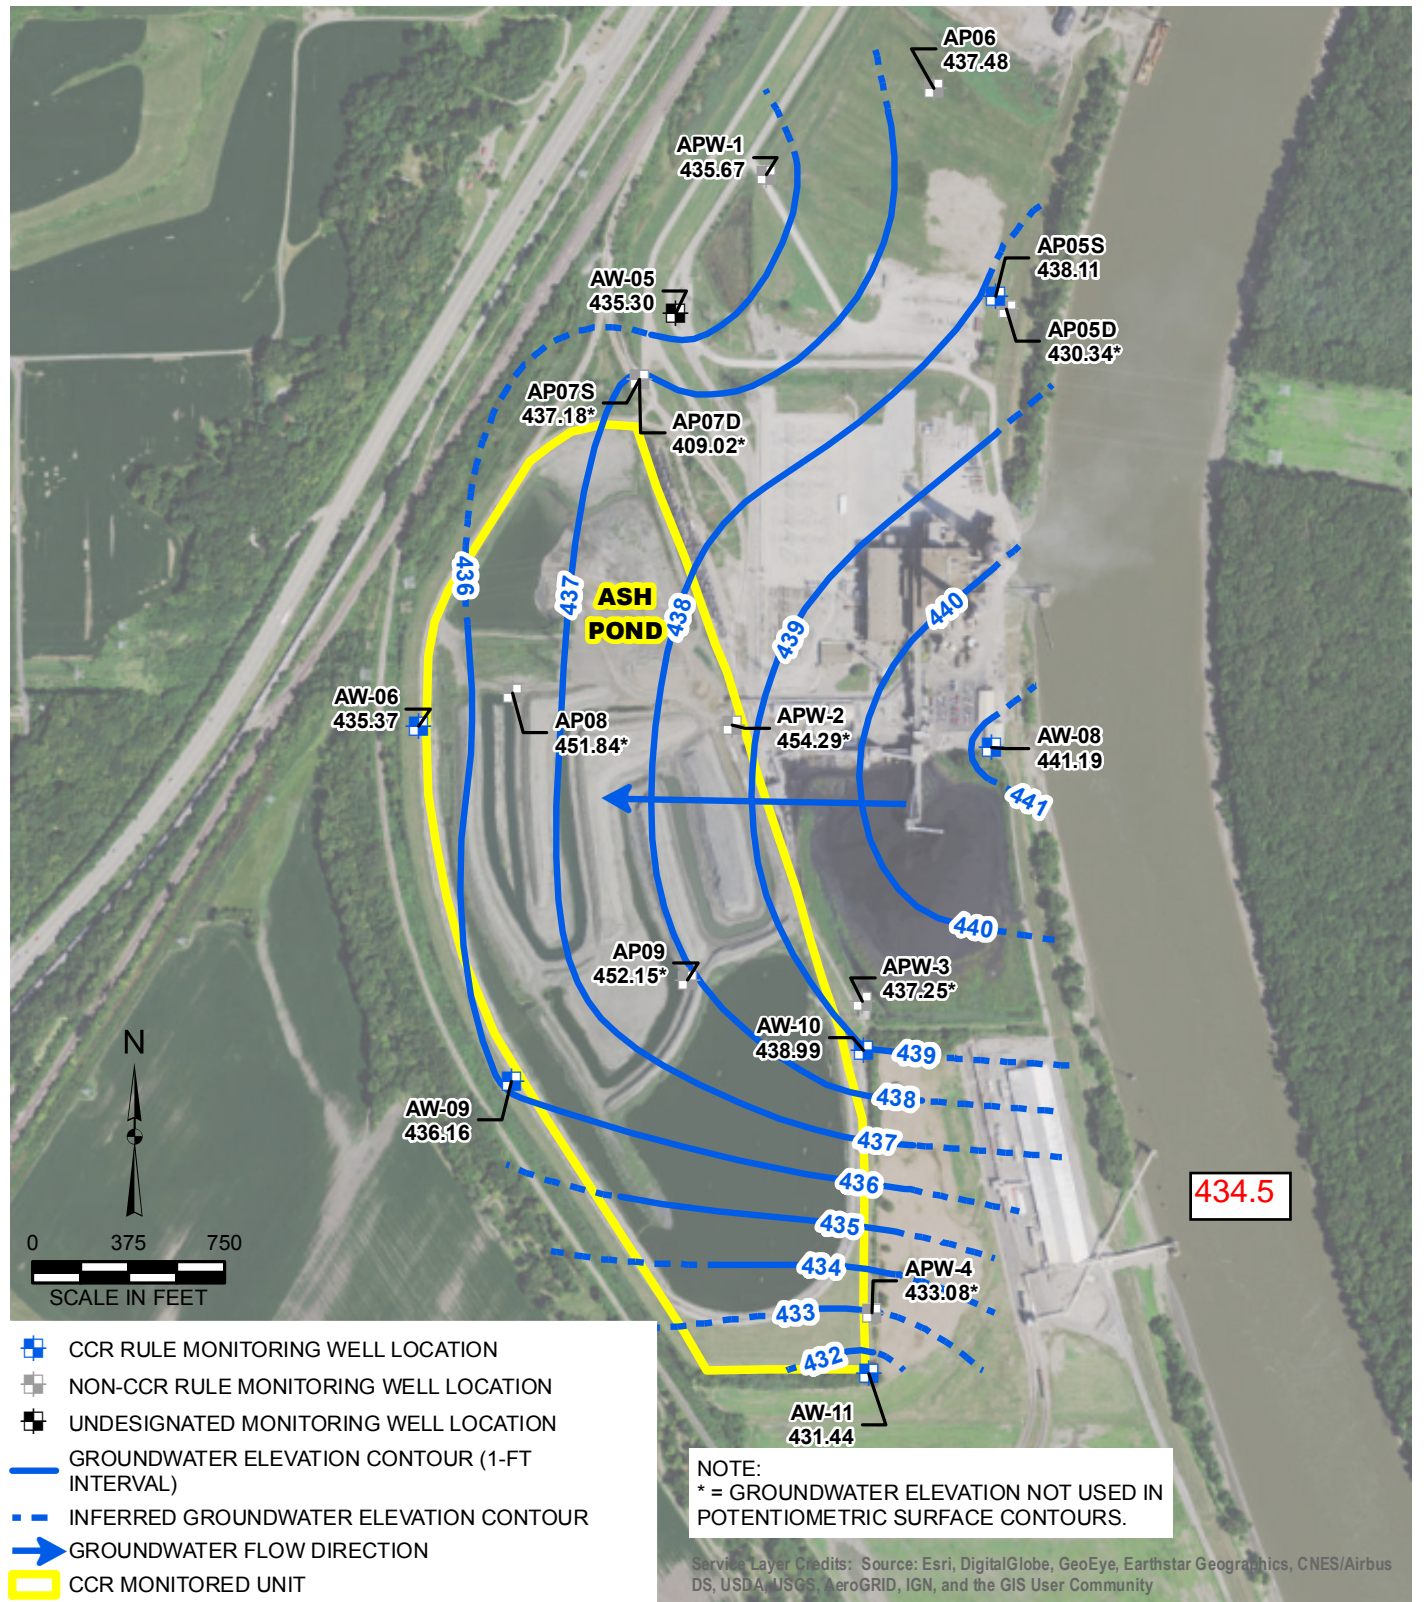

**EDWARDS ASH POND (UNIT ID: 301)
UPPERMOST AQUIFER UNIT
GROUNDWATER ELEVATION CONTOUR MAP
ROUND 8: JULY 19, 2017**

PROJECT NO: 2285
FIGURE NO: 1

DRAWN BY/DATE:
SDS 7/29/17
REVIEWED BY/DATE:
ANS 7/29/17
APPROVED BY/DATE:
JJW 9/1/17


DYNEGY CCR RULE GROUNDWATER MONITORING
EDWARDS POWER STATION
BARTONSVILLE, ILLINOIS



8/13/2020 11:13:30 PM

Service Layer Credits: Source: Esri, Maxar, GeoEye, Earthstar Geographics, CNES/Airbus DS, USDA, USGS, AeroGRID, IGN, and the GIS User Community

Y:\Mapping\Projects\222285\MXD\GW_Contours\Round_09\09_Edwards AP_GW_Contours.mxd

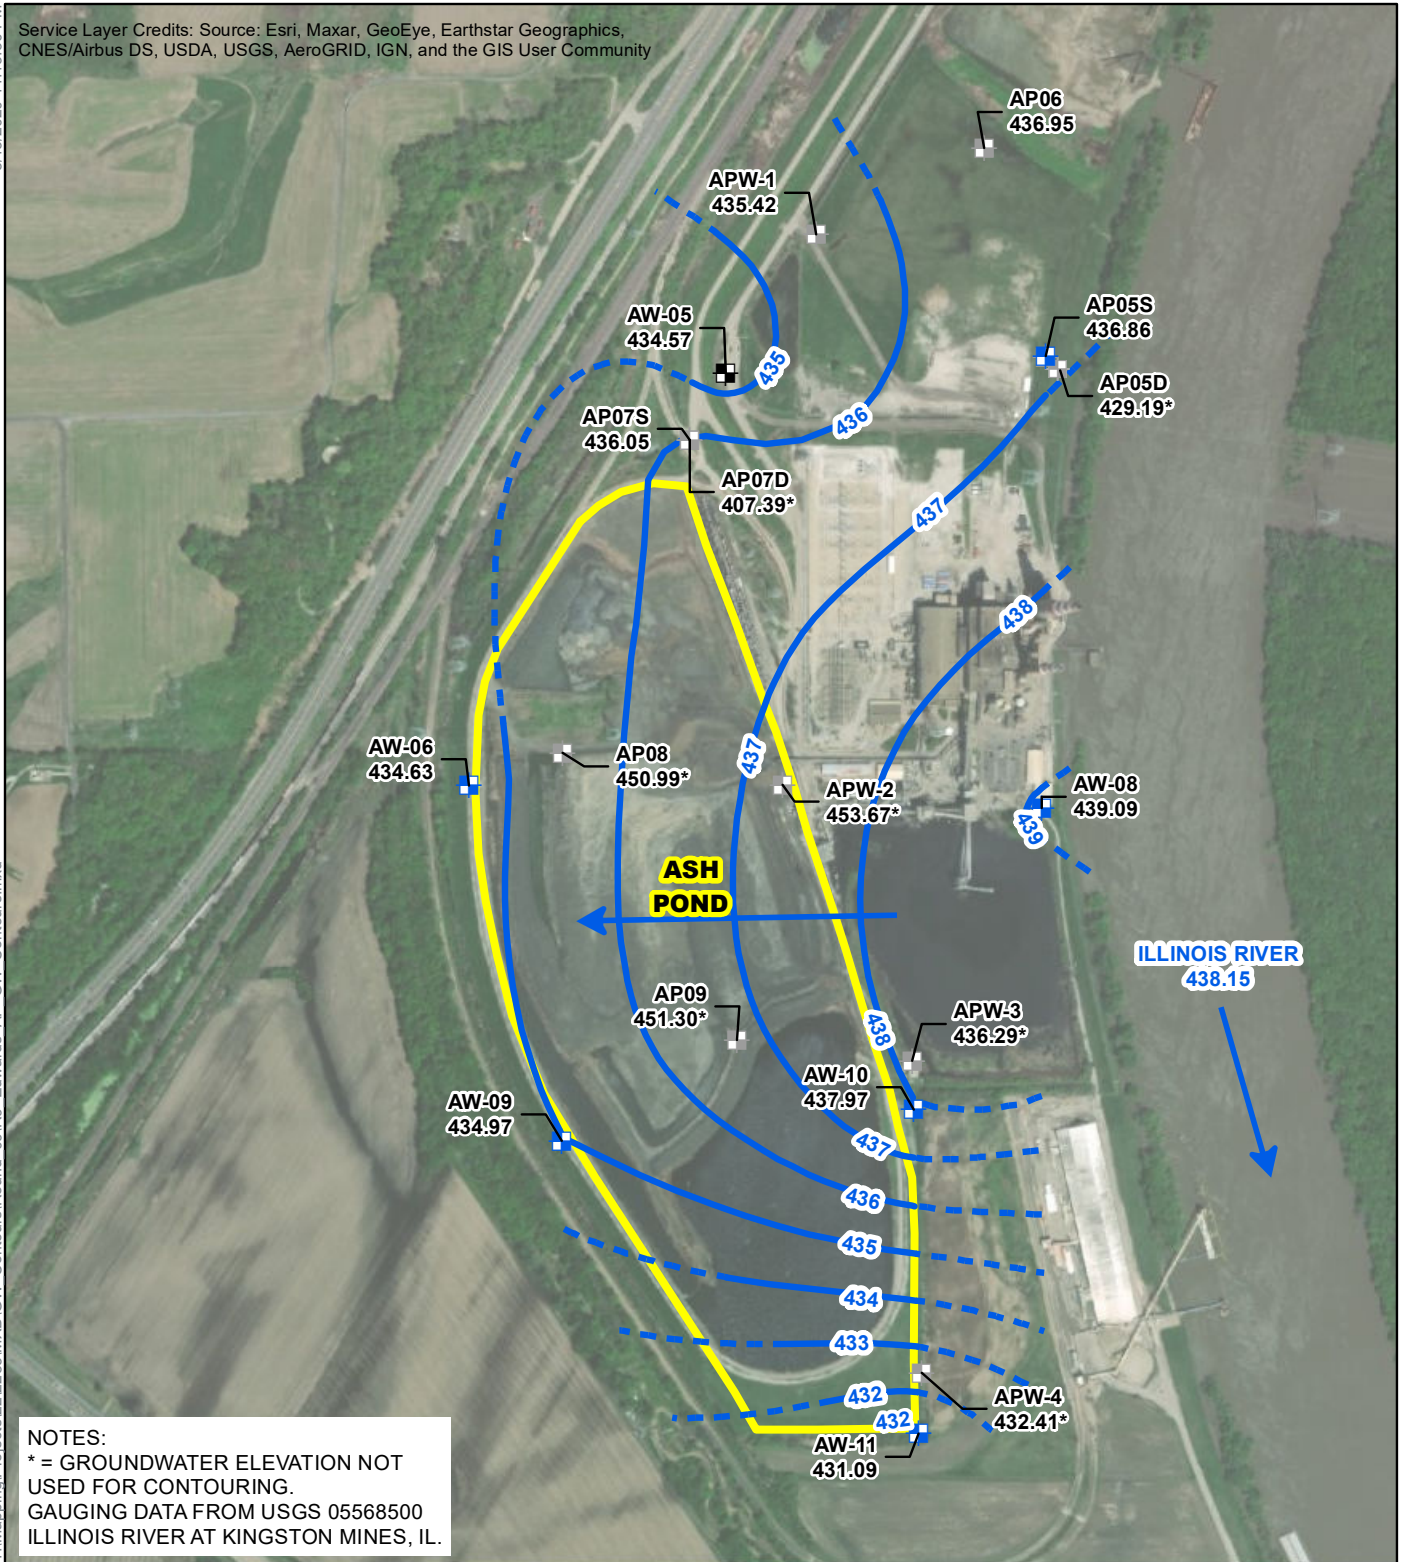


NOTES:
 * = GROUNDWATER ELEVATION NOT USED FOR CONTOURING.
 GAUGING DATA FROM USGS 05568500 ILLINOIS RIVER AT KINGSTON MINES, IL.

- CCR RULE MONITORING WELL LOCATION
- NON-CCR RULE MONITORING WELL LOCATION
- UNDESIGNATED MONITORING WELL LOCATION
- GROUNDWATER ELEVATION CONTOUR (1-FT CONTOUR INTERVAL, NAVD88)
- INFERRED GROUNDWATER ELEVATION CONTOUR
- GROUNDWATER FLOW DIRECTION
- CCR MONITORED UNIT


**EDWARDS ASH POND (UNIT ID: 301)
 GROUNDWATER ELEVATION CONTOUR MAP
 NOVEMBER 1, 2017**

CCR RULE GROUNDWATER MONITORING
 EDWARDS POWER STATION
 BARTONVILLE, ILLINOIS



Service Layer Credits: Source: Esri, Maxar, GeoEye, Earthstar Geographics, CNES/Airbus DS, USDA, USGS, AeroGRID, IGN, and the GIS User Community

Y:\Mapping\Projects\22\2285\MXD\GW_Contours\Round_2018_20\Round_2018_20_Edwards_AP_GW_Contours.mxd

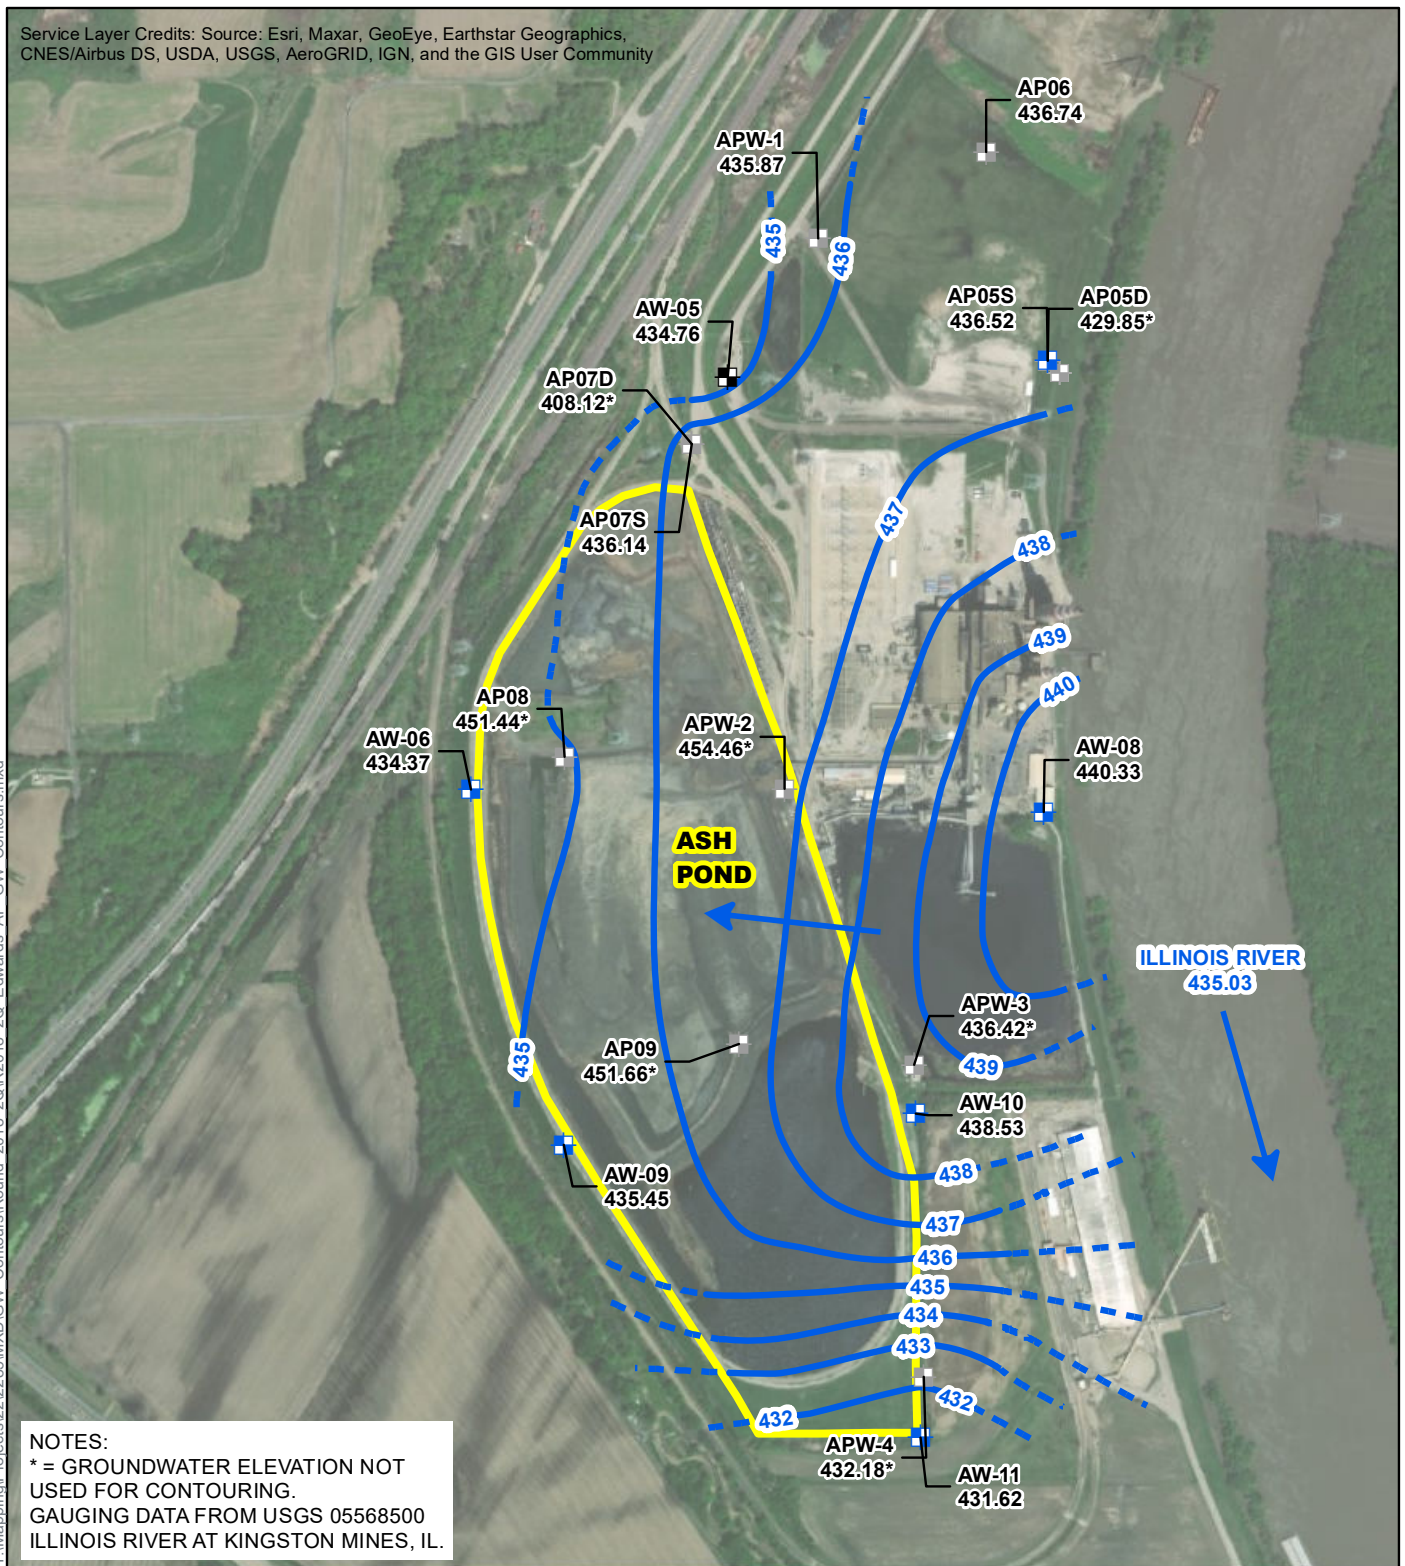


NOTES:
 * = GROUNDWATER ELEVATION NOT USED FOR CONTOURING.
 GAUGING DATA FROM USGS 05568500 ILLINOIS RIVER AT KINGSTON MINES, IL.

- CCR RULE MONITORING WELL LOCATION
- NON-CCR RULE MONITORING WELL LOCATION
- UNDESIGNATED MONITORING WELL LOCATION
- GROUNDWATER ELEVATION CONTOUR (1-FT CONTOUR INTERVAL, NAVD88)
- INFERRED GROUNDWATER ELEVATION CONTOUR
- GROUNDWATER FLOW DIRECTION
- CCR MONITORED UNIT

**EDWARDS ASH POND (UNIT ID: 301)
 GROUNDWATER ELEVATION CONTOUR MAP
 MAY 4, 2018**


CCR RULE GROUNDWATER MONITORING
 EDWARDS POWER STATION
 BARTONVILLE, ILLINOIS



8/13/2020 11:12:43 PM

Service Layer Credits: Source: Esri, Maxar, GeoEye, Earthstar Geographics, CNES/Airbus DS, USDA, USGS, AeroGRID, IGN, and the GIS User Community

Y:\Mapping\Projects\222285\MXD\GW_Contours\Round_2018_30\Round_2018_30_Edwards_AP_GW_Contours.mxd

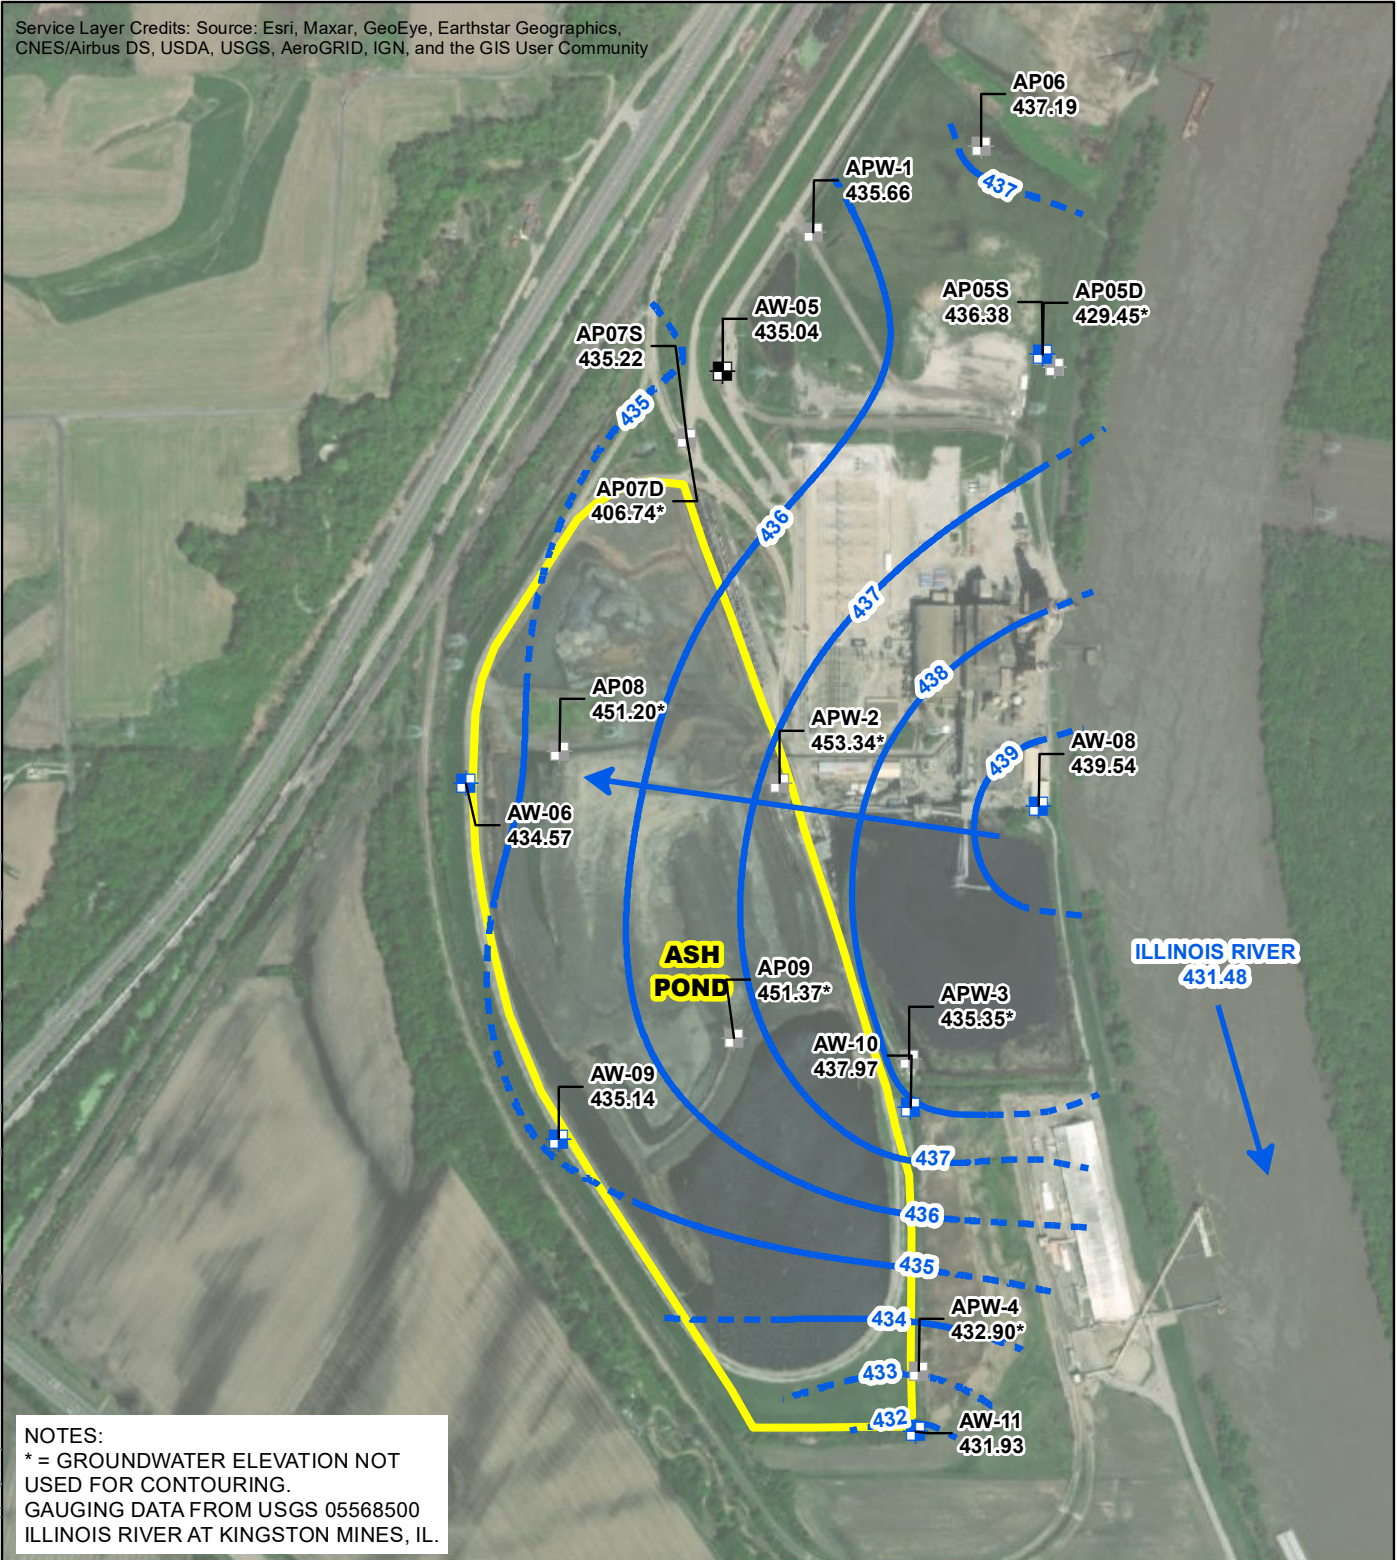


NOTES:
 * = GROUNDWATER ELEVATION NOT USED FOR CONTOURING.
 GAUGING DATA FROM USGS 05568500 ILLINOIS RIVER AT KINGSTON MINES, IL.

- CCR RULE MONITORING WELL LOCATION
- NON-CCR RULE MONITORING WELL LOCATION
- UNDESIGNATED MONITORING WELL LOCATION
- GROUNDWATER ELEVATION CONTOUR (1-FT CONTOUR INTERVAL, NAVD88)
- INFERRED GROUNDWATER ELEVATION CONTOUR
- GROUNDWATER FLOW DIRECTION
- CCR MONITORED UNIT

**EDWARDS ASH POND (UNIT ID: 301)
 GROUNDWATER ELEVATION CONTOUR MAP
 JULY 26, 2018**


CCR RULE GROUNDWATER MONITORING
 EDWARDS POWER STATION
 BARTONVILLE, ILLINOIS



8/13/2020 11:07:18 PM

Service Layer Credits: Source: Esri, Maxar, GeoEye, Earthstar Geographics, CNES/Airbus DS, USDA, USGS, AeroGRID, IGN, and the GIS User Community

Y:\Mapping\Projects\22\2285\MXD\GW_Contours\Round_2019_10\Round_2019_10_Edwards_AP_GW_Contours.mxd

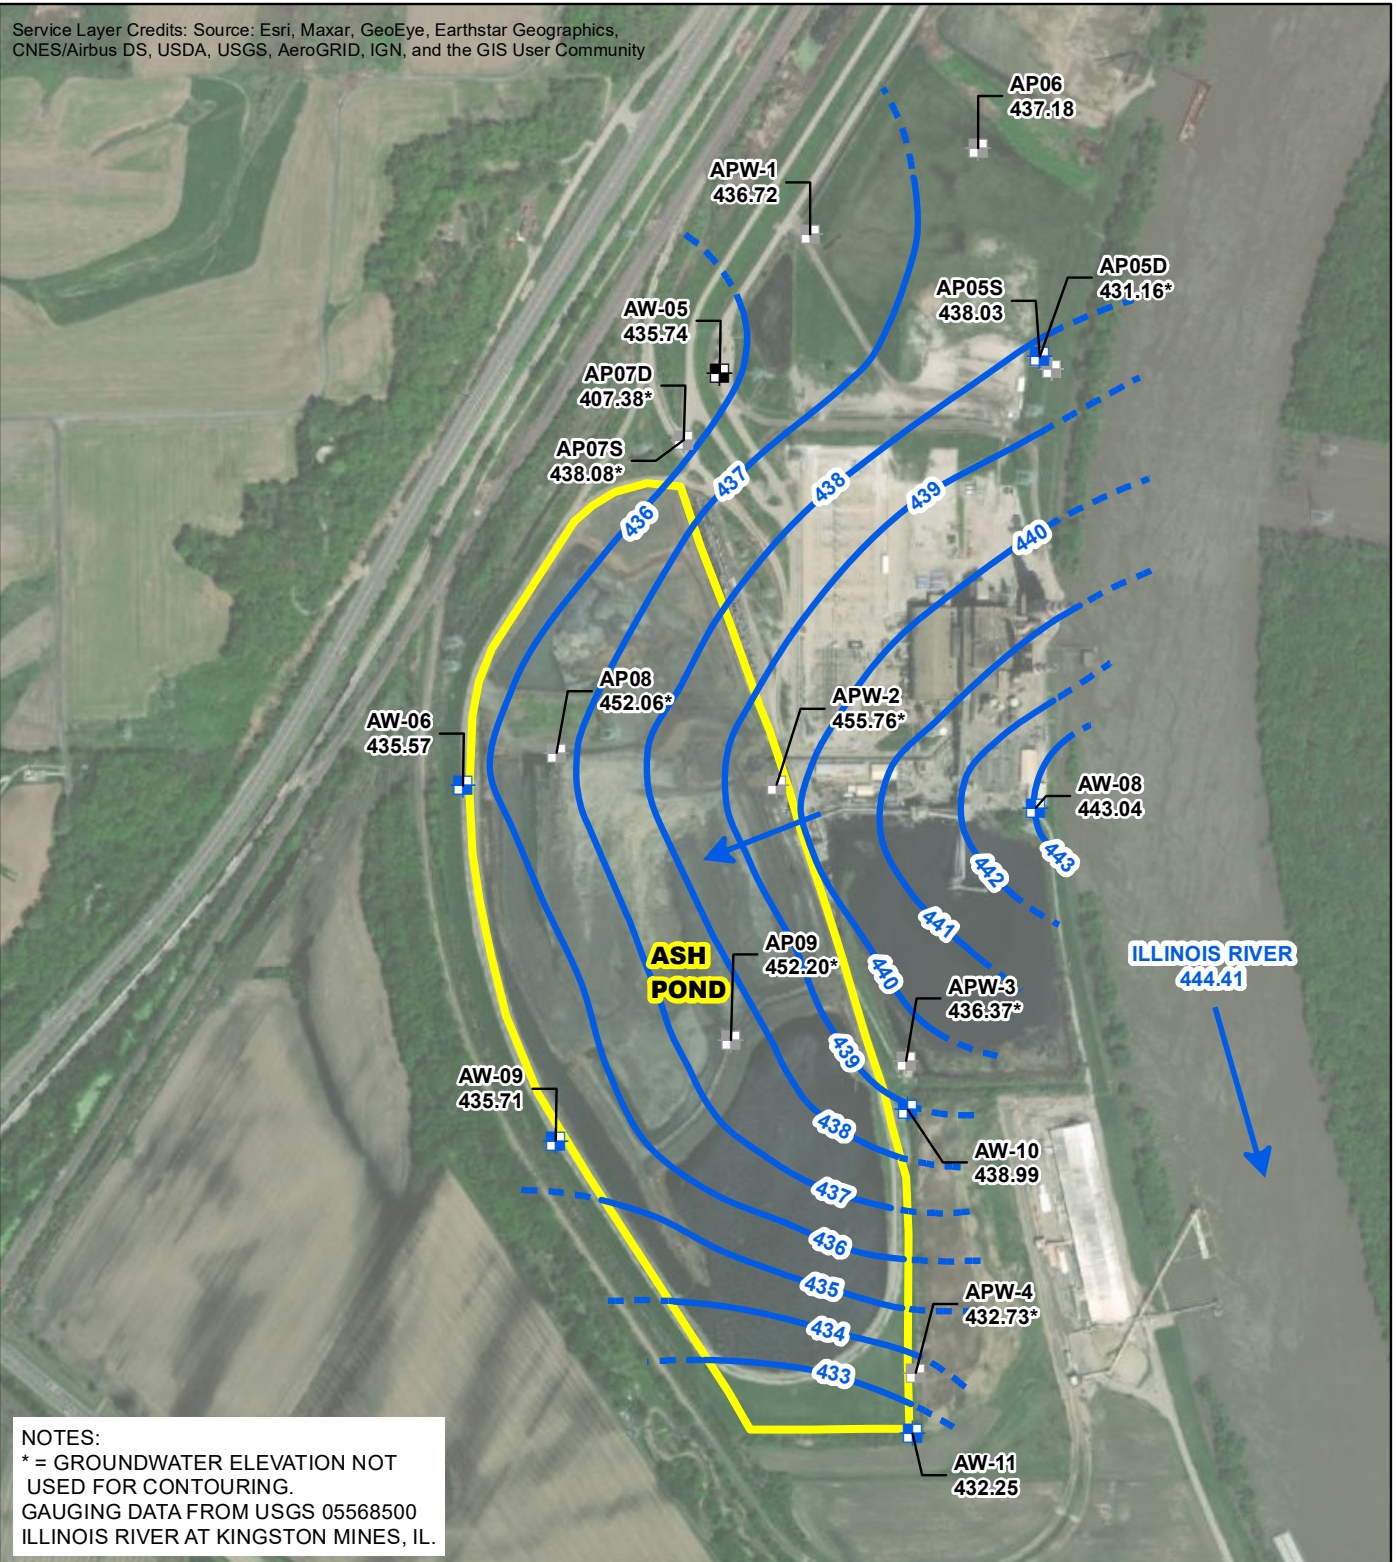


NOTES:
 * = GROUNDWATER ELEVATION NOT USED FOR CONTOURING.
 GAUGING DATA FROM USGS 05568500 ILLINOIS RIVER AT KINGSTON MINES, IL.

- CCR RULE MONITORING WELL LOCATION
- NON-CCR RULE MONITORING WELL LOCATION
- UNDESIGNATED MONITORING WELL LOCATION
- GROUNDWATER ELEVATION CONTOUR (1-FT CONTOUR INTERVAL, NAVD88)
- INFERRED GROUNDWATER ELEVATION CONTOUR
- GROUNDWATER FLOW DIRECTION
- CCR MONITORED UNIT

**EDWARDS ASH POND (UNIT ID: 301)
 GROUNDWATER ELEVATION CONTOUR MAP
 FEBRUARY 25, 2019**


CCR RULE GROUNDWATER MONITORING
 EDWARDS POWER STATION
 BARTONVILLE, ILLINOIS



8/13/2020 11:08:16 PM

Service Layer Credits: Source: Esri, Maxar, GeoEye, Earthstar Geographics, CNES/Airbus DS, USDA, USGS, AeroGRID, IGN, and the GIS User Community

Y:\Mapping\Projects\222285\MXD\GW_Contours\Round_2019_30\Round2019_30_Edwards_AP_GW_Contours.mxd

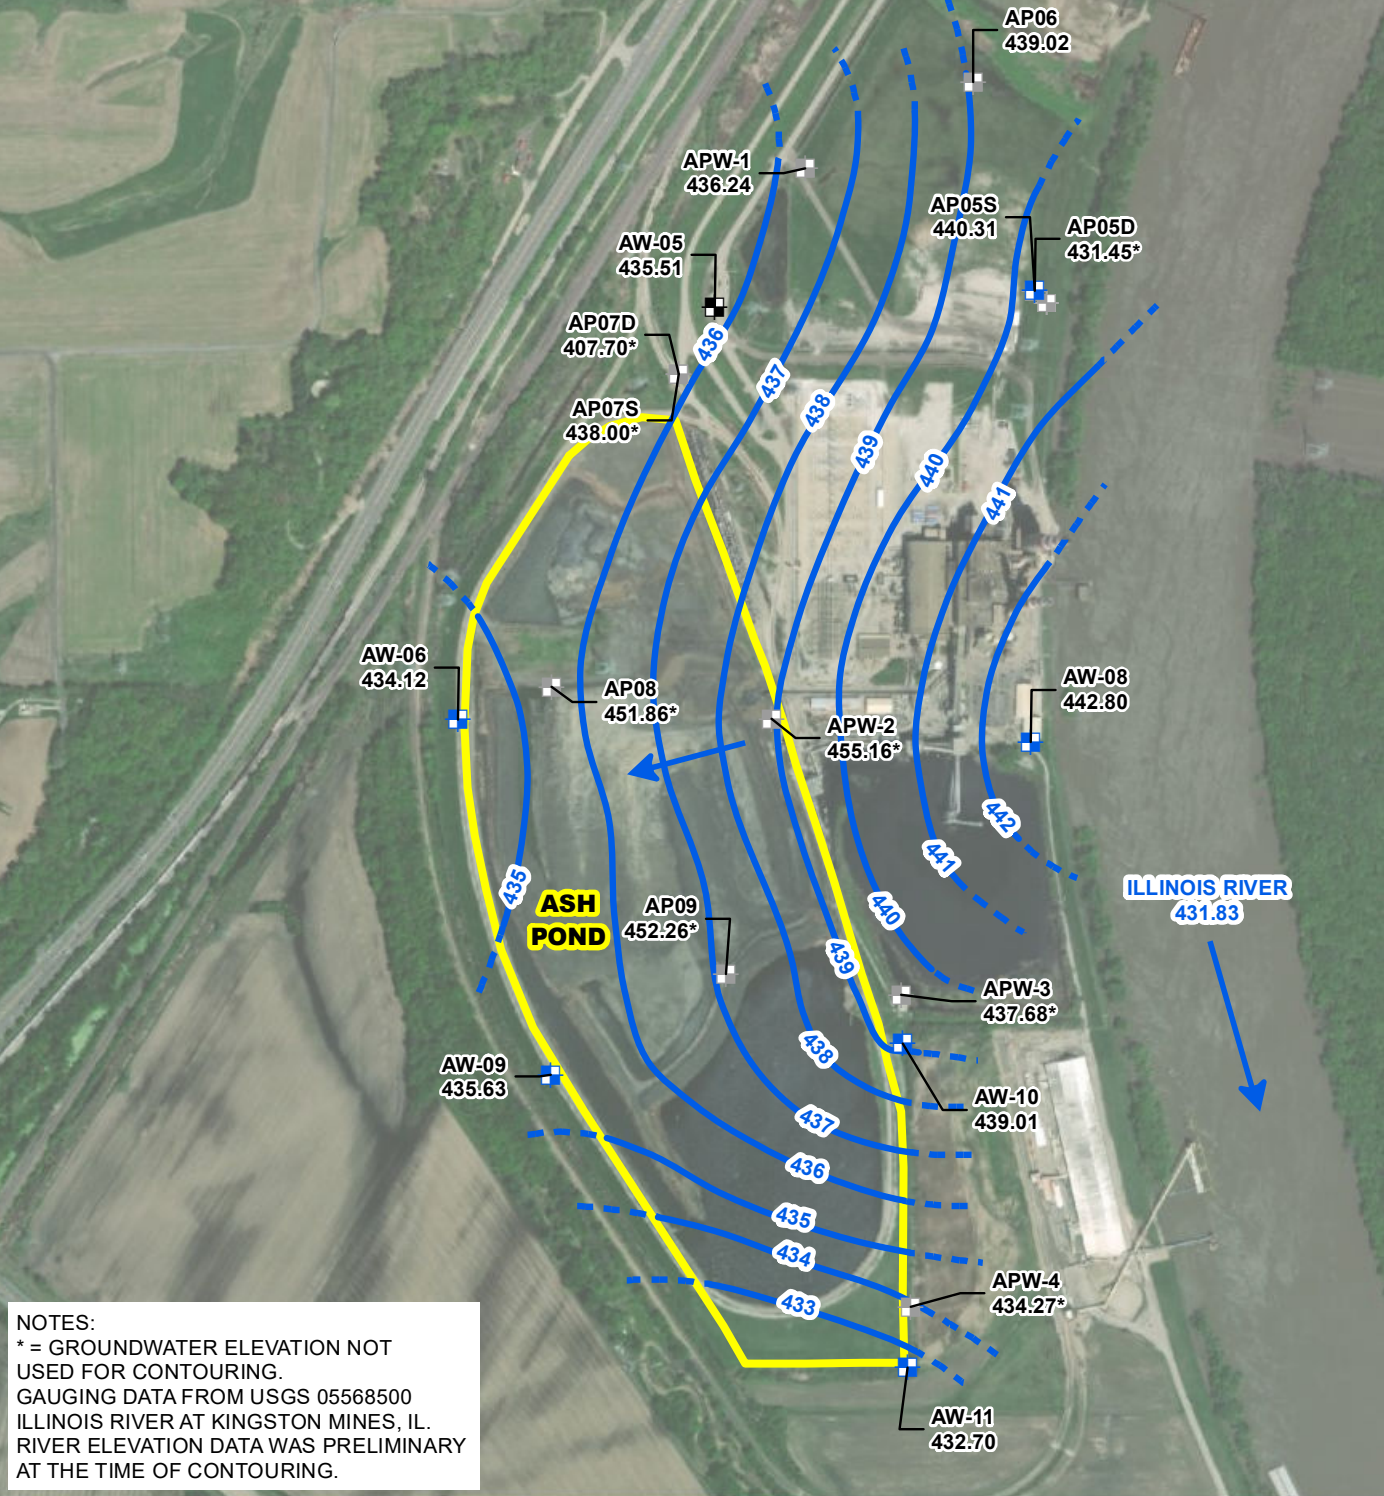

NOTES:
 * = GROUNDWATER ELEVATION NOT USED FOR CONTOURING.
 GAUGING DATA FROM USGS 05568500 ILLINOIS RIVER AT KINGSTON MINES, IL. RIVER ELEVATION DATA WAS PRELIMINARY AT THE TIME OF CONTOURING.


**EDWARDS ASH POND (UNIT ID: 301)
 GROUNDWATER ELEVATION CONTOUR MAP
 AUGUST 6, 2019**

CCR RULE GROUNDWATER MONITORING
 EDWARDS POWER STATION
 BARTONVILLE, ILLINOIS



- CCR RULE MONITORING WELL LOCATION
- NON-CCR RULE MONITORING WELL LOCATION
- UNDESIGNATED MONITORING WELL LOCATION
- GROUNDWATER ELEVATION CONTOUR (1-FT CONTOUR INTERVAL, NAVD88)
- INFERRED GROUNDWATER ELEVATION CONTOUR
- GROUNDWATER FLOW DIRECTION
- CCR MONITORED UNIT



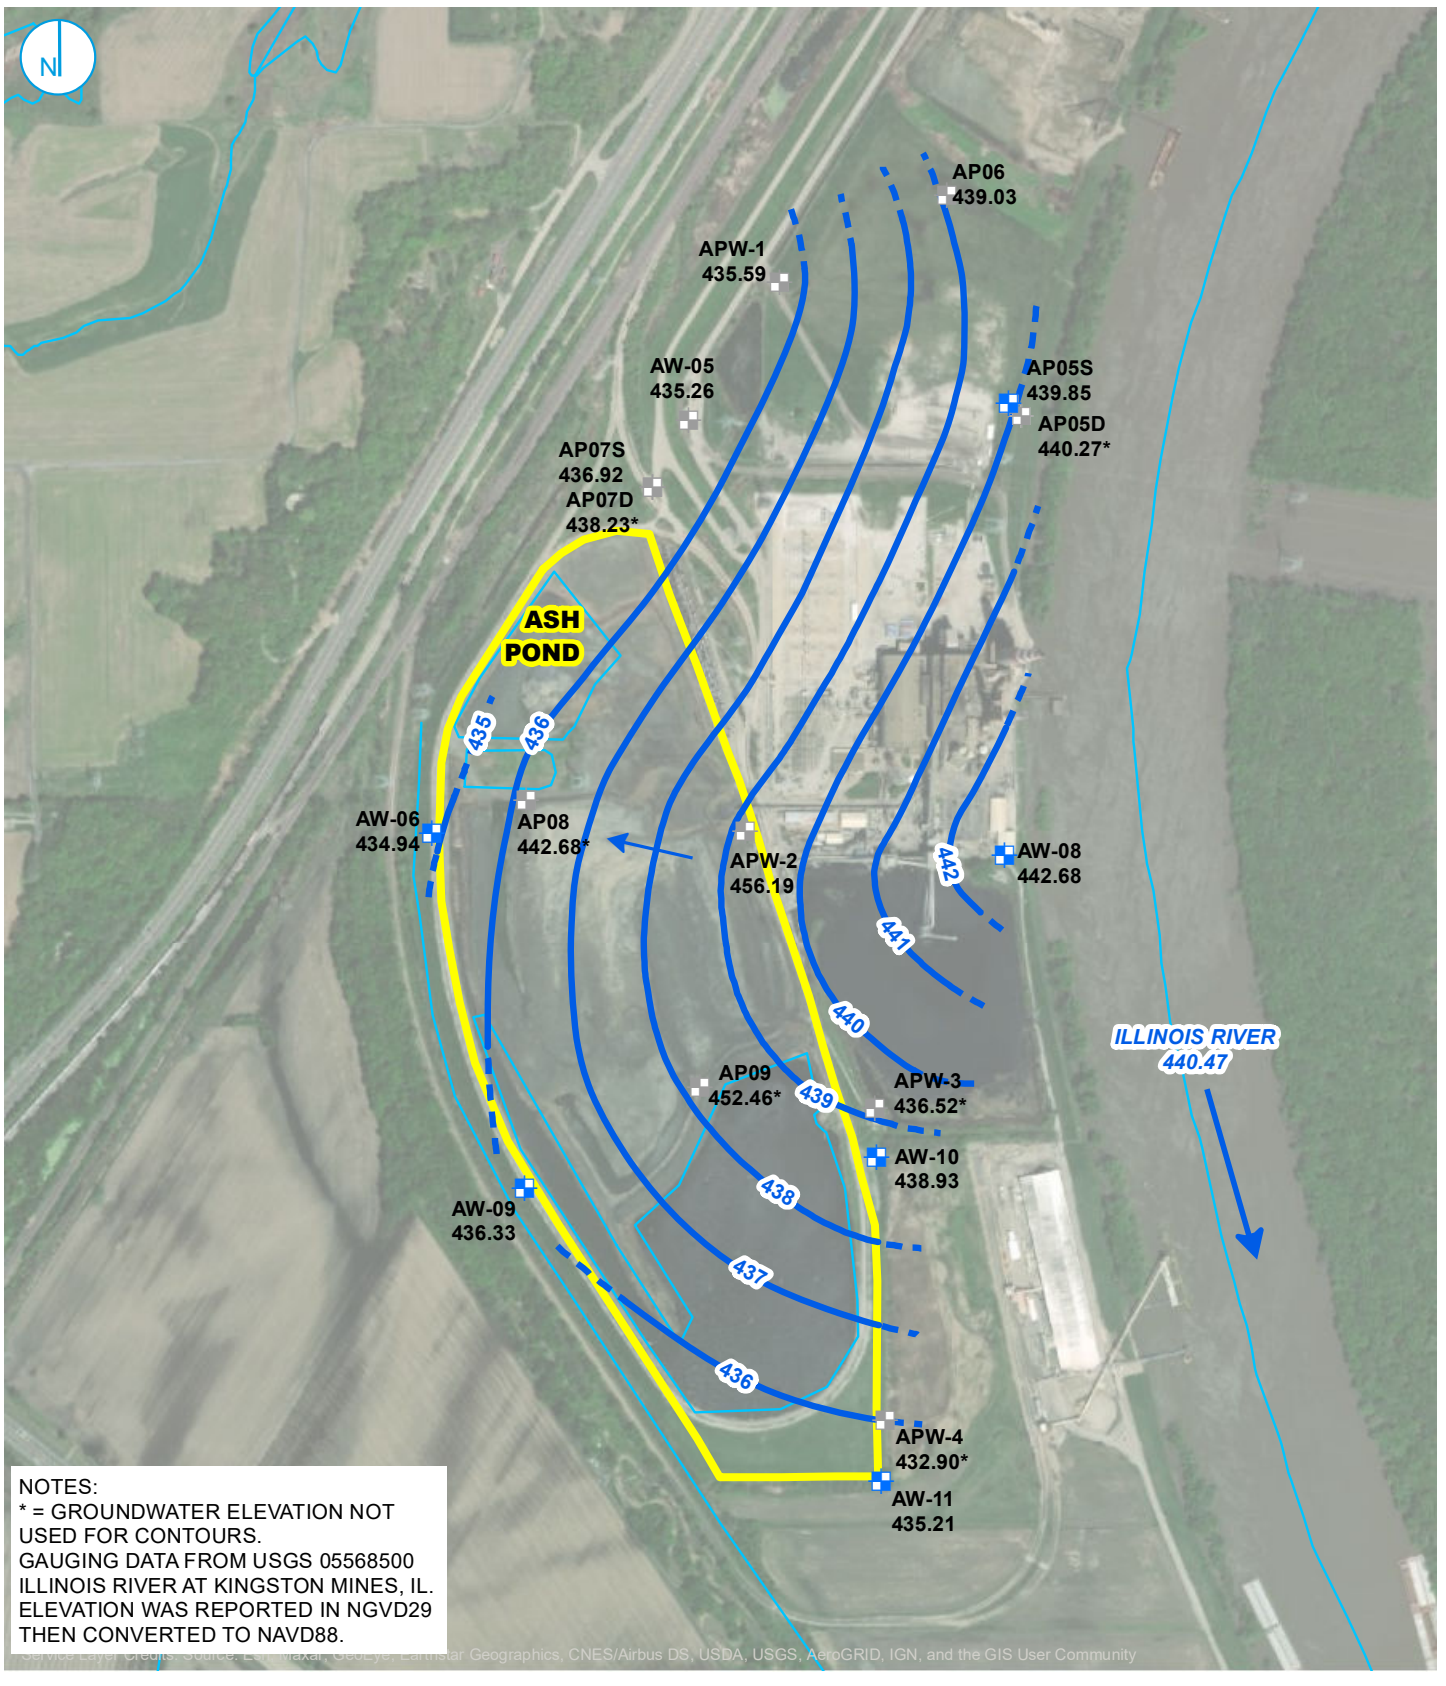

NOTES:
 * = GROUNDWATER ELEVATION NOT USED FOR CONTOURS.
 GAUGING DATA FROM USGS 05568500 ILLINOIS RIVER AT KINGSTON MINES, IL. ELEVATION WAS REPORTED IN NGVD29 THEN CONVERTED TO NAVD88.

© Services Layer Credits: Source: Esri, Maxar, GeoEye, Earthstar Geographics, CNES/Airbus DS, USDA, USGS, AeroGRID, IGN, and the GIS User Community

- CCR RULE MONITORING WELL
- NON-CCR RULE MONITORING WELL
- GROUNDWATER ELEVATION CONTOUR (1-FT CONTOUR INTERVAL, NAVD88)
- INFERRED GROUNDWATER ELEVATION CONTOUR
- GROUNDWATER FLOW DIRECTION
- CCR MONITORED UNIT
- SURFACE WATER FEATURE



GROUNDWATER ELEVATION CONTOUR MAP
FEBRUARY 27, 2020

EDWARDS ASH POND (UNIT ID: 301)
 VISTRA ENERGY
 EDWARDS POWER STATION
 BARTONVILLE, ILLINOIS

RAMBOLL US CORPORATION
 A RAMBOLL COMPANY



**ATTACHMENT 5 – TABLES SUMMARIZING CONSTITUENT CONCENTRATIONS
AT EACH MONITORING WELL**

**Analytical Results - Appendix III
Edwards Ash Pond**

Sample Location	Date Sampled	Boron, total (mg/L)	Calcium, total (mg/L)	Chloride, total (mg/L)	Fluoride, total (mg/L)	pH (s.u.)	Sulfate, total (mg/L)	Total Dissolved Solids (mg/L)
Background Wells								
AP-05S	1/18/2017	0.36	110	44	<0.25	6.9	38	860
AP-05S	5/10/2017	0.34	110	42	<0.25	7.1	32	810
AP-05S	6/7/2017	0.34	110	42	<0.25	6.8	29	500
AP-05S	6/22/2017	0.32	110	42	<0.25	7.2	26	880
AP-05S	7/21/2017	0.27	120	41	<0.25	6.9	23	840
AP-05S	7/31/2017	0.29	130	44	<0.25	7.0	19	750
AP-05S	8/7/2017	0.30	120	41	<0.25	7.0	17	840
AP-05S	8/23/2017	0.31	98	43	<0.25	6.9	12	820
AP-05S	11/2/2017	0.37	100	39	<0.25	7.2	10	820
AP-05S	5/7/2018	0.29	94	42	<0.25	7.2	8.1	860
AP-05S	7/27/2018	0.33	110	41	<0.25	7.1	6.2	940
AP-05S	8/27/2018	NA	NA	NA	NA	7.0	NA	NA
AP-05S	2/27/2019	0.29	91	40	<0.25	7.1	4.0	880
AP-05S	8/6/2019	0.24	110	37	<0.25	7.1	<1	900
AP-05S	2/27/2020	0.31	170	40	<0.25	6.7	<1	840
AW-08	11/9/2015	0.16	140	19	<0.25	6.6	80	740
AW-08	12/21/2015	NA	NA	NA	NA	NA	NA	NA
AW-08	2/17/2016	0.17	150	20	0.324	6.8	61	660
AW-08	5/17/2016	0.21	160	18	0.376	6.8	59	680
AW-08	7/21/2016	0.14	100	23	0.340	7.0	55	680
AW-08	11/10/2016	0.15	160	20	0.346	7.1	46	710
AW-08	1/17/2017	0.13	110	20	<0.25	7.2	64	640
AW-08	5/8/2017	0.11	160	16	0.331	7.1	23	780
AW-08	7/19/2017	0.085	160	16	<0.25	7.3	19	640
AW-08	11/1/2017	0.14	150	16	0.334	7.1	11	680
AW-08	5/5/2018	0.096	130	18	0.338	7.1	7.5	640
AW-08	7/27/2018	0.13	130	17	0.313	7.2	6.0	600
AW-08	8/27/2018	NA	NA	NA	NA	7.1	NA	NA
AW-08	2/27/2019	0.12	140	17	0.270	7.1	9.6	670
AW-08	8/6/2019	0.10	130	19	0.287	7.3	20	700
AW-08	2/27/2020	0.11	140	16	0.300	6.9	<1	680
Downgradient Wells								
AW-06	11/10/2015	0.31	110	61	<0.25	7.0	36	560
AW-06	2/17/2016	0.29	72	75	0.441	7.2	40	650
AW-06	5/18/2016	0.17	110	43	0.465	7.2	41	490
AW-06	7/22/2016	0.21	120	50	0.414	7.1	42	540
AW-06	11/11/2016	0.16	110	45	0.429	7.2	39	530
AW-06	1/17/2017	0.17	100	39	0.351	7.2	39	540
AW-06	5/9/2017	0.18	110	37	0.415	7.2	38	560
AW-06	7/20/2017	0.19	140	34	0.314	7.3	34	480
AW-06	11/2/2017	0.18	100	32	0.405	7.1	32	500
AW-06	5/5/2018	0.17	120	37	0.286	7.2	29	430
AW-06	8/24/2018	0.14	110	35	0.366	7.9	31	540
AW-06	2/27/2019	0.13	110	35	0.280	7.3	29	580
AW-06	8/6/2019	0.093	120	33	0.393	7.2	29	580
AW-06	2/27/2020	0.12	110	33	0.413	7.0	23	500
AW-09	11/10/2015	0.79	170	31	<0.25	6.8	28	700
AW-09	12/21/2015	NA	NA	NA	NA	NA	NA	NA
AW-09	2/17/2016	0.86	210	31	0.313	6.6	23	700
AW-09	5/17/2016	1.3	120	32	0.338	6.5	37	640
AW-09	7/22/2016	0.51	180	32	0.342	6.6	19	660
AW-09	11/11/2016	0.38	140	29	0.334	6.7	8.6	790
AW-09	1/17/2017	0.84	120	32	<0.25	6.9	28	710
AW-09	5/9/2017	0.49	140	28	0.281	7.1	13	760

**Analytical Results - Appendix III
Edwards Ash Pond**

Sample Location	Date Sampled	Boron, total (mg/L)	Calcium, total (mg/L)	Chloride, total (mg/L)	Fluoride, total (mg/L)	pH (s.u.)	Sulfate, total (mg/L)	Total Dissolved Solids (mg/L)
AW-09	7/20/2017	0.31	160	28	<0.25	6.9	1.6	700
AW-09	11/2/2017	0.90	110	32	0.279	7.0	29	690
AW-09	5/5/2018	0.29	130	26	0.294	7.0	<1	670
AW-09	8/24/2018	0.72	120	36	0.334	7.0	26	720
AW-09	2/27/2019	0.52	120	29	0.250	7.0	12	780
AW-09	8/6/2019	0.20	140	27	<0.25	7.2	<1	770
AW-09	2/27/2020	0.24	130	24	<0.25	6.9	<1	740
AW-10	11/9/2015	0.42	140	94	<0.25	6.6	2.8	1100
AW-10	2/18/2016	0.56	280	99	<0.25	7.0	1.2	1200
AW-10	5/18/2016	0.53	170	83	0.324	7.1	<1	1100
AW-10	7/21/2016	0.46	130	100	<0.25	7.1	<1	1100
AW-10	11/11/2016	0.44	140	92	<0.25	7.1	<1	1100
AW-10	11/17/2017	0.44	110	85	<0.25	7.1	1.8	1100
AW-10	5/10/2017	0.49	120	89	<0.25	6.9	4.1	1200
AW-10	7/20/2017	0.43	130	84	<0.25	7.0	<1	980
AW-10	11/2/2017	0.54	100	85	<0.25	7.2	2.8	1000
AW-10	5/7/2018	0.42	110	85	<0.25	7.3	<1	1000
AW-10	7/27/2018	0.48	170	88	<0.25	7.2	<1	1100
AW-10	8/27/2018	NA	NA	NA	NA	7.1	NA	NA
AW-10	2/27/2019	0.47	130	85	<0.25	7.2	<1	1100
AW-10	8/6/2019	0.50	160	100	<0.25	7.3	<1	1200
AW-10	2/27/2020	0.46	140	83	<0.25	6.8	<1	1200
AW-11	11/9/2015	0.23	170	33	<0.25	6.5	1.4	870
AW-11	2/18/2016	0.24	210	36	0.29	6.9	2.0	900
AW-11	5/18/2016	0.25	170	31	0.38	7.0	1.8	860
AW-11	7/22/2016	0.22	160	36	<0.25	7.0	1.9	880
AW-11	11/11/2016	0.25	220	33	<0.25	7.1	<1	880
AW-11	1/17/2017	0.22	150	35	<0.25	7.2	2.2	920
AW-11	5/9/2017	0.23	210	34	<0.25	7.0	4.9	940
AW-11	7/20/2017	0.23	240	30	<0.25	7.2	<1	920
AW-11	11/2/2017	0.23	140	33	<0.25	7.2	3.2	920
AW-11	5/7/2018	0.21	140	30	<0.25	7.2	<1	880
AW-11	8/27/2018	0.30	290	31	0.270	7.2	1.1	980
AW-11	2/27/2019	0.22	160	30	<0.25	7.2	<1	970
AW-11	8/6/2019	0.18	160	30	<0.25	7.2	<1	980
AW-11	2/27/2020	0.22	170	30	<0.25	6.7	<1	970

Notes:

1. Abbreviations: mg/L - milligrams per liter; NA - not analyzed; s.u. - standard units.

Analytical Results - Appendix IV
Edwards Ash Pond

Sample Location	Date Sampled	Antimony, total (mg/L)	Arsenic, total (mg/L)	Barium, total (mg/L)	Beryllium, total (mg/L)	Cadmium, total (mg/L)	Chromium, total (mg/L)	Cobalt, total (mg/L)	Fluoride, total (mg/L)	Lead, total (mg/L)	Lithium, total (mg/L)	Mercury, total (mg/L)	Molybdenum, total (mg/L)	Radium-226 + Radium 228, tot (pCi/L)	Selenium, total (mg/L)	Thallium, total (mg/L)
Background Wells																
AP-05S	1/18/2017	0.0041	0.003	0.54	<0.001	<0.001	<0.004	0.0025	<0.25	0.001	0.040	<0.0002	0.019	1.05	<0.001	<0.001
AP-05S	5/10/2017	<0.003	0.0041	0.54	<0.001	<0.001	<0.004	<0.002	<0.25	<0.001	0.038	<0.0002	0.015	1.32	<0.001	<0.001
AP-05S	6/7/2017	<0.003	0.0055	0.59	<0.001	<0.001	<0.004	<0.002	<0.25	<0.001	0.034	<0.0002	0.015	1.43	<0.001	<0.001
AP-05S	6/22/2017	<0.003	0.0063	0.65	<0.001	<0.001	<0.004	<0.002	<0.25	<0.001	0.036	<0.0002	0.015	1.89	<0.001	<0.001
AP-05S	7/21/2017	<0.003	0.0077	0.69	<0.001	<0.001	<0.004	<0.002	<0.25	<0.001	0.035	<0.0002	0.014	1.75	<0.001	<0.001
AP-05S	7/31/2017	<0.003	0.0074	0.77	<0.001	<0.001	<0.004	<0.002	<0.25	<0.001	0.038	<0.0002	0.012	1.38	<0.001	<0.001
AP-05S	8/7/2017	<0.003	0.0077	0.77	<0.001	<0.001	<0.004	<0.002	<0.25	<0.001	0.035	<0.0002	0.011	2.20	<0.001	<0.001
AP-05S	8/23/2017	<0.003	0.0072	0.79	<0.001	<0.001	<0.004	<0.002	<0.25	<0.001	0.044	<0.0002	0.0076	2.63	<0.001	<0.001
AP-05S	5/7/2018	<0.003	0.0028	0.46	<0.001	<0.001	<0.004	<0.002	<0.25	<0.001	0.032	<0.0002	0.0038	NA	<0.001	<0.001
AP-05S	5/29/2018	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	1.68	NA	NA
AP-05S	7/27/2018	NA	0.0047	0.70	<0.001	NA	<0.004	<0.002	<0.25	<0.001	0.025	NA	0.0029	3.19	<0.001	NA
AP-05S	2/27/2019	<0.003	0.0046	0.87	<0.001	<0.001	<0.004	<0.002	<0.25	<0.001	0.020	<0.0002	0.0014	2.30	<0.001	<0.001
AP-05S	8/6/2019	NA	0.0067	1.1	<0.001	NA	<0.004	<0.002	<0.25	<0.001	0.031	NA	<0.001	3.00	<0.001	NA
AP-05S	2/27/2020	<0.003	0.0088	1.4	<0.001	<0.001	0.028	0.013	<0.25	0.0099	0.059	<0.0002	0.0026	2.85	0.0016	<0.001
AW-08	11/9/2015	<0.003	0.0011	0.15	<0.001	<0.001	<0.004	0.0038	<0.25	<0.001	0.025	<0.0002	0.0028	1.12	0.0012	<0.001
AW-08	2/17/2016	<0.003	0.0014	0.16	<0.001	<0.001	<0.004	0.0034	0.324	<0.001	0.025	<0.0002	0.0027	1.27	<0.001	<0.001
AW-08	5/17/2016	<0.003	0.0056	0.19	0.014	<0.001	<0.004	0.0053	0.376	<0.001	0.019	<0.0002	0.0044	0.454	<0.001	<0.001
AW-08	7/21/2016	<0.003	0.0018	0.13	<0.0005	<0.001	<0.004	0.002	0.340	<0.001	0.019	<0.0002	0.0040	0.357	<0.001	<0.001
AW-08	11/10/2016	<0.003	0.011	0.20	<0.001	<0.001	<0.004	0.0034	0.346	<0.001	0.016	<0.0002	0.0085	0.433	<0.001	<0.001
AW-08	1/17/2017	<0.003	0.0012	0.15	<0.001	<0.001	<0.004	0.003	<0.25	<0.001	0.020	<0.0002	0.0032	0.408	<0.001	<0.001
AW-08	5/8/2017	<0.003	0.017	0.21	<0.001	<0.001	<0.004	<0.002	0.331	<0.001	0.014	<0.0002	0.0072	0.975	<0.001	<0.001
AW-08	7/19/2017	<0.003	0.016	0.22	<0.001	<0.001	<0.004	<0.002	<0.25	<0.001	0.014	<0.0002	0.0062	0.394	<0.001	<0.001
AW-08	11/1/2017	NA	NA	NA	NA	NA	NA	NA	0.334	NA	NA	NA	NA	NA	NA	NA
AW-08	5/5/2018	<0.003	0.027	0.24	<0.001	<0.001	<0.004	<0.002	0.338	<0.001	0.014	<0.0002	0.0044	NA	<0.001	<0.001
AW-08	5/29/2018	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	0.422	NA	NA
AW-08	7/27/2018	NA	0.020	0.19	<0.001	NA	<0.004	<0.002	0.313	<0.001	<0.01	NA	0.0043	0.807	<0.001	NA
AW-08	2/27/2019	<0.003	0.019	0.22	<0.001	<0.001	<0.004	<0.002	0.270	<0.001	<0.01	<0.0002	0.0049	0.402	<0.001	<0.001
AW-08	8/6/2019	NA	0.0074	0.18	<0.001	NA	<0.004	<0.002	0.287	<0.001	0.017	NA	0.0037	3.95	<0.001	NA
AW-08	2/27/2020	<0.003	0.019	0.23	<0.001	<0.001	<0.004	<0.002	0.300	<0.001	<0.02	<0.0002	0.0051	0.933	<0.001	<0.001
Downgradient Wells																
AW-06	11/10/2015	<0.003	0.0034	0.29	<0.001	<0.001	0.014	0.006	<0.25	0.006	0.035	<0.0002	0.0034	2.54	0.001	<0.001
AW-06	2/17/2016	<0.003	0.0018	0.20	<0.001	<0.001	0.0071	0.0024	0.441	0.0023	0.029	<0.0002	0.0038	2.62	<0.001	<0.001
AW-06	5/18/2016	<0.003	0.0014	0.18	<0.001	<0.001	<0.004	<0.002	0.465	<0.001	0.017	<0.0002	0.0044	1.21	<0.001	<0.001
AW-06	7/22/2016	<0.003	0.0082	0.32	0.00085	<0.001	0.026	0.014	0.414	0.014	0.042	0.0018	0.0052	2.08	0.0022	<0.001
AW-06	11/11/2016	<0.003	0.0045	0.25	<0.001	<0.001	0.024	0.0068	0.429	0.0064	0.030	<0.0002	0.0064	0.498	<0.001	<0.001
AW-06	1/17/2017	<0.003	0.0036	0.19	<0.001	<0.001	0.0084	0.0028	0.351	0.0063	0.020	<0.0002	0.0066	0.372	<0.001	<0.001
AW-06	5/9/2017	<0.003	0.0014	0.16	<0.001	<0.001	<0.004	<0.002	0.415	0.0012	0.018	<0.0002	0.0095	0.399	<0.001	<0.001
AW-06	7/20/2017	<0.003	0.032	0.46	0.0011	<0.001	0.033	0.019	0.314	0.019	0.049	<0.0002	0.0086	0.813	0.0023	<0.001
AW-06	11/2/2017	NA	NA	NA	NA	NA	NA	NA	0.405	NA	NA	NA	NA	NA	NA	NA
AW-06	5/5/2018	<0.003	0.037	0.45	0.0014	<0.001	0.034	0.018	0.286	0.019	0.048	<0.0002	0.008	NA	0.0028	<0.001
AW-06	5/29/2018	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	1.09	NA	NA
AW-06	8/24/2018	NA	0.0048	0.18	<0.001	NA	<0.004	<0.002	0.366	0.0018	<0.01	NA	0.0057	1.98	<0.001	NA
AW-06	2/27/2019	<0.003	0.0046	0.18	<0.001	<0.001	<0.004	<0.002	0.280	0.0013	<0.01	<0.0002	0.0051	0.357	<0.001	<0.001
AW-06	8/6/2019	NA	0.020	0.35	<0.001	NA	0.024	0.01	0.393	0.011	0.035	NA	0.0055	1.82	0.002	NA
AW-06	2/27/2020	<0.003	0.0053	0.21	<0.001	<0.001	0.0068	<0.002	0.413	0.0016	0.020	<0.0002	0.0049	0.242	<0.001	<0.001
AW-09	11/10/2015	<0.003	0.018	0.62	0.0029	<0.001	0.075	0.040	<0.25	0.038	0.11	<0.0002	0.014	7.71	0.0067	<0.001

**Analytical Results - Appendix IV
Edwards Ash Pond**

Sample Location	Date Sampled	Antimony, total	Arsenic, total	Barium, total	Beryllium, total	Cadmium, total	Chromium, total	Cobalt, total	Fluoride, total	Lead, total	Lithium, total	Mercury, total	Molybdenum, total	Radium-226 + Radium 228, tot (pCi/L)	Selenium, total	Thallium, total
		(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)	(mg/L)
AW-09	2/17/2016	<0.003	0.046	1.1	0.007	0.0028	0.2	0.093	0.313	0.11	0.26	0.00026	0.020	5.97	0.0091	0.0016
AW-09	5/17/2016	<0.003	<0.001	0.15	<0.001	<0.001	<0.004	0.0023	0.338	<0.001	0.022	<0.0002	0.015	0.464	<0.001	<0.001
AW-09	7/22/2016	<0.003	0.025	0.57	0.0025	0.0012	0.073	0.043	0.342	0.036	0.11	<0.0002	0.024	3.46	0.0036	<0.001
AW-09	11/11/2016	<0.003	0.02	0.39	<0.001	<0.001	0.03	0.017	0.334	0.0097	0.04	<0.0002	0.026	2.23	0.0013	<0.001
AW-09	1/17/2017	<0.003	<0.001	0.18	<0.001	<0.001	<0.004	0.0029	<0.25	<0.001	0.022	<0.0002	0.012	0.729	<0.001	<0.001
AW-09	5/9/2017	<0.003	0.0049	0.22	<0.001	<0.001	<0.004	0.0051	0.281	<0.001	0.022	<0.0002	0.020	0.00	<0.001	<0.001
AW-09	7/20/2017	<0.003	0.031	0.57	0.0013	<0.001	0.039	0.024	<0.25	0.024	0.06	<0.0002	0.028	1.86	0.002	<0.001
AW-09	11/2/2017	NA	NA	NA	NA	NA	NA	NA	0.279	NA	NA	NA	NA	NA	NA	NA
AW-09	5/5/2018	<0.003	0.036	0.37	<0.001	<0.001	0.015	0.01	0.294	0.0076	0.029	<0.0002	0.037	NA	0.0015	<0.001
AW-09	5/29/2018	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	0.633	NA	NA
AW-09	8/24/2018	NA	<0.001	0.18	<0.001	NA	<0.004	0.0034	0.334	<0.001	0.011	NA	0.015	0.466	<0.001	NA
AW-09	2/27/2019	<0.003	0.0019	0.22	<0.001	<0.001	<0.004	0.0036	0.250	<0.001	0.013	<0.0002	0.016	0.771	<0.001	<0.001
AW-09	8/6/2019	NA	0.026	0.54	<0.001	NA	0.017	0.011	<0.25	0.011	0.036	NA	0.015	1.94	0.0012	NA
AW-09	2/27/2020	<0.003	0.017	0.46	<0.001	<0.001	0.0092	0.0051	<0.25	0.0035	0.023	<0.0002	0.012	1.51	<0.001	<0.001
AW-10	11/9/2015	<0.003	0.010	0.98	<0.001	<0.001	0.015	0.0083	<0.25	0.0054	0.073	<0.0002	0.0017	3.83	0.0013	<0.001
AW-10	2/18/2016	<0.003	0.097	6.3	0.015	0.0031	0.45	0.25	<0.25	0.27	0.85	0.00033	0.0094	7.06	0.016	0.0023
AW-10	5/18/2016	<0.003	0.040	3.4	0.0011	<0.001	0.056	0.034	0.324	0.035	0.11	<0.0002	0.0028	5.73	0.0021	<0.001
AW-10	7/21/2016	<0.003	0.010	1.0	<0.0005	<0.001	0.015	0.0097	<0.25	0.0074	0.08	<0.0002	0.0016	6.07	0.001	<0.001
AW-10	11/11/2016	<0.003	0.018	1.4	0.0012	<0.001	0.038	0.026	<0.25	0.022	0.12	<0.0002	0.0029	3.57	0.0025	<0.001
AW-10	1/17/2017	<0.003	0.0023	0.58	<0.001	<0.001	<0.004	0.0022	<0.25	<0.001	0.056	<0.0002	0.0023	1.23	<0.001	<0.001
AW-10	5/10/2017	<0.003	0.0032	0.66	<0.001	<0.001	<0.004	0.0027	<0.25	<0.001	0.057	<0.0002	0.0032	1.12	<0.001	<0.001
AW-10	7/20/2017	<0.003	0.0052	0.67	<0.001	<0.001	0.0042	0.0033	<0.25	0.0018	0.052	<0.0002	0.0043	0.875	<0.001	<0.001
AW-10	11/2/2017	NA	NA	NA	NA	NA	NA	NA	<0.25	NA	NA	NA	NA	NA	NA	NA
AW-10	5/7/2018	<0.003	0.0089	0.88	<0.001	<0.001	<0.004	0.0031	<0.25	0.001	0.042	<0.0002	0.0020	NA	<0.001	<0.001
AW-10	5/29/2018	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	2.40	NA	NA
AW-10	7/27/2018	NA	0.018	1.4	0.0022	NA	0.063	0.036	<0.25	0.035	0.11	NA	0.0030	8.03	0.0035	NA
AW-10	2/27/2019	<0.003	0.012	0.93	<0.001	<0.001	<0.004	0.0037	<0.25	0.0024	0.040	<0.0002	0.028	1.79	<0.001	<0.001
AW-10	8/6/2019	NA	0.019	1.5	0.0014	NA	0.05	0.026	<0.25	0.026	0.12	NA	0.0022	4.08	0.0033	NA
AW-10	2/27/2020	<0.003	0.011	1.2	<0.001	<0.001	0.023	0.0098	<0.25	0.0092	0.065	<0.0002	0.0012	2.19	0.0012	<0.001
AW-11	11/9/2015	<0.003	0.011	1.2	<0.001	<0.001	0.029	0.011	<0.25	0.0099	0.067	<0.0002	0.0043	2.78	0.0019	<0.001
AW-11	2/18/2016	<0.003	0.014	1.6	0.0013	<0.001	0.044	0.023	0.290	0.026	0.078	<0.0002	0.0066	3.20	0.0021	<0.001
AW-11	5/18/2016	<0.003	0.0053	0.83	<0.001	<0.001	0.0095	0.0067	0.380	0.0049	0.033	<0.0002	0.0065	0.558	<0.001	<0.001
AW-11	7/22/2016	<0.003	0.0054	0.84	<0.0005	<0.001	0.0042	0.0034	<0.25	0.0019	0.033	<0.0002	0.0037	2.69	<0.001	<0.001
AW-11	11/11/2016	<0.003	0.021	2.0	0.0027	0.0014	0.095	0.044	<0.25	0.049	0.14	<0.0002	0.0088	2.69	0.0061	<0.001
AW-11	1/17/2017	<0.003	0.0042	0.56	<0.001	0.0015	0.0063	0.0038	<0.25	0.0015	0.031	<0.0002	0.010	0.394	0.0012	<0.001
AW-11	5/9/2017	<0.003	0.014	1.4	0.0012	<0.001	0.031	0.023	<0.25	0.024	0.080	<0.0002	0.0073	5.75	0.003	<0.001
AW-11	7/20/2017	<0.003	0.025	2.5	0.0028	0.0017	0.091	0.046	<0.25	0.05	0.14	<0.0002	0.0077	4.47	0.0042	<0.001
AW-11	11/2/2017	NA	NA	NA	NA	NA	NA	NA	<0.25	NA	NA	NA	NA	NA	NA	NA
AW-11	5/7/2018	<0.003	0.011	0.73	<0.001	<0.001	<0.004	0.0029	<0.25	<0.001	0.021	<0.0002	0.0064	NA	<0.001	<0.001
AW-11	5/29/2018	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	1.75	NA	NA
AW-11	8/27/2018	NA	0.029	3.0	0.0046	NA	0.15	0.070	0.270	0.08	0.16	NA	0.0099	7.60	0.0083	NA
AW-11	2/27/2019	<0.003	0.013	0.76	<0.001	<0.001	<0.004	0.0031	<0.25	0.0012	0.017	<0.0002	0.0053	2.33	<0.001	<0.001
AW-11	8/6/2019	NA	0.018	0.88	<0.001	NA	<0.004	0.0023	<0.25	<0.001	0.031	NA	0.0046	1.69	<0.001	NA
AW-11	2/27/2020	<0.003	0.013	1.3	<0.001	<0.001	0.0081	0.0041	<0.25	0.0033	0.029	<0.0002	0.0028	3.68	<0.001	<0.001

Notes:

1. Abbreviations: mg/L - milligrams per liter; NA - not analyzed; pCi/L - picocurie per liter;

**ATTACHMENT 6 – SITE HYDROGEOLOGY AND STRATIGRAPHIC CROSS-
SECTIONS OF THE SITE**

CONCEPTUAL SITE MODEL AND DESCRIPTION OF SITE HYDROGEOLOGY (ASH POND AREA)

The Edwards Power Station (Power Station) conceptual site model (CSM) and Description of Site Hydrogeology for the Edwards Ash Pond (AP) located in Bartonville, Illinois are described in the following sections.

REGIONAL SETTING

The AP is located in the Illinois Valley where the general sequence of unlithified Quaternary deposits, from ground surface down is:

- Poorly sorted sand, silt, and clay of the Cahokia Formation. Fine-grained deposits are predominant near the land surface, and coarse-grained deposits typically occur near the base of this formation, and have been observed to be 20 feet thick in the area.
- Glacial outwash belonging to the Henry and Banner Formations. The sands of the Henry and Banner Formations fill the deepest parts of the Illinois Valley, and are generally 75 to 150 feet thick in the area.

The Sankoty Sand Member of the Banner Formation rests directly on bedrock and fills the deepest part of the Illinois Valley in the area. Its thickness varies greatly from about 50 to 150 feet due to erosion and irregularities on the bedrock surface (Burch and Kelly, 1993). The Sankoty Sand is the most extensive aquifer in the region and is characterized by coarse- to medium-grained sand. Gravel is present in some beds but is not common (Willman and Frye, 1970).

SITE GEOLOGY

The major unconsolidated materials present at the AP include:

- Upper Cahokia Unit – Low permeability clays and silts of the Upper Cahokia Formation, saturated in portions of the site.
- Uppermost Aquifer (Groundwater Monitoring Zone) – Thin (generally less than 4 feet), moderate permeability sand, silty sand, and clayey gravel units which also includes the Lower Cahokia and the bedrock interface.
- Lower Confining Unit – Thick, very low permeability shales and siltstones of the Carbondale formation.

There is significant thickness of clay and/or silt overlying shaley bedrock. The bedrock surface dips toward the river and also toward a channel located in the southwest portion of the AP which is illustrated in the cross-sections attached to this demonstration.

SITE HYDROGEOLOGY

The CCR groundwater monitoring system consists of seven monitoring wells installed in the uppermost aquifer and adjacent to the AP (AW-05, AP-05S, AW-06, AW-08, AW-09, AW-10 and AW-11) (see Monitoring Well Location Map, and Well Construction Diagrams and Drilling Logs attached to this demonstration). The unit utilizes two background monitoring wells (AW-08 and AP-05S) as part of the CCR groundwater monitoring system.

The Uppermost aquifer consists of unconfined clays and silts of the Upper Cahokia, where saturated, and the thin, moderate permeability sands and gravels of the Lower Cahokia Formation which at some locations also

includes the bedrock interface (AP05S, AW05, AW08, AW09, AW10). The thickness of the sand and gravel unit was measured up to 4 feet within a bedrock channel (EDW-B009), although the sand and gravel is not laterally continuous.

The unlithified deposits are underlain by Pennsylvanian age bedrock, much of which is shale, of the Carbondale Formation. The top of rock was described as shale, siltstone, and shaley limestone based on borings which were advanced to rock. Thicknesses can be over 300 feet (Willman et al., 1967). Wells screened within the bedrock indicate low hydraulic conductivity (geometric mean 2.0×10^{-7} cm/sec). Water quality of the bedrock is increasingly mineralized with depth making the groundwater less desirable as a water supply.

Hydraulic Conductivity

Hydraulic conductivity/slug tests were completed in wells screened in the unlithified material as part of the Hydrogeologic Site Characterization (NRT, 2017). The hydraulic characteristics of the Lower Cahokia indicate the unit has a moderate hydraulic conductivity. The results of single-well field permeability tests have hydraulic conductivity values ranging from 5.4×10^{-6} to 3.25×10^{-3} cm/sec, with a geometric mean of 2.1×10^{-4} cm/sec. The effective porosity of this aquifer likely varies significantly in magnitude due to its variable composition. For purposes of groundwater velocities, a value of 0.1 and 0.15 was used to represent different portions of the aquifer.

GROUNDWATER ELEVATIONS, FLOW DIRECTION AND VELOCITY

Measured groundwater elevations typically range from about 430 ft in the south and southwest portion of the site, to 440 ft in the upgradient well along the Illinois River (AW-08). Groundwater elevations within the aquifer unit vary up to 4 feet based on river levels and appear to be influenced by the presence of a bedrock channel that is present along the western side of the AP. Piezometric head in the bedrock at depth ranges from about 408 ft msl in AP07D to about 430 ft msl in AP05D.

Groundwater generally flows from AW08 to the west, northwest toward AW-05 and southwest toward a buried bedrock channel. It is expected that groundwater discharges to the Illinois River south of the site property, where the bedrock channel potentially intersects the Illinois River. Groundwater flow within the shallow clay till is not mapped but based on the water surface in the pond and the range of Illinois River elevations, this shallow groundwater flows towards the Illinois River except during flood events. The horizontal gradient between wells AW-08 and AW-09, as measured in January and May 2017, is 0.003 and 0.002, respectively. Vertical gradients are generally upward between the Lower Cahokia/bedrock interface and Upper Cahokia, and downward between the bedrock interface and bedrock wells.

The Illinois River Valley is a regional discharge zone. Although gradients appear downward between the bedrock surface and the deep bedrock wells, it is expected that groundwater within the bedrock discharges to the Illinois River through fractures and more permeable portions of the bedrock.

Groundwater flow velocity within the Uppermost Aquifer ranged from approximately 0.001 to 0.12 ft/day as groundwater flowed from the Illinois River towards the bedrock channel in January 2017. During May 2017, velocities were slightly higher in portions of the site and ranged from 0.001 to 0.185 ft/day. In general, the flow velocity is slower near the river and increases near the sand and gravel unit in the southwest portion of the site. Groundwater flow within the shallow clay where saturated is assumed to be negligible and flow velocities were not calculated.

REFERENCES





NRT, 2013. Phase I Hydrogeological Assessment Report, Coal Combustion Product Impoundment, E.D. Edwards Energy Center, Peoria County IL, March 2013.

NRT, an OBG Company (NRT), 2017. Hydrogeologic Monitoring Plan, Edwards Ash Pond CCR Unit ID 301, Edwards Power Station, Bartonville, Illinois, October 2017

Willman, H.B., and J.C. Frye, 1970, Pleistocene Stratigraphy of Illinois: Illinois State Geological Survey, Bulletin 94, 204 p.

Willman, H.B., J.C. Frye, J.A. Simon, K.E. Clegg, D.H. Swann, E. Atherton, C. Collinson, J.A. Lineback, T.C. Buschbach, and H.B. Willman, 1967, Geologic Map of Illinois: Illinois State Geological Survey map, scale 1:500,000.

PROJECT: RAMBOLL PROJECT NUMBER DATED: 9/10/2020 3:07 PM \\G:\proj\NET\REG\EDW\EDW\SSLD\Drawings\Root\EDW\Shared Documents\1-CCR_GW_Deliverables\Part A\Edwards\Cross Sections\CAD\Edwards_Cross Sections.dwg

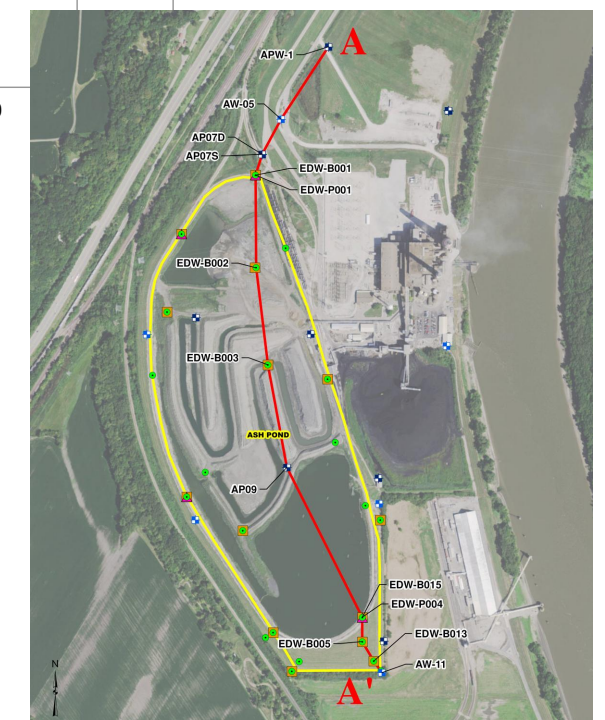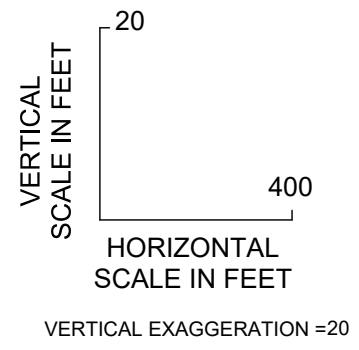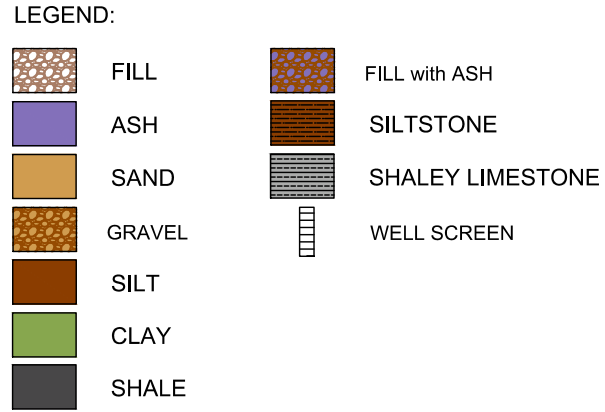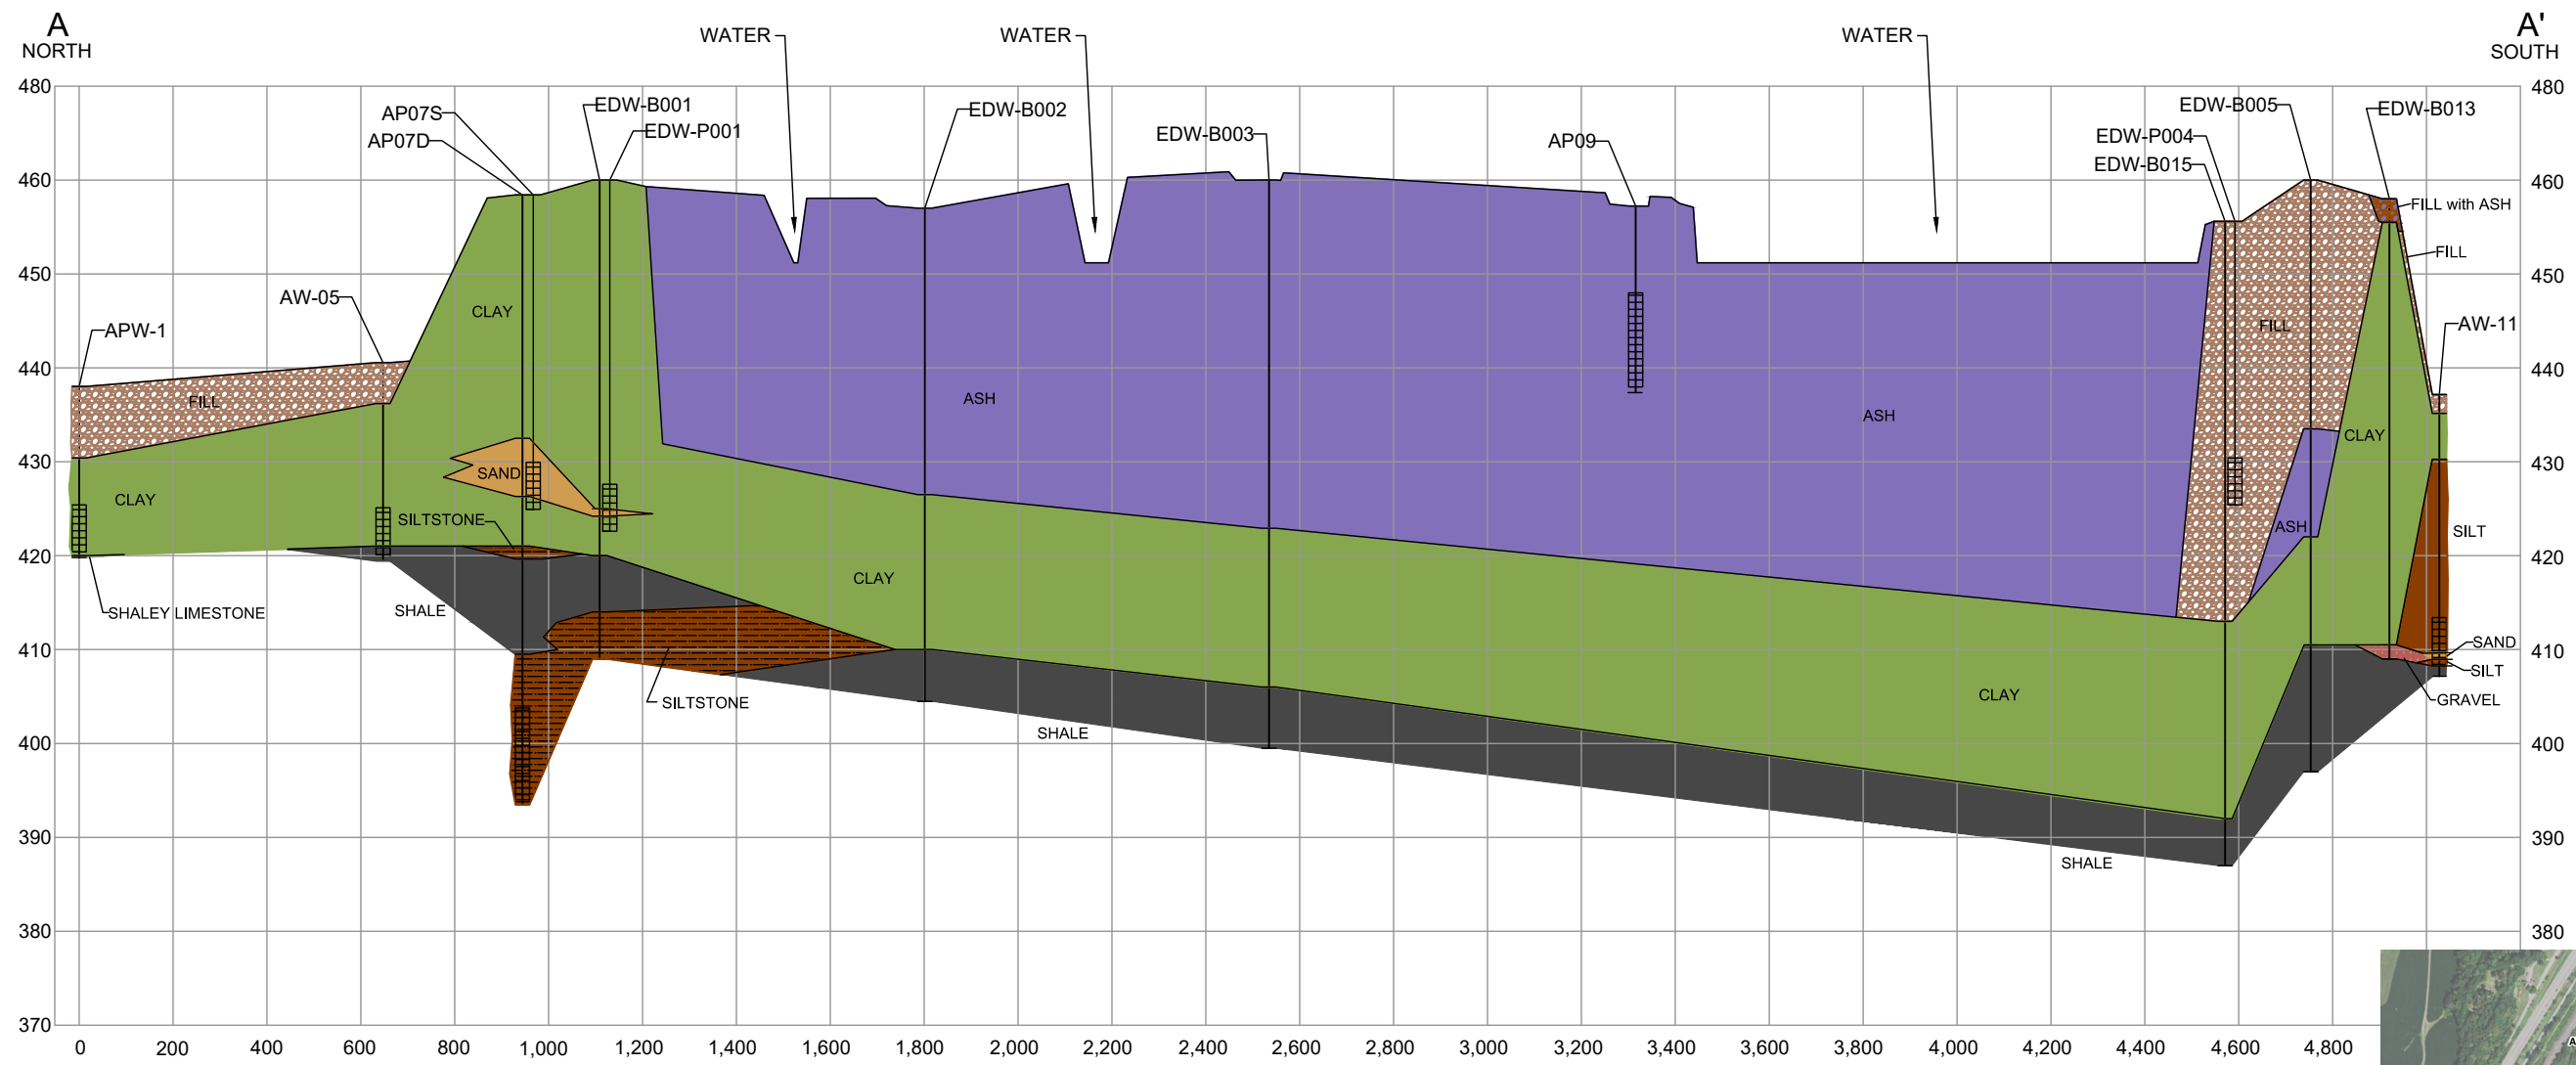

**GEOLOGICAL CROSS SECTION
A-A'**
HYDROGEOLOGIC MONITORING PLAN

FIGURE 1

RAMBOLL US CORPORATION
A RAMBOLL COMPANY

EDWARDS ASH POND
EDWARDS POWER STATION
BARTONSVILLE, ILLINOIS



ATTACHMENT 7 – STRUCTURAL STABILITY ASSESSMENT



Submitted to
Illinois Power Resources
Generating, LLC
7800 S. Cilco Lane
Bartonville, IL 61607

Submitted by
AECOM
1001 Highlands Plaza Drive West
Suite 300
St. Louis, MO 63110

October 2016

CCR Rule Report: Initial Structural Stability Assessment

For

Ash Pond

At Edwards Power Station

1 Introduction

This Coal Combustion Residual (CCR) Rule Report documents that the Ash Pond at the Illinois Power Resources Generating, LLC Edwards Power Station meets the structural stability assessment requirements specified in 40 Code of Federal Regulations (CFR) §257.73(d), except as noted herein. The Ash Pond is located near Bartonville, Illinois in Peoria County, approximately 0.1 miles west of the Edwards Power Station. The Ash Pond serves as the wet impoundment basin for CCR materials produced by the Edwards Power Station.

The Ash Pond is an existing CCR surface impoundment as defined by 40 CFR §257.53. The CCR Rule requires that an initial structural stability assessment for an existing CCR surface impoundment be completed by October 17, 2016. In general, the initial structural stability assessment must document that the design, construction, operation, and maintenance of the CCR unit is consistent with recognized and generally accepted good engineering practices.

The owner or operator of the CCR unit must obtain a certification from a qualified professional engineer stating that the initial structural stability assessment was conducted in accordance with the requirements of 40 CFR § 257.73(d). The owner or operator must prepare a periodic structural stability assessment every five years.

2 Initial Structural Stability Assessment

40 CFR §257.73(d)(1)

The owner or operator of the CCR unit must conduct initial and periodic structural stability assessments and document whether the design, construction, operation, and maintenance of the CCR unit is consistent with recognized and generally accepted good engineering practices for the maximum volume of CCR and CCR wastewater which can be impounded therein. The assessment must, at a minimum, document whether the CCR unit has been designed, constructed, operated, and maintained with [the standards in (d)(1)(i)-(vii)].

An initial structural stability assessment has been performed to document that the design, construction, operation and maintenance of the Ash Pond is consistent with recognized and generally accepted good engineering practices. The results of the structural stability assessment are discussed in the following sections. Based on the assessment and its results, the design, construction, operation, and maintenance of the Ash Pond were found to be consistent with recognized and generally accepted good engineering practices, and meets the standards in 257.73(d)(1)(i)-(vii), except as noted herein.

2.1 Foundations and Abutments (§257.73(d)(1)(i))

CCR unit designed, constructed, operated, and maintained with stable foundations and abutments.

The stability of the foundations was evaluated using soil data from field investigations and reviewing design drawings, operational and maintenance procedures, and conditions observed in the field by AECOM. Additionally, slope stability analyses were performed to evaluate slip surfaces passing through the foundations and the abutments.

The foundation consists of soft to stiff soil. Slope stability analyses exceed the criteria listed in §257.73(e)(1) for slip surfaces passing through the foundation and abutments. The slope stability analyses are discussed in the *CCR Rule Report: Initial Safety Factor Assessment for Ash Pond at Edwards Power Station (October 2016)*. A review of operational and maintenance procedures as well as current and past performance of the dikes has determined appropriate processes are in place for continued operational performance.

Based on the conditions observed by AECOM, the Ash Pond was designed and constructed with stable foundations. Operational and maintenance procedures are in place to address any issues related to the stability of foundations. Therefore, the Ash Pond meets the requirements in §257.73(d)(1)(i).

2.2 Slope Protection (§257.73(d)(1)(ii))

CCR unit designed, constructed, operated, and maintained with adequate slope protection to protect against surface erosion, wave action and adverse effects of sudden drawdown.

The adequacy of slope protection was evaluated by reviewing design drawings, operational and maintenance procedures, and conditions observed in the field by AECOM.

Based on this evaluation, adequate slope protection was designed and constructed at the Ash Pond. No evidence of significant areas of erosion or wave action were observed. The interior slopes are covered with vegetation in some areas and crushed stone in other areas. The exterior slopes are covered in vegetation with some limited areas of crushed stone. Operational and maintenance procedures to repair the vegetation and crushed stone as needed are appropriate to protect against surface erosion and wave action. Intentional or unintentional sudden drawdown of the pool in the Ash Pond is not expected to occur due to the characteristics of the spillway structure.

Because sudden drawdown conditions are not expected to occur, slope protection to protect against the adverse effects of sudden drawdown is not required. Therefore, the Ash Pond meets the requirements in §257.73(d)(1)(ii).

2.3 Dike Compaction (§257.73(d)(1)(iii))

CCR unit designed, constructed, operated, and maintained with dikes mechanically compacted to a density sufficient to withstand the range of loading conditions in the CCR unit.

The density of the dike materials was evaluated using soil data from field investigations and reviewing design drawings, operational and maintenance procedures, and conditions observed in the field by AECOM. Additionally, slope stability analyses were performed to evaluate slip surfaces passing through the dike over the range of expected loading conditions as defined within §257.73(e)(1).

Based on this evaluation, the dike consists of soft to very stiff material that is stiff on average, which is indicative of mechanically compacted dikes. Slope stability analyses factors of safety exceed the criteria listed in §257.73(e)(1) for slip surfaces passing through the dike. The slope stability analyses are discussed in the *CCR Rule Report: Initial Safety Factor Assessment for the Ash Pond at Edwards Power Station* (October 2016); therefore, the original design and construction of the Ash Pond included sufficient dike compaction and density. Operational and maintenance procedures are in place to identify and mitigate deficiencies in order to maintain sufficient compaction of the dikes to withstand the range of loading conditions. Therefore, the Ash Pond meets the requirements in §257.73(d)(1)(iii).

2.4 Vegetated Slopes (§257.73(d)(1)(iv))¹

CCR unit designed, constructed, operated, and maintained with vegetated slopes of dikes and surrounding areas, except for slopes which have an alternate form or forms of slope protection.

The adequacy of slope vegetation was evaluated by reviewing design drawings, operational and maintenance procedures, and conditions observed in the field by AECOM.

Based on this evaluation, the vegetation on the exterior and interior slopes is adequate as no substantial bare or overgrown areas were observed. Crushed stone is present in some locations on the interior and exterior slopes, which is an alternate form of slope protection. Therefore, the original design and construction of the Ash Pond included adequate vegetation of the dikes and surrounding areas. Adequate operational and maintenance procedures are in place to regularly manage vegetation growth, including mowing and seeding any bare areas, as evidenced by the conditions observed by AECOM. Therefore, the Ash Pond meets the requirements in §257.73(d)(1)(iv).

¹ As modified by court order issued June 14, 2016, *Utility Solid Waste Activities Group v. EPA*, D.C. Cir. No. 15-1219 (order granting remand and vacatur of specific regulatory provisions).

2.5 Spillways (§257.73(d)(1)(v))

CCR unit designed, constructed, operated, and maintained with a single spillway or a combination of spillways configured as specified in [paragraph (A) and (B)]:

(A) All spillways must be either:

- (1) of non-erodible construction and designed to carry sustained flows; or*
- (2) earth- or grass-lined and designed to carry short-term, infrequent flows at non-erosive velocities where sustained flows are not expected.*

(B) The combined capacity of all spillways must adequately manage flow during and following the peak discharge from a:

- (1) Probable maximum flood (PMF) for a high hazard potential CCR surface impoundment; or*
- (2) 1000-year flood for a significant hazard potential CCR surface impoundment; or*
- (3) 100-year flood for a low hazard potential CCR surface impoundment.*

The spillway was evaluated using design drawings, operational and maintenance procedures, and conditions observed in the field by AECOM. Additionally, hydrologic and hydraulic analyses were completed to evaluate the capacity of the spillway relative to inflow estimated for the probable maximum flood event for the high hazard potential Ash Pond. The hazard potential classification assessment was performed by Stantec in 2016 in accordance with §257.73(a)(2).

The primary spillway is comprised of a drop inlet riser structure that is constructed of either a corrugated metal pipe (CMP) or reinforced concrete pipe (RCP), and a CMP outlet pipe. The CMP and concrete (if present) are non-erodible materials designed to carry sustained flows. The capacity of the spillway was evaluated using hydrologic and hydraulic analysis performed per §257.82(a). The analysis found that the spillway can adequately manage flow during peak discharge resulting from the Probable Maximum Flood storm event without overtopping of the embankments. The hydrologic and hydraulic analyses are discussed in the *CCR Rule Report: Initial Inflow Design Flood Control System Plan for Ash Pond at Edwards Power Station* (October 2016). Operational and maintenance procedures are in place to repair any issues with the spillway and remove debris or other obstructions from the spillway, as evidenced by the conditions observed by AECOM. As a result, these procedures are appropriate for maintaining the spillway. Therefore, the Ash Pond meets the requirements in §257.73(d)(1)(v).

2.6 Stability and Structural Integrity of Hydraulic Structures (§257.73(d)(1)(vi))

CCR unit designed, constructed, operated, and maintained with hydraulic structures underlying the base of the CCR unit or passing through the dike of the CCR unit that maintain structural integrity and are free of significant deterioration, deformation, distortion, bedding deficiencies, sedimentation, and debris which may negatively affect the operation of the hydraulic structure.

Two hydraulic structures are present which pass through the dike of the Ash Pond: the CMP primary spillway outlet pipe and a high-density polyethylene (HDPE) sewer force main. The stability and structural integrity of the pipes were evaluated using design drawings, operational and maintenance procedures, inspections, and conditions observed in the field by AECOM. No other hydraulic structures are known to pass through the dike of or underlie the base of the Edwards Ash Pond.

The evaluation of design drawings and operational and maintenance procedures and conditions observed in the field did not identify any issues with either hydraulic structure. However, the evaluation of the stability and structural integrity of both hydraulic structures has not been fully completed, as high pipe flows in the primary spillway, required for operation of the Edwards Power Station, preclude closed circuit television (CCTV) inspection. Additionally, access issues preclude complete inspection of the sewer force main pipe, although a partial inspection was performed which found the inspected portions of the hydraulic structure to be free of significant deterioration, deformation, distortion, bedding deficiencies, sedimentation, and debris that may negatively affect the operation of the hydraulic structure.

Based on this evaluation, the hydraulic structures at the Edwards Power Station cannot be certified to meet the requirements of §257.73(d)(1)(vi) because a complete CCTV inspection of both hydraulic structures has not yet been performed, thus, precluding completion of the evaluation of the stability and structural integrity of the pipes. In accordance with §257.73(d)(2), AECOM recommends that a CCTV pipe inspection of both hydraulic structures be completed as soon as feasible and that this assessment be updated once the inspection is completed.

2.7 Downstream Slope Inundation/Stability (§257.73(d)(1)(vii))

CCR unit designed, constructed, operated, and maintained with, for CCR units with downstream slopes which can be inundated by the pool of an adjacent water body, such as a river, stream or lake, downstream slopes that maintain structural stability during low pool of the adjacent water body or sudden drawdown of the adjacent water body.

The structural stability of the downstream slopes of the Ash Pond was evaluated by comparing the location of the Ash Pond relative to adjacent water bodies using published Federal Emergency Management Agency (FEMA) Flood Insurance Rate Maps (FIRMs), aerial imagery, and conditions observed in the field by AECOM.

Based on this evaluation, water bodies are not expected to inundate the downstream slopes of the Ash Pond. Although the Ash Pond is shown within the 100-year flood zone for the Illinois River on the FEMA FIRM map for the area, the Ash Pond is located behind a United States Army Corps of Engineers (USACE) levee. The levee was constructed to an elevation of 462 feet, which is 3 feet higher than the 100-year elevation of the Illinois River listed on the FIRM map (459 feet). Therefore, inundation of the downstream slopes is not expected to occur.

Based on this evaluation, the requirements in §257.73(d)(1)(vii) are not applicable to the Ash Pond, as inundation of the downstream slopes is not expected to occur.

3 Certification Statement

CCR Unit: Illinois Power Resources Generating, LLC; Edwards Power Station; Ash Pond

I, Victor A. Modeer, being a Registered Professional Engineer in good standing in the State of Illinois, do hereby certify, to the best of my knowledge, information, and belief that the information contained in this CCR Rule Report, and the underlying data in the operating record, has been prepared in accordance with the accepted practice of engineering. I certify, for the above-referenced CCR Unit, that the initial structural stability assessment dated October 13, 2016 was conducted in accordance with the requirements of 40 CFR § 257.73(d).

VICTOR A. MODEER JR.
Printed Name

10/13/16
Date



About AECOM

AECOM (NYSE: ACM) is a global provider of professional technical and management support services to a broad range of markets, including transportation, facilities, environmental, energy, water and government. With nearly 100,000 employees around the world, AECOM is a leader in all of the key markets that it serves. AECOM provides a blend of global reach, local knowledge, innovation, and collaborative technical excellence in delivering solutions that enhance and sustain the world's built, natural, and social environments. A Fortune 500 company, AECOM serves clients in more than 100 countries and has annual revenue in excess of \$19 billion.

More information on AECOM and its services can be found at www.aecom.com.

1001 Highlands Plaza Drive West
Suite 300
St. Louis, MO 63110
1-314-429-0100



Office Memorandum

Date: November 17, 2020

To: Cynthia Vodopivec

cc: Matt Ballance
Jason Campbell
Charles Koudelka

From: Vic Modeer

Subject: Ash Pond Structural Stability Assessment
Illinois Power Resources Generating, LLC
Edwards Power Station

BACKGROUND

The October 2016 certified "CCR Rule Report: Initial Structural Stability Assessment for the Ash Pond at the Edwards Power Station" (CCR Certification Report) prepared by AECOM for Illinois Power Resources Generating, LLC (IPRG) describes the outlets for the northern portion and southern portion of the Ash Pond. There are two hydraulic structures that pass through the dike of the Ash Pond, a 36-inch corrugated metal pipe (CMP) primary spillway outlet and a 6-inch HDPE sewer force main. No other hydraulic structures pass through the dike of or underlie the base of the Edwards Ash Pond. The AECOM report states that the hydraulic structures cannot be structurally certified due to inability to complete a closed-circuit television inspection of both structures. However, the spillway system and sewer force main have been inspected numerous times thereafter and found to be structurally sufficient.

The spillway system for the Ash Pond includes a standpipe spillway structure that consists of vertically stacked 36-inch diameter (dia.) CMP pipe sections seated on a concrete drop inlet structure and pad. The spillway structure discharges clarified plant process water and CCR contact stormwater through the 36-inch dia. CMP and into the Illinois River in accordance with the station's NPDES permit. A galvanized 8-gauge CMP pipe was originally installed in 1958. The standpipe was extended in height and reported to be inspected in 1975 and 2003. The 2003 extension brought the standpipe spillway to the current elevation.

Pipe Inspections and Structural Stability Statements. AECOM's 2016 report could not certify that the hydraulic structures at the Edwards Ash Pond met the requirements of § 257.73(d)(1)(vi) because of the inability to internally inspect the pipes due to the high flow volume. However, the standpipe spillway vertical section was visually inspected, no leaks were

observed, and the standpipe was observed to be intact. In addition, approximately 600 feet of the approximately 2,400-foot long sewer force main were inspected and found to be free of significant deterioration, deformation, distortion, bedding deficiencies, sedimentation, and debris.

Structural Stability – Dike. The stability of the Edwards Ash Pond embankment section at the standpipe spillway (Cross Section I-I, “CCR Certification Report”) had calculated factors of safety of 2.26, (§ 257.73(e)(1)(i) Minimum FS = 1.50), 2.26 (§ 257.73(e)(1)(ii) Minimum = 1.40) and 1.30 (§ 257.73(e)(1)(iii) Minimum = 1.00). The inspection history does not reveal any seepage at the standpipe spillway section.

EVALUATION

Pipe Inspections and Structural Stability Statements.

36” Outlet Pipe. IPRG agrees that the 36” CMP must be visually inspected to ascertain that it is structurally sound. The Pekin Lamarsh Drainage and Levee District is currently working to certify the levees with the U.S. Army Corp of Engineers (USACE) in this reach of the Illinois River. The USACE certification requires inspecting and certifying all pipe structures that pass through an Illinois River levee. The Pekin Lamarsh Drainage and Levee District has entered an agreement with IPRG to temporarily halt the permitted discharge from the Ash Pond into the river and inspect the pipe within the next two months.

IPRG will provide an addendum to the 2016 Structural Stability Assessment that includes the results of the pipe inspection.

6” Sewer Force Main. The sewer force main is an HDPE pipe. The wall thickness is approximately 0.5.” It is important to note that the HDPE pipe is not subject to a corrosion related failure based on the material of the pipe. Also, there is not enough pumping pressure to cause a rupture. Finally, the pipe does not carry abrasive solids at a high enough velocity to cause erosive depletion in the wall thickness. The HDPE pipe under the 6” sewer force main is buried deep enough that operating conditions at the site do not subject it to conditions that would cause a collapse.

The sewer force main does not penetrate the dike at locations where there is ponded water, such as would be the case in the clarifying ponded section of this impoundment (*Kumar, G., Cecchin, I., Thomé, A. and Reddy, K.R., “Failure of Coal Ash Containment Facilities: Causes, Impacts, Remediation, and Lessons Learned,” 5th International Conference on Forensic Geotechnical Engineering, ISSMGE, 2016*). The likelihood would rise if the conduit were in the ponded location, but the ash type and pond details do not lend themselves to that type of failure with this 6” Sewer Force Main. The pond is filled with bottom ash that has been shown not to flow freely if an embankment of the Edwards Ash Pond height failure occurred (*S. Mohanty and N. R. Patra, “Liquefaction and Earthquake Response Analysis of Panipat Pond Ash Embankment in India,” Journal of Earthquake and Tsunami, 2016, Vol 10.04; AECOM, “Root Cause Analysis Report, TVA Kingston Dredge Pond Failure,” Report to TVA, June 25, 2009*). The height of embankment and the height of the water level in the pond are not conducive to a piping failure that could cause a flow release of bottom ash (*Foster, M., Fell, R. and Spannagle, M.,*

2000. A method for assessing the relative likelihood of failure of embankment dams by piping. *Canadian Geotechnical Journal*, 37(5), pp.1025-1061).

Accordingly, the sewer force main is structurally sufficient and meets the requirements of § 257.73(d)(1)(vi).

Please let me know if you have any questions.

Sincerely,

A handwritten signature in blue ink, appearing to read "Vic Modeer". The signature is fluid and cursive, with a large initial "V" and "M".

Vic Modeer, PE, D.GE
(IL, MO, IN, KY, OH, LA)
Consulting Engineer

ATTACHMENT 8 – SAFETY FACTOR ASSESSMENT



Submitted to
Illinois Power Resources
Generating, LLC
7800 S. Cilco Lane
Bartonville, IL 61607

Submitted by
AECOM
1001 Highlands Plaza Drive West
Suite 300
St. Louis, MO 63110

October 2016

CCR Rule Report: Initial Safety Factor Assessment

For

Ash Pond

At Edwards Power Station

1 Introduction

This Coal Combustion Residual (CCR) Rule Report documents that the Ash Pond at the Illinois Power Resources Generating, LLC Edwards Power Station meets the safety factor assessment requirements specified in 40 Code of Federal Regulations (CFR) §257.73(e). The Ash Pond is located near Bartonville, Illinois in Peoria County, approximately 0.1 miles west of the Edwards Power Station. The Ash Pond serves as the wet impoundment basin for CCR material produced by the Edwards Power Station.

The Ash Pond is an existing CCR surface impoundment as defined by 40 CFR §257.53. The CCR Rule requires that the initial safety factor assessment for an existing CCR surface impoundment be completed by October 17, 2016.

The owner or operator of the CCR unit must obtain a certification from a qualified professional engineer stating that the initial safety factor assessment meets the requirements of 40 CFR § 257.73(e). The owner or operator must prepare a safety factor assessment every five years.

2 Initial Safety Factor Assessment

40 CFR §257.73(e)(1)

The owner or operator must conduct initial and periodic safety factor assessments for each CCR unit and document whether the calculated factors of safety for each CCR unit achieve the minimum safety factors specified in (e)(1)(i) through (iv) of this section for the critical cross section of the embankment. The critical cross section is the cross section anticipated to be the most susceptible of all cross sections to structural failure based on appropriate engineering considerations, including loading conditions. The safety factor assessments must be supported by appropriate engineering calculations.

(i) The calculated static factor of safety under the long-term, maximum storage pool loading condition must equal or exceed 1.50.

(ii) The calculated static factor of safety under the maximum surcharge pool loading condition must equal or exceed 1.40.

(iii) The calculated seismic factor of safety must equal or exceed 1.00.

(iv) For dikes constructed of soils that have susceptibility to liquefaction, the calculated liquefaction factor of safety must equal or exceed 1.20.

A geotechnical investigation program and stability analyses were performed to evaluate the design, performance, and condition of the earthen dikes of the Ash Pond. The exploration consisted of auger borings, cone penetrating testing, and laboratory program including index, strength, and consolidation testing. Data collected from the geotechnical investigation, available design drawings, construction records, inspection reports, previous engineering investigations, and other pertinent historic documents were utilized to perform the safety factor assessment and geotechnical analyses.

In general, the subsurface conditions at the Ash Pond consist of a soft to very stiff compacted ash and clay dike, overlying stiff alluvial clay, overlying soft to medium stiff alluvial clay, which in turn overlies shale bedrock. Phreatic water is typically located above the embankment/foundation interface beneath the crest of the dike, and at the embankment/foundation interface near the toe of the dike.

Ten (10) representative cross sections were analyzed using limit equilibrium slope stability analysis software to evaluate stability of the perimeter dike system and foundations. The cross sections were located to represent critical surface geometry, subsurface stratigraphy, and phreatic conditions across the site. Each cross section was evaluated for each of the loading conditions stipulated in §257.73(e)(1).

The Soils Susceptible to Liquefaction loading condition, §257.73(e)(1)(iv), was not evaluated because a liquefaction susceptibility evaluation did not find soils susceptible to liquefaction within the Ash Pond dikes. As a result, this loading condition is not applicable to the Ash Pond at the Edwards Power Station.

Results of the Initial Safety Factor Assessments, for the critical cross-section, (i.e., the lowest calculated factor of safety out of the cross sections analyzed for each loading condition) are listed in Table 1.

Table 1 – Summary of Initial Safety Factor Assessment

Loading Conditions	§257.73(e)(1) Subsection	Minimum Factor of Safety	Calculated Factor of Safety
Maximum Storage Pool Loading	(i)	1.50	1.54
Maximum Surcharge Pool Loading	(ii)	1.40	1.54
Seismic	(iii)	1.00	1.08
Soils Susceptible to Liquefaction	(iv)	1.20	Not Applicable

Based on this evaluation, the Ash Pond meets the requirements in §257.73(e)(1).


3 Certification Statement

CCR Unit: Illinois Power Resources Generating, LLC; Edwards Power Station; Ash Pond

I, Victor A. Modeer, being a Registered Professional Engineer in good standing in the State of Illinois, do hereby certify, to the best of my knowledge, information, and belief that the information contained in this CCR Rule Report, and the underlying data in the operating record, has been prepared in accordance with the accepted practice of engineering. I certify, for the above-referenced CCR Unit, that the initial safety factor assessment dated October 13, 2016 meets the requirements of 40 CFR §257.73(e).

VICTOR A MODEER JR
Printed Name

10/13/16
Date

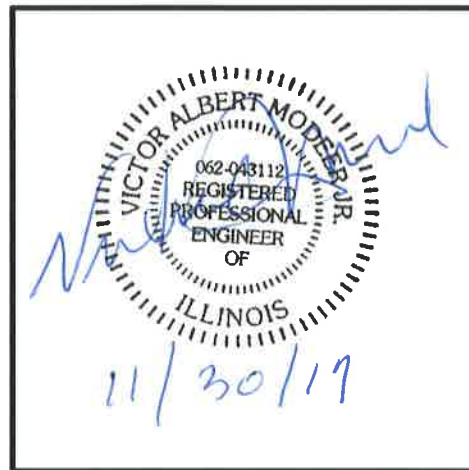

About AECOM

AECOM (NYSE: ACM) is a global provider of professional technical and management support services to a broad range of markets, including transportation, facilities, environmental, energy, water and government. With nearly 100,000 employees around the world, AECOM is a leader in all of the key markets that it serves. AECOM provides a blend of global reach, local knowledge, innovation, and collaborative technical excellence in delivering solutions that enhance and sustain the world's built, natural, and social environments. A Fortune 500 company, AECOM serves clients in more than 100 countries and has annual revenue in excess of \$19 billion.

More information on AECOM and its services can be found at www.aecom.com.

1001 Highlands Plaza Drive West
Suite 300
St. Louis, MO 63110
1-314-429-0100

ATTACHMENT 9 – CLOSURE PLAN

CLOSURE PLAN FOR EXISTING CCR SURFACE IMPOUNDMENT
40 CFR 257.102(b)
REV 0 – 10/17/2016

SITE INFORMATION

Site Name / Address	Edwards Power Station / 7800 South CILCO Lane, Bartonville, IL 61607		
Owner Name / Address	Illinois Power Resources Generating, LLC / 1500 Eastport Plaza Drive, Collinsville, IL 62234		
CCR Unit	Ash Pond	Closure Method and Final Cover Type	Close In-Place Clayey Soil Cover with Vegetation

CLOSURE PLAN DESCRIPTION

(b)(1)(i) – Narrative description of how the CCR unit will be closed in accordance with this section.	The Ash Pond will be dewatered, as necessary, to facilitate closure by leaving CCR in place. The CCR in the Ash Pond will be shaped and graded. The final cover will be sloped to promote drainage and stormwater runoff will be conveyed through a series of drainage channels on the cover system toward the existing vertical drop outlet structure on the east side of the Ash Pond. Existing pipes and their support structures into or within the Ash Pond will be removed from service. In accordance with 257.102(b)(3), this initial written closure plan will be amended to provide additional details after the final engineering design for the grading and cover system is completed, if the final design would substantially affect this written closure plan. This initial closure plan reflects the information available to date.
(b)(1)(iii) – If closure of the CCR unit will be accomplished by leaving CCR in place, a description of the final cover system and methods and procedures used to install the final cover.	The soils for the final cover system will be placed directly on top of the graded CCR material to achieve final grades and will include (from bottom up): 1) 18” of compacted earthen material with a permeability of less than or equal to the permeability of the natural subsoils present at the site or no greater than 1×10^{-5} cm/sec, whichever is less; 2) 6” of soil capable of sustaining native plant growth; and 3) planted native grasses. Emplaced CCR material will be regraded as fill and supplemented with borrow soils as necessary to achieve design grades. Earthen material will be placed, graded, and compacted to meet the thickness and permeability as discussed above for the cover system. Organic earthen material will be placed on top of the 18” of compacted soils to create a 6” soil layer capable of sustaining native plant growth. The final cover surface will be seeded and vegetated. The final cover slope will have a minimum slope of 2% and will be graded to convey stormwater runoff to drainage pipes installed from the center of the cover area, through the berm, and to surface discharge.
(b)(1)(iii) – How the final cover system will achieve the performance standards in 257.102(d).	
(d)(1)(i) Control, minimize or eliminate, to the maximum extent feasible, post-closure infiltration of liquids into the waste and releases of CCR, leachate, or contaminated run-off to the ground or surface waters or to the atmosphere.	The permeability of the final cover will be equal to or less than the permeability of the natural subsoils present below the CCR material or permeability no greater than 1×10^{-5} cm/sec, whichever is less. Therefore, the permeability of the final cover system will not be greater than 1×10^{-5} cm/sec. The final cover system will be graded with a minimum 2% slope.
(d)(1)(ii) – Preclude the probability of future impoundment of water, sediment, or slurry.	The final cover will be installed with a minimum 2% slope. Drainage channels will be installed with a minimum 0.5% slope.
(d)(1)(iii) – Include measures that provide for major slope stability to prevent the sloughing or movement of the final cover system during the closure and post-closure care period.	The final cover will have a minimum 2% slope and drainage channels will have minimum 0.5% slope. Drainage channels will be lined with turf reinforced mats where required to reduce the potential for erosion. The final slope of the berms and cover will meet the stability requirements to prevent sloughing or movement of the final cover system.
(d)(1)(iv) – Minimize the need for further maintenance of the CCR unit.	The final cover will be vegetated to minimize erosion and maintenance.

CLOSURE PLAN DESCRIPTION	
(d)(1)(v) – Be completed in the shortest amount of time consistent with recognized and generally accepted good engineering practices.	Closure is estimated to be completed no later than five years upon commencement of closure activities.
(d)(2)(i) – Free liquids must be eliminated by removing liquid wastes or solidifying the remaining wastes and waste residue.	The unit will be dewatered sufficiently, as necessary, to remove the free liquids to provide a stable base for the construction of the final cover system.
(d)(2)(ii) – Remaining wastes must be stabilized sufficiently to support the final cover system.	Dewatering as necessary and regrading of existing in-place CCR will sufficiently stabilize the waste such that the final cover will be supported.
(d)(3) – A final cover system must be installed to minimize infiltration and erosion, and at minimum, meets the requirements of (d)(3)(i).	The final cover will consist of a minimum 18" earthen material layer with permeability equal to or less than the permeability of the natural subsoils or no greater than 1×10^{-5} cm/sec, whichever is less. Therefore, the permeability of the final cover system will be not greater than 1×10^{-5} cm/sec. Erosion will be minimized with a soil layer of no less than 6" of earthen material capable of sustaining native plant growth. The final cover surface will be seeded and vegetated.
(d)(3)(i) – The design of the final cover system must be included in the written closure plan.	When the design of the final cover system is completed, the written closure plan will be amended if the final design would substantially change this written closure plan. The design of the final cover system will meet the requirements of §(d)(3)(i)(A)–(D) as described below.
(d)(3)(i)(A) – The permeability of the final cover system must be less than or equal to the permeability of any bottom liner system or natural subsoils present, or a permeability no greater than 1×10^{-5} cm/sec, whichever is less.	The permeability of the final cover will be equal to or less than the permeability of the natural subsoils or no greater than 1×10^{-5} cm/sec, whichever is less. Therefore, the permeability of the final cover system will be not greater than 1×10^{-5} cm/sec.
(d)(3)(i)(B) – The infiltration of liquids through the closed CCR unit must be minimized by the use of an infiltration layer than contains a minimum of 18 inches of earthen material.	The final cover will include a minimum of 18" of compacted earthen material with a permeability equal to or less than the permeability of the natural subsoils or no greater than 1×10^{-5} cm/sec, whichever is less. Therefore, the permeability of the final cover system will be not greater than 1×10^{-5} cm/sec.
(d)(3)(i)(C) – The erosion of the final cover system must be minimized by the use of an erosion layer that contains a minimum of six inches of earthen material that is capable of sustaining native plant growth.	The final cover will include a minimum of 6" of an earthen erosion layer that is capable of sustaining native plant growth. The final cover will be seeded and vegetated.
(d)(3)(i)(D) – The disruption of the integrity of the final cover system must be minimized through a design that accommodates settling and subsidence.	The final cover will be installed with a minimum 2% slope and will incorporate calculated settlement as well as differential settling and subsidence.
INVENTORY AND AREA ESTIMATES	
(b)(1)(iv) – Estimate of the maximum inventory of CCR ever on-site over the active life of the CCR unit	5,300,000 cubic yards
(b)(1)(v) – Estimate of the largest area of the CCR unit ever requiring a final cover	91 acres

CLOSURE SCHEDULE	
(b)(1)(vi) – Schedule for completing all activities necessary to satisfy the closure criteria in this section, including an estimate of the year in which all closure activities for the CCR unit will be completed. The schedule should provide sufficient information to describe the sequential steps that will be taken to close the CCR unit, including major milestones and the estimated timeframes to complete each step or phase of CCR unit closure.	
The milestone and the associated timeframes are initial estimates. Some of the activities associated with the milestones will overlap. Amendments to the milestones and timeframes will be made as more information becomes available.	
Written Closure Plan	October 17, 2016
Notification of Intent to Close Placed in Operating Record	No later than the date closure of the CCR unit is initiated. Closure to commence in accordance with the applicable timeframes in 40 CFR 257.102(e).
Agency coordination and permit acquisition <ul style="list-style-type: none"> Coordinating with state agencies for compliance Acquiring state permits 	Year 1 – 5 (estimated) Year 1 (estimated)
Mobilization	Year 1 (estimated)
Dewater and stabilize CCR <ul style="list-style-type: none"> Complete dewatering, as necessary Complete stabilization of CCR 	Year 2 (estimated) Year 2 (estimated)
Grading <ul style="list-style-type: none"> Grading of CCR material in pond to facilitate surface water drainage 	Year 2 - 5 (estimated)
Installation of final cover	Year 2 - 5 (estimated)
Estimate of Year in which all closure activities will be completed	Year 5
AMENDMENT AND CERTIFICATION	
(b)(3)(i) – The owner or operator may amend the initial or any subsequent written closure plan developed pursuant to 257.102(b)(1) at any time.	This initial closure plan will be amended as required by 257.102(b)(3) and, as allowed by 257.102(b)(3), may be amended at any time, including as more information becomes available.
(b)(3)(ii) – The owner or operator must amend the written closure plan whenever: (A) There is a change in the operation of the CCR unit that would substantially affect the written closure plan in effect; or (B) Before or after closure activities have commenced, unanticipated events necessitate a revision of the written closure plan.	
(b)(3)(iii) – The owner or operator must amend the closure plan at least 60 days prior to a planned change in the operation of the facility or CCR unit, or no later than 60 days after an unanticipated event requires the need to revise an existing written closure plan. If a written closure plan is revised after closure activities have commenced for a CCR unit, the owner or operator must amend the current closure plan no later than 30 days following the triggering event.	
(b)(4) – The owner or operator of the CCR unit must obtain a written certification from a qualified professional engineer that the initial and any amendment of the written closure plan meets the requirements of this 40 CFR 257.102.	Certification by a qualified professional engineer will be appended to this plan.

Certification Statement 40 CFR § 257.102 (d)(3)(iii) – Design of the Final Cover System for a CCR Surface Impoundment

CCR Unit: Illinois Power Resources Generating, LLC; Edwards Power Station; Ash Pond


I, Victor Modeer, being a Registered Professional Engineer in good standing in the State of Illinois, do hereby certify, to the best of my knowledge, information, and belief, that the information contained in this certification has been prepared in accordance with the accepted practice of engineering. I certify, for the above referenced CCR Unit, that the design of the final cover system as included in the initial written closure plan, dated October 17, 2016, meets the requirements of 40 CFR § 257.102.

Victor Modeer, PE, D.GE

Printed Name

10/13/16

Date

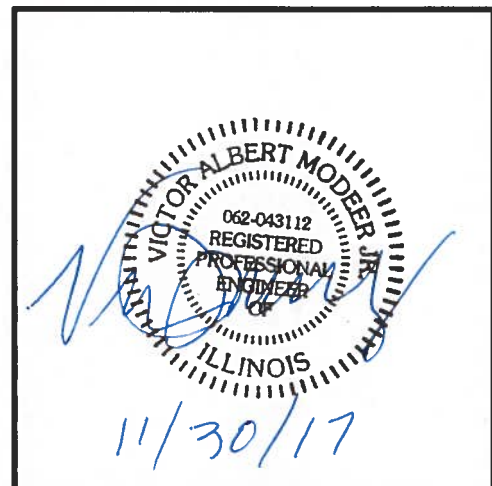

Certification Statement 40 CFR § 257.102 (b)(4) – Initial Written Closure Plan for a CCR Surface Impoundment

CCR Unit: Illinois Power Resources Generating, LLC; Edwards Power Station; Ash Pond


I, Victor Modeer, being a Registered Professional Engineer in good standing in the State of Illinois, do hereby certify, to the best of my knowledge, information, and belief, that the information contained in this certification has been prepared in accordance with the accepted practice of engineering. I certify, for the above referenced CCR Unit, that the information contained in the initial written closure plan, dated October 17, 2016, meets the requirements of 40 CFR § 257.102.

Victor Modeer, PE, D.GE

Printed Name

10/13/14

Date

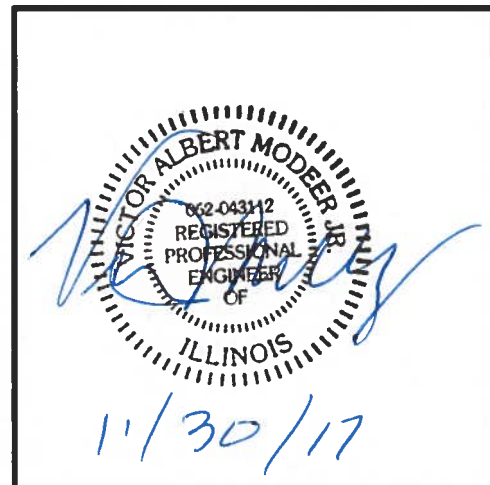

40 C.F.R. § 257.102(B)(3): Closure Plan Addendum
Edwards Ash Pond
September 29, 2020

ADDENDUM NO. 1 EDWARDS ASH POND CLOSURE PLAN


This Addendum No. 1 to the Closure Plan for Existing Coal Combustion Residuals (CCR) Impoundment for the Edwards Ash Pond at the Edwards Power Station, Revision 0 - October 17, 2016 has been prepared to meet the requirements of Title 40 of the Code of Federal Regulations (40 C.F.R.) Section 257.103(f)(2)(v)(D) as a component of the demonstration that the Edwards Ash Pond qualifies for a site-specific alternative deadline to initiate closure due to permanent cessation of a coal-fired boiler by a certain date.

The Edwards Ash Pond will begin construction of closure and cease receipt of CCR and non-CCR wastestreams no later than April 17, 2026 as indicated in the Edwards Power Station Alternative Closure Demonstration dated September 29, 2020. Closure will be completed by October 17, 2028 within the 5-year timeframe included in the Closure Schedule identified in the Edwards Ash Pond Closure Plan in accordance with 40 C.F.R. § 257.102(f)(ii).

All other aspects of the Closure Plan remain unchanged.

CERTIFICATION

I, Eric J. Tlachac, a Qualified Professional Engineer in good standing in the State of Illinois, certify that the information in this addendum is accurate as of the date of my signature below. The content of this report is not to be used for other than its intended purpose and meaning, or for extrapolations beyond the interpretations contained herein.



Eric J. Tlachac
Qualified Professional Engineer
062-063091
Illinois

Ramboll Americas Engineering Solutions, Inc., f/k/a O'Brien & Gere Engineers, Inc.

Date: 9/29/2020





CREATE AMAZING.

Burns & McDonnell World Headquarters
9400 Ward Parkway
Kansas City, MO 64114
O 816-333-9400
F 816-333-3690
www.burnsmcd.com