

Kincaid Power Plant Weekly CCR Impoundment Inspection


Date	05/19/21
Inspector Name	DAVE HYBER
Inspector Signature	<i>[Signature]</i>

Pond Level	-14"
Temperature	70°F
Weather	P Cloudy

	Slag Field		Comments	
	Item	Condition		
Embankment	Vertical & Horizontal Alignment of Crest	NE	NORTHWEST BERM BASE (SEE MAP)	
	Seepage	OB		
	Erosion	NE		
	Unusual Movement or Cracking At or Beyond Toe	NE		
	Surface Cracks	NE		
	Sloughing or Erosion of Outer Embankment Slopes	NE		
	Sloughing or Erosion of Inner Embankment Slopes	NE		
	Upstream Face Slope Protection (HDPE Liner)	NE		
	Animal Damage	MM		ANIMAL BURROWS (SEE MAP)
	Vegetative Cover	NE		
	Condition of Piezometers	NE		
	Embankment Drainage Ditches	NE		
	Spillway/Discharge to Canal	Discharge coloration		NE
Seepage		NE		
Alignment		NE		
Condition of Pipe		NE		
Construction Joints		NE		
Differential Settlement		NE		
Discharge Structure	Alignment	NE		
	Connection to Bollard	NE		
	Debris in Inlet	NE		
	Condition of Pipe	NE MM	2 DISCHARGE PIPE BROKE OFF.	
	Seepage at Inlet or Outlet	NE		

Condition Codes

- EC = Emergency Condition. A serious dam safety condition exists that needs immediate action. Report immediately to Chief Dam Safety Engineer and immediate supervisor
- IM = Item needing immediate maintenance to restore or ensure its safety or integrity. Remediation should be completed within 1 month.
- MM = Item needing minor maintenance. The safety or integrity of the item is not yet imperiled.
- OB = Condition requires regular observation to ensure that the condition does not become worse.
- GC = Good Condition.
- NE = No evidence of a problem.
- NI = Not Inspected. Reason should be stated in comment.

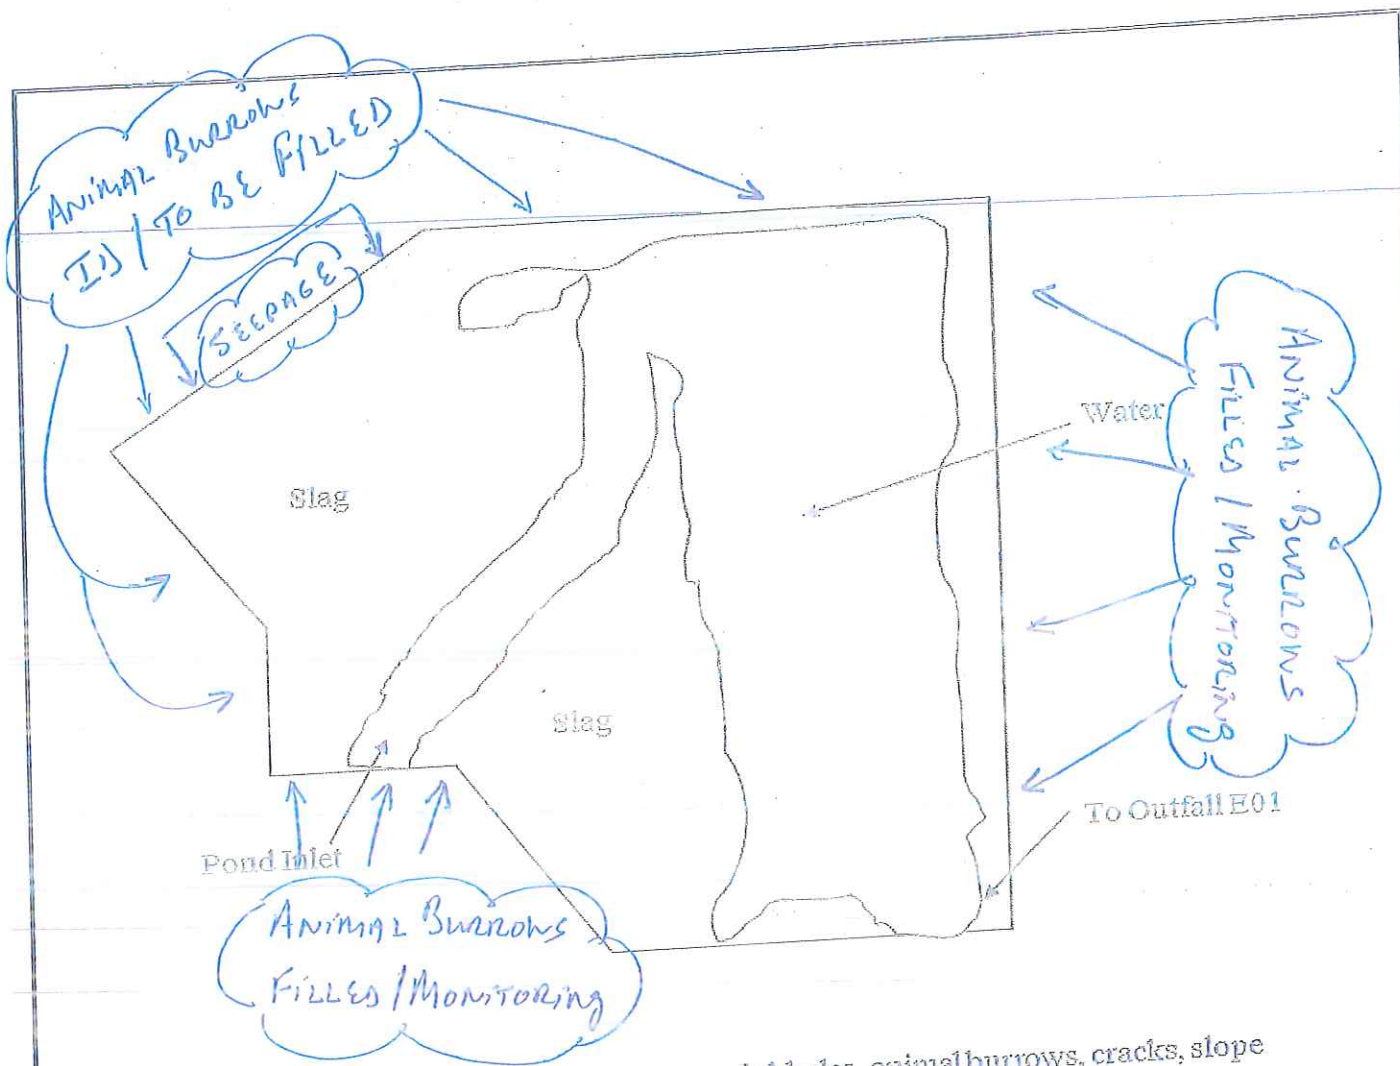

- Note approximate location of seepage, sinkholes, animal burrows, cracks, slope erosions, etc. on sketch above and identify in tables on previous pages
- Keep copy of completed report in Station's CCR Rule Operating Record.

• Animal Burrows Active, Kelly Finding and Filling them.

• Lower roadway EXTREMELY soggy DUE RECENT HEAVY RAINS.